


Fire Detection Control Panel BC016-2 with Evacuation Functions

- For small and mid-sized systems
- Addressable conventional technology with a maximum of 16 zones
- Up to 8 evacuation circuits
- Menu-driven operation
- Free parameter setup via PC software or operating field
- Factory settings allow for easy commissioning
- EN 54/VdS-certified

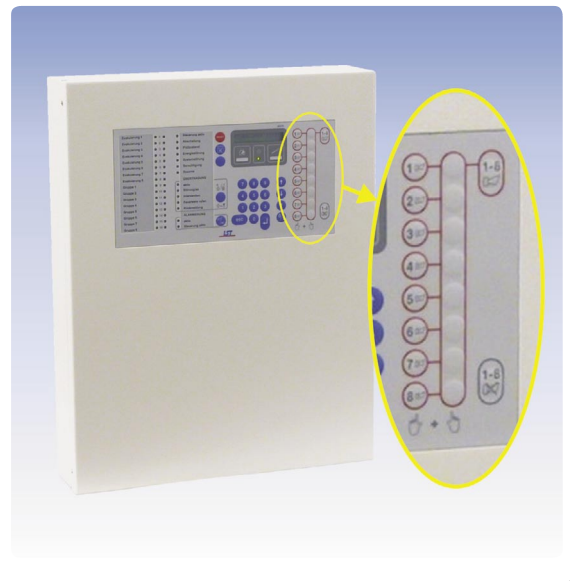

Fire is a permanent threat to life and property. Therefore, immediate response to a fire is imperative. The main objective of the fire detection control panel Series BC016 is to alarm and to react in time and, consequently, save lives and protect property. For decades LST have focused their aims to undertaking unrivaled efforts in order to realize new innovations in the security area. Research, development and production are loca-

ted within LST premises, thus guaranteeing flexible and reliable individual solutions.

Using a powerful processor system, display texts, and a large number of integrated functions, the fire detection control panels Series BC016 ensure topmost efficiency and speed – prerequisites for saving lives and minimizing damage to property.

Description

Fire detection control panel BC016-2 in design and function corresponds to fire detection control panel BC016-1. In addition, the BC016-2 has the possibility to operate up to eight alarming devices as evacuation circuits directly via the expanded keypad of the control panel. These evacuation circuits can be actuated either dependent of the alarm situation of the detector zone or by a superordinate danger detection device.

Using the expanded keypad, you can manually activate or deactivate the alarming devices that have been parameterised as evacuation circuits independent from the alarm situation on the control panel. This way, the user

can manually start or terminate an evacuation alarm on the fire detection control panel without prior alarm of a fire detector. In the LED field, the first zone displays are automatically used for displaying the operating conditions of the evacuation circuits.

For security reasons a two-button operation must be performed to activate an evacuation circuit.

The physical outputs for the control and monitoring of the alarming devices are provided by optional modules (e.g., siren connection module SZ58-3).



Clear Concept

The fire detection control panel BC016-2 has been designed for use in small and mid-sized systems and already in its basic version provides the following features:

- 8 conventional detector lines permit the connection of automatic detectors and manual call points in conventional technology as well as special detectors with contact output. Individual detector identification can be achieved by means of an optional address module.
- A slot for connecting the Detector Zone Extension MGE8-1 is available for the extension to 16 conventional detector lines.
- Dry relay outputs indicate the alarm and fault conditions on the control panel. In addition, 16 open-collector outputs, two auxiliary inputs, and an additional relay output are available for general applications.
- Up to 8 alarming devices can be operated as evacuation circuits directly via the expanded keypad of the fire detection control panel.
- The optional Fire Brigade Interface FWI016-1 allows for the connection of two independent transmitting devices for a direct interconnection to a designated alarm respondent (e.g., the fire brigade) as well as for the connection of a country-specific fire brigade control unit.
- Outputs with open parameters and logical combinations of detector zones for the activation of external controls and alarming devices allow for a maximum of flexibility. Thus, no additional expenses arise for external relays, logic gates or timers. Using these individual combinations of different types of detectors, even fire protection strategies under the most difficult circumstances can be combined into a reasonable concept.
- The LC text display shows all present events with date and time. This allows for quick and targeted reaction in the event of a fire as well as for easy maintenance.
- An event memory allows for the display of the latest 200 events at any time, including all required information. Thus, all system conditions and user operations that occurred are documented in a clearly laid out way.
- A possible breakdown of the central processing board is securely detected and displayed by the system.
- The processor-monitored power supply ensures permanent surveillance and charging of the batteries. This way, even during a power failure the untroubled and uninterrupted operation (for more than 72 hours depending on the design) is guaranteed.
- Three hierarchized authorization levels for operation and parameterisation facilitate a high degree of security against unauthorized access.
- The control panel is easily operated menu-driven via the display and operating field. Clear instructions on the display guide the user during commissioning, operation and maintenance.
- The parameter data can be entered either via the display and operating field or, in a more comfortable way, created by means of the PC software PARSOFT-1 and loaded into the control panel. Thus, a quick and efficient transfer of the system configuration into the control panel is guaranteed.
- After activation, the control panel is immediately ready for operation due to the practical factory setting. This guarantees easy and time-saving commissioning.


The extremely flat wall mount cabinet allows for an easy mounting in virtually any place of the building. Thanks to its modern, ageless design, architectural requirements and demands of the respective regulations are ideally combined. The compact design allows for the accommodation of the optional Detector Zone Extension, the Fire Brigade Interface, the Serial Interface Module, up to 3 auxiliary modules (e.g., relay module, siren connection module) and batteries up to 22Ah apart from the central processing board in the standard case. Series BC016 thus stands for modularity and easy expansion.

This product complies with all relevant standards of EN 54 and is VdS-certified. In addition, the product also holds several country-specific approvals and certificates. LST's high quality level is secured by a permanently monitored quality management system certified by ISO 9001.

Permanent Connection

A variety of peripheral devices can be connected to the fire detection control panel BC016-2:

- Fire brigade key safe
- Fire brigade control unit
- Acoustic and optical signaling devices
- External protocol printer
- Remote indication unit
- Actuators
- Modules for remote parameterisation and remote maintenance via computer network, modem or GSM connection – and much more.

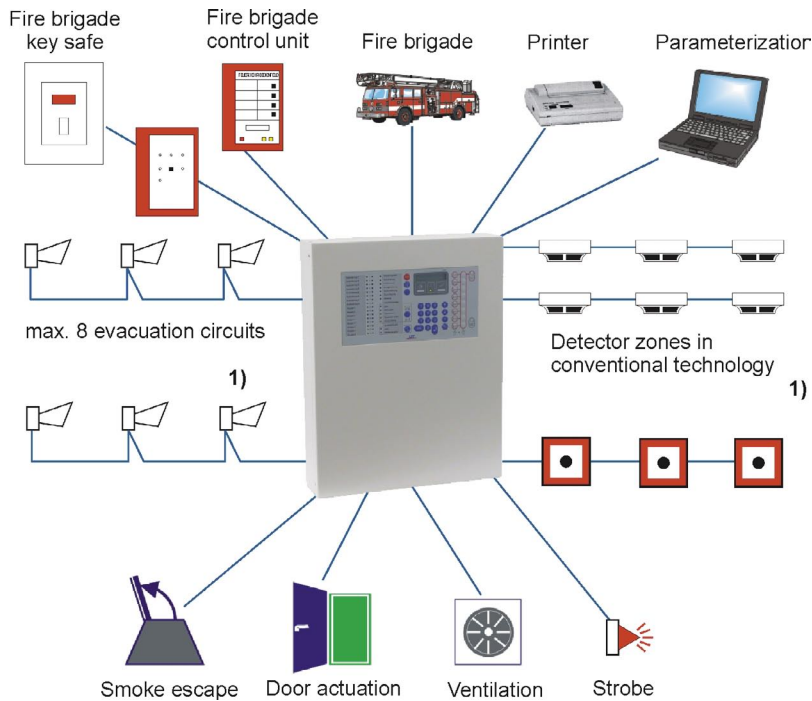

Specifications

Mains voltage	230VAC +10/-15%, 50Hz
Output/nominal voltage	typ. 28VDC
Output peak current	max. 1.8A
Own current consumption at 24V	typ. 70mA (without optional components)
Ambient temperature	-5°C to +50°C
Relative humidity	95% (no condensation)
Dimensions W x H x D	380 x 480 x 83 (mm)
Colour	gray-white, RAL 9002
Weight without accumulator	approx. 5kg
Approvals (EN 54-2, EN 54-4)	VdS G205023 FT 14/439/04 (Austria),
Part No.	210122
Order name	Fire and Evacuation Panel BC016-2/INT1

Building Safety. Building Security.

LST

Free Manuals Download Website

<http://myh66.com>

<http://usermanuals.us>

<http://www.somanuals.com>

<http://www.4manuals.cc>

<http://www.manual-lib.com>

<http://www.404manual.com>

<http://www.luxmanual.com>

<http://aubethermostatmanual.com>

Golf course search by state

<http://golfingnear.com>

Email search by domain

<http://emailbydomain.com>

Auto manuals search

<http://auto.somanuals.com>

TV manuals search

<http://tv.somanuals.com>