

Carrier Zone-MizerTM Modular Multizone Heating/Cooling Units

48MA/50ME

Electric Cooling 180,000 to 360,000 Btuh



Electric Heating 180,000 to 540,000 Btuh

Hot Water/Glycol Heating 160,000 to 800,000 Btuh

Gas Heating 480,000 to 720,000 Btuh



Carrier energy savings design
that solves a complex problem, too.

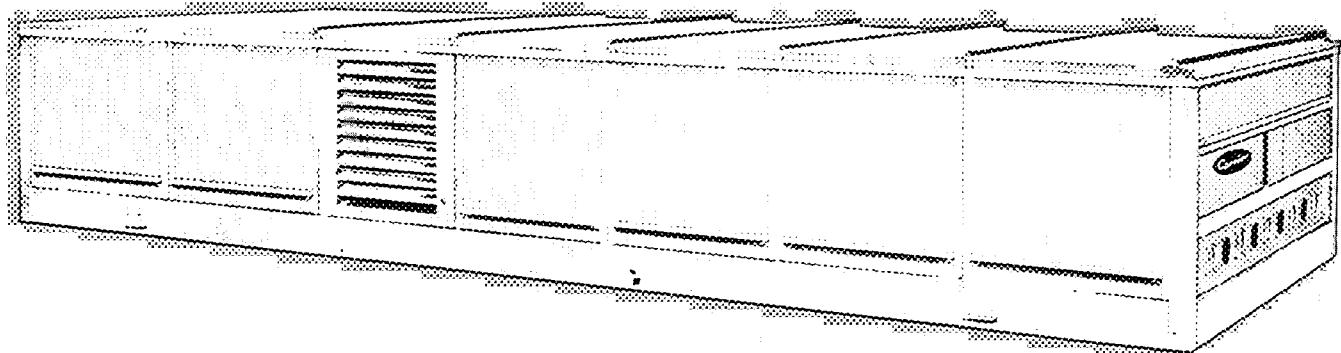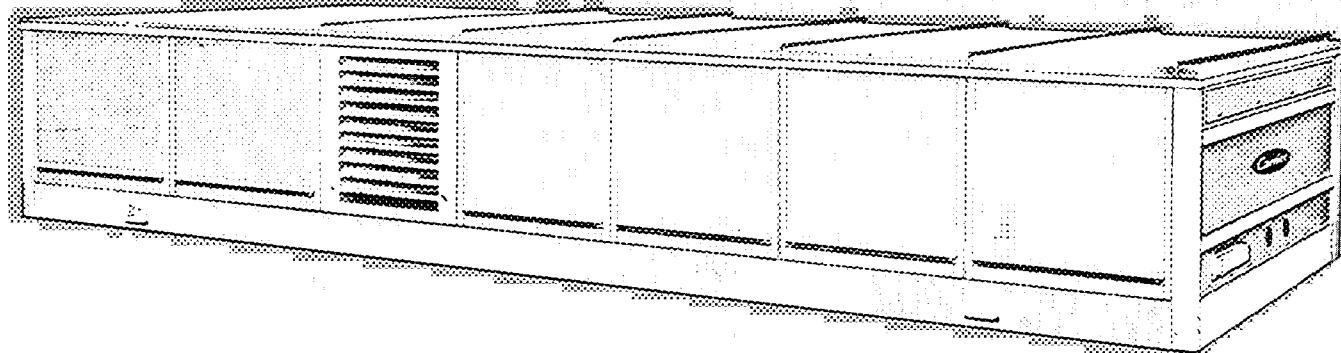

Rooftop installations for

- Schools
- Office buildings
- Commercial buildings



No hot decks. . .no cold decks. . . no zoning dampers. . .no energy waste!

It's what you **don't** get with Carrier's Zone-Mizer Modular Multizone unit that sets it apart from all the others.


You don't get hot decks or cold decks because the Carrier design gives each zone module its own cooling coil and heating section. Each zone module operates independently. One unit can heat, cool, dehumidify, reheat, and ventilate up to 12 different zones simultaneously. All this means real energy savings. . .there's no wasteful duplication of effort as in hot deck/cold deck units. For still more energy savings, Zone-Mizer provides up to 3 steps of electric heat or gas heat with an intermittent pilot ignition in every zone.

Something else you don't get. . .zoning dampers. Since the Carrier design doesn't have hot and cold decks, it doesn't need zoning dampers. By eliminating them from the picture, you eliminate the adjustments, service, and operating problems that go along with zoning dampers.

Five sizes, offering capacities to 37 tons, provide equipment flexibility and economy. One large unit may serve where 2 units were required before; or units of different sizes may be mix/matched to deliver the heating/cooling capacity required in a specific application. And the choice of gas, electric or hot water/glycol coils allows you to select a unit that can deliver maximum operating economy and convenience by taking advantage of an already available heating plant or favorable area fuel rates.


When specifying a multizone unit, choose the one that makes a point of doing something about installation problems. . .the Carrier Zone-Mizer Modular Multizone. It's a sturdy, one-piece unit — factory-wired, piped, and charged. It arrives ready to be set in place on the specially designed roof curb. Make the power and control connections and that's it. Initial adjustments are trouble free — you won't even need a factory engineer at start-up. The total package carries the UL label or is design certified by AGA.

Zone-Mizer™ Modular Multizone standard features

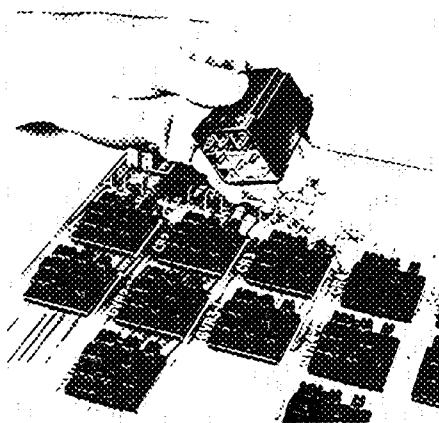


1 Etched solid copper circuit panels have interchangeable plug-in relays to minimize parts stocking. Circuit breakers that may be used as disconnect switches, terminal boards to simplify installation of accessories, a control circuit shutoff switch and 24-volt controls are all standard.

2 Motorized outdoor air inlet damper — A simple rheostat adjustment on the unit (or on the optional remote control panel) sets the damper to control the amount of outdoor air admitted.

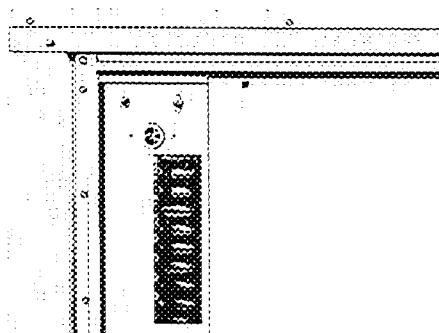

3 Fused 115-volt convenience outlet in the control box provides power at the unit for work lights and small power tools.

4 Motormaster® solid-state condenser fan speed control permits year-round operation of refrigeration system down to -20F ambient.

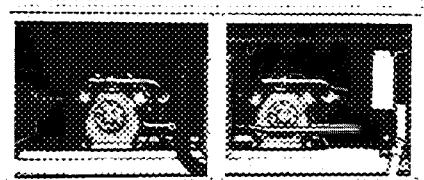

5 Dependable cooling — Each serviceable hermetic compressor system has cylinder unloaders for capacity control and electric power savings. Crank-case heaters, accumulators, filter driers and low-ambient starting controls are also standard.


Time Guard® electrical circuit prevents rapid cycling of the compressor if occupant tampers with the thermostat. Compressor cannot short-cycle on a safety device, such as the low-pressure switch, should someone forget to clean the air filters.

Capacity control permits a wide operating range. During light loads the compressor automatically unloads to reduce operating costs and maintain steady compressor operation. When the load drops below the minimum unloader stage, the hot gas bypass control provides continuous cooling operation.

Built-in safety controls prevent damage to unit components. Included are high- and low-pressure switches, overtemperature limit switches and overload protection for all motors.



6 Polyurethane foam sandwich access panels are of Weather Armor galvanneal steel. Their thermal resistance prevents sweating at outdoor conditions up to 77 F dew point. And they are strong enough to support a 250-pound man.

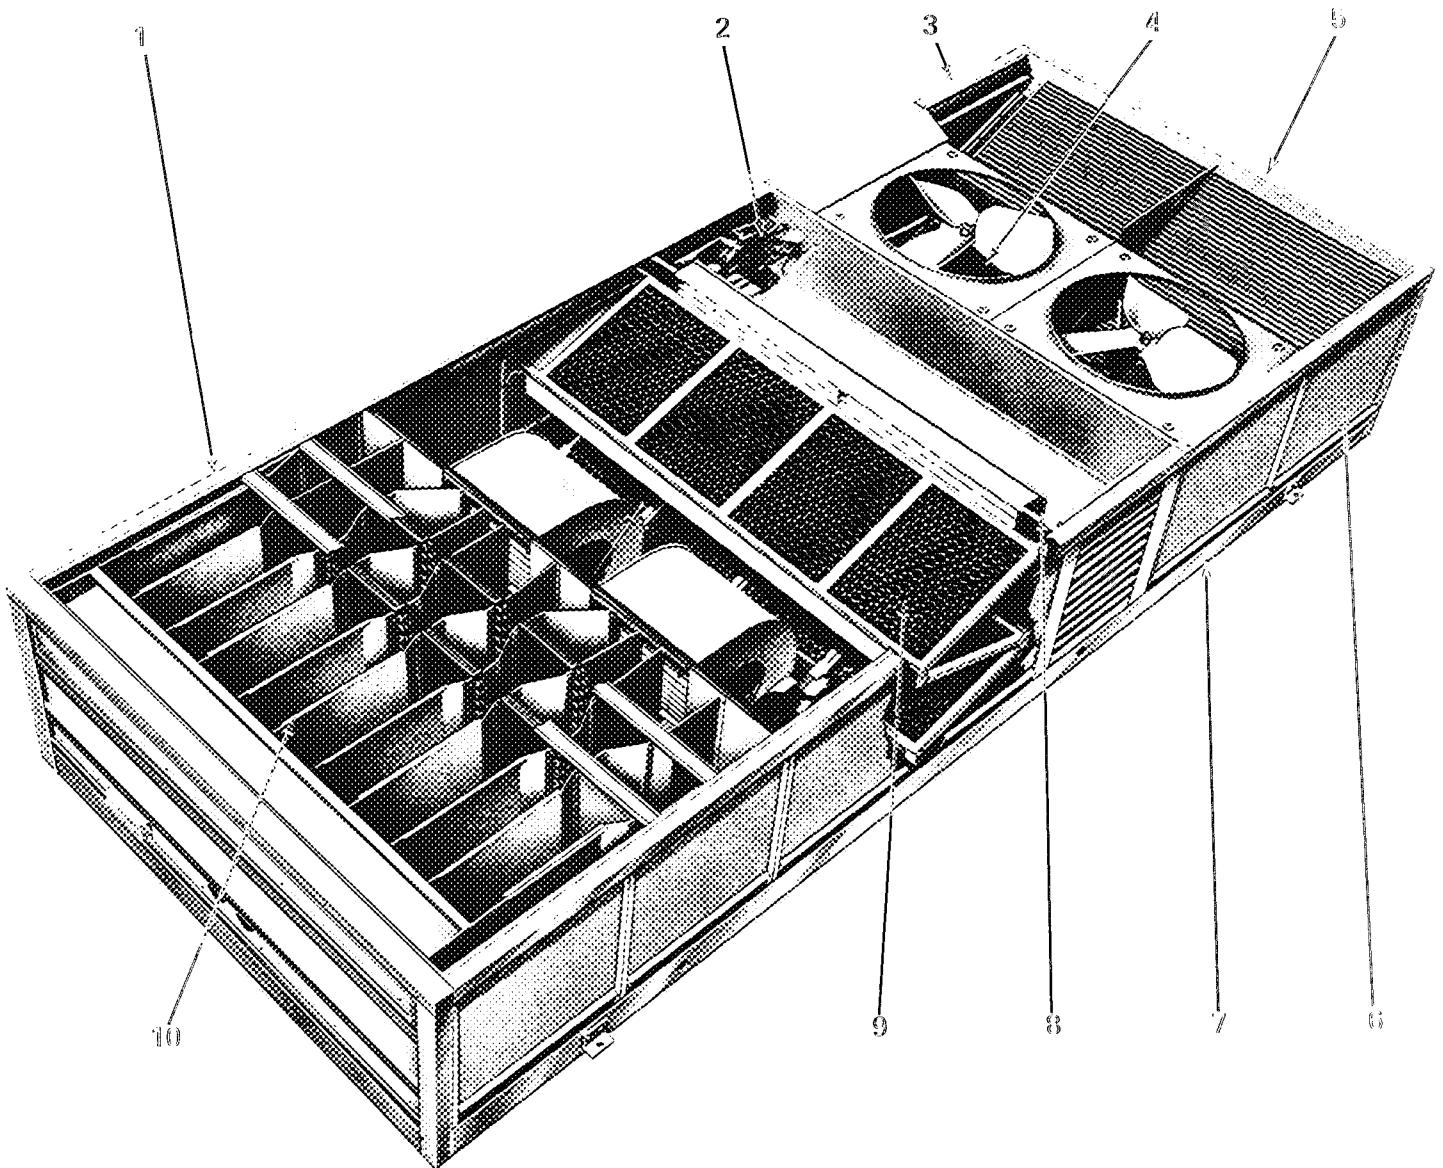

1 Rugged extruded aluminum frames and protective grilles provide strength and good looks. Unit will not sag during rigging.

2 Low silhouette — The cabinet has no vents or hoods to break up the clean appearance. The curb-mounted unit seldom requires a parapet to hide it from street level view.

3 Humidry® coil — This separate cooling coil dehumidifies the outdoor air before it is mixed with the return air to prevent high indoor relative humidities in humid weather and during partial load operation.

4 Large filter area — Over 41 square feet of standard filter area is factory supplied. Filter tracks will accept one-in. or 2-in., high- or low-velocity, permanent or throwaway, standard or high-efficiency filters.

10 Electric heater section (50ME)

— Each zone module has its own 2- or 3-stage electric heater assembly or hot water/glycol heating coil. Electric heaters have 24-volt relays and 115-volt contactors. Each heating element has circuit breakers and automatic thermal reset. Each leg has its own heat limiter (fusible link).

Each hot water/glycol heating coil has its own solenoid operated shutoff valve and balancing valve. All heating coils are prepped to supply and return manifolds which also include a bleed valve.

Gas heating (48MA) — Each zone module has stainless steel burners, → Porcelon™ heat exchangers and its own redundant gas valve. Natural gas units also have a regulator for each gas valve. Intermittent pilot ignition and forced draft combustion are standard on all units.

Zone-Mizer™ Modular Multizone concept. How it works. . .


Outdoor air entering the unit thru the side louvers is filtered and then cooled and dehumidified by the Humidry® cooling coil when mechanical cooling is operating. Return air entering the unit from below is mixed with this conditioned air. The mixture is then filtered. After passing thru the indoor air fans, the air is discharged into the individual zone modules. The air passing thru each zone module is either cooled or

heated in response to a signal from the thermostat controlling that module. This treated air then continues to the individual zone duct systems, thus providing a constant air pattern and volume on each cooling coil and heating assembly.


Each zone module cooling coil has its own solenoid valve to admit refrigerant when needed. When 2 or more mod-

ules are grouped for a larger zone requirement, 2-stage cooling can be provided. . .and controlled by one simple 24-volt mercury bulb thermostat

This condenser end view of unit (034 and 040) shows the 3 outdoor air fans and the side condenser air inlet grilles. The 2 end panels may be easily removed for control box and compressor accessibility.

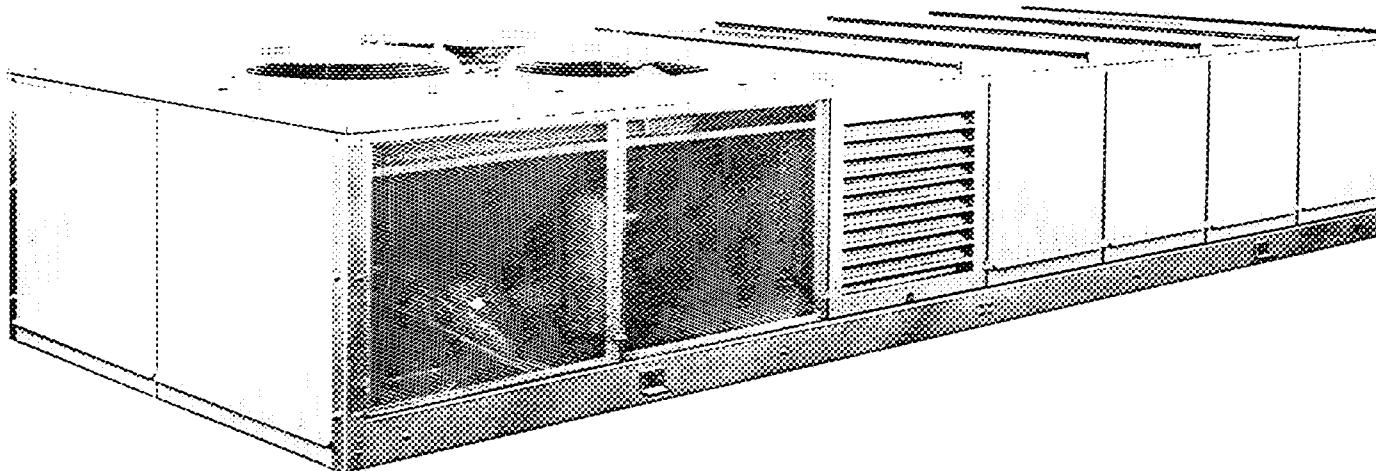

SPLITS AIRSTREAM INTO ZONES

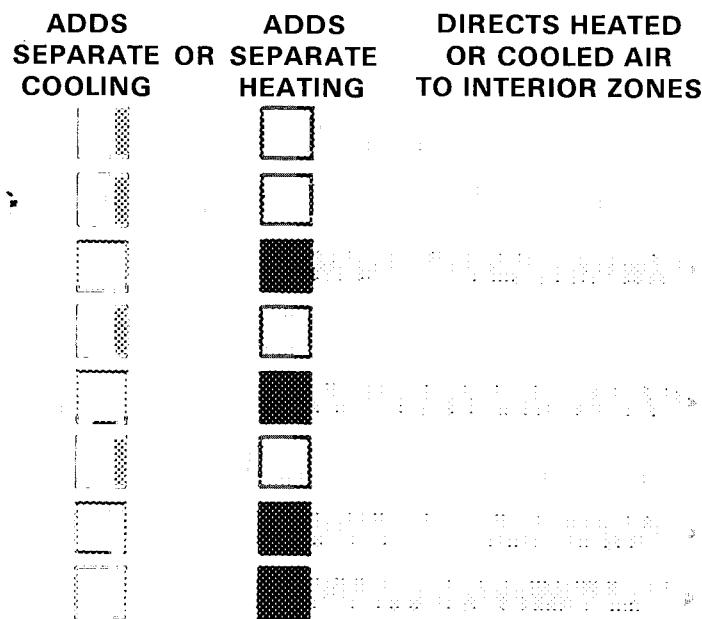

and why it's best.

Low operating costs

On partial load, the Carrier compressors unload cylinders to match compressor output to cooling needed with up to 6 steps of reduction. To maintain balanced operation, the hot gas bypass system diverts hot refrigerant to the outdoor air cooling coil as needed.

There is no mixing of warm and cold airstreams in the modular design. Just that amount of energy required to heat or cool a given zone is used — and no more.

Heating is available 3 ways. . . Electric heating, provided by 2- or 3-stage electric heaters in each module, gives up to 36 steps of capacity, again using the minimum amount of energy.

Hot water/glycol heat may be specified to utilize an already available heating plant.

Gas heating models utilize intermittent pilot ignition in each module designed to consume a minimum amount of energy.

Low-temperature operating capability. . . You can use the economizer cycle with outdoor air for "free cooling," as with competing units. However, with Carrier's head pressure controlled refrigeration system, you can often save money by using refrigeration to cool the space instead. So-called "free cooling" is expensive if a large quantity of cool outdoor air must be heated for the zones which do not require cooling. The Carrier refrigeration system can operate at outdoor temperatures down to -20F. The Carrier modular design, therefore, is not dependent on an economizer cycle for cooling at low outdoor temperatures.

Superior humidity control

One of the major concerns in multizone applications has been the control of humidity, especially in schools where moisture comes from large groups of people as well as from outdoor ventilation air. The basic Carrier design eliminates this problem. During mechanical cooling, all outdoor air that passes thru the Humidry® outdoor air cooling coil is dehumidified whenever any zones require cooling. The air is then further dehumidified when it passes thru the zone module cooling coil.

If further dehumidification should be required for any or all zones, reheat can be added easily. A humidistat, installed in the conditioned space to override the thermostat, energizes the cooling coil for that zone.

Ease of service

The Zone-Mizer™ Modular Multizone uses simple, familiar, commercial, thermostatic controls for each module, eliminating the need for factory experts and complex start-up and service procedures. The printed control circuit board has clearly marked terminals for easy connection of standard 2-stage heating and one- or 2-stage cooling thermostats, which are located in each zone.

Identical relays plug into the circuit board. Modules can be easily combined to serve larger spaces by placing factory-supplied jumper wires on the premarked terminals.

The entire control system is neatly organized in one location. For excellent accessibility, all circuit breakers project outside so that any motor can be disconnected without opening the high-voltage box. This often eliminates the need for separate field-supplied disconnects.

The handsome Carrier mercury bulb type thermostats control heating and cooling modes. They are available with a locking device which requires an Allen wrench for access, or you can allow the zone occupant to set his own temperature.

Access to the Zone-Mizer Modular Multizone is thru removable side panels held in place with simple fasteners. Top panels may also be removed for complete access to unit interior.

In short, the local installing dealer or contractor can handle all service and will have available, from the nearest Carrier distributor, any parts required.

Accessories and factory-installed options

Hot water/glycol heating (50ME) —

Often, such as when renovating existing buildings, a heating plant is available. For these applications, Carrier's hot water/glycol heating unit may be ideally suited. Each zone module has its own high-capacity heating coil. All controls, solenoid operated shutoff valves and balancing valves are included. No internal piping or wiring required.


Heaters are designed for and intended to be operated with a glycol/water solution of 20% minimum glycol concentration for freeze-up protection. (Factory-Installed Option).

Roof curb supports unit and frames roof openings to provide a strong, watertight interface between unit and roof. Galvanized, 14-gage steel, 2-piece construction minimizes installation time and costs. (Accessory)

Modulating outdoor air control provides year-round ventilation with outdoor air. An outdoor air thermostat locks out compressors to permit "free cooling" with outdoor air. (Factory-Installed Option)

Roll filter package includes 65 ft of 2-in. thick filter media, automatic media advance switch and a motor. The run-out switch turns on the filter light in the remote control center to show when the media needs replacing. (Factory-Installed Option)

Powered exhaust damper has controls to operate outdoor air fans to

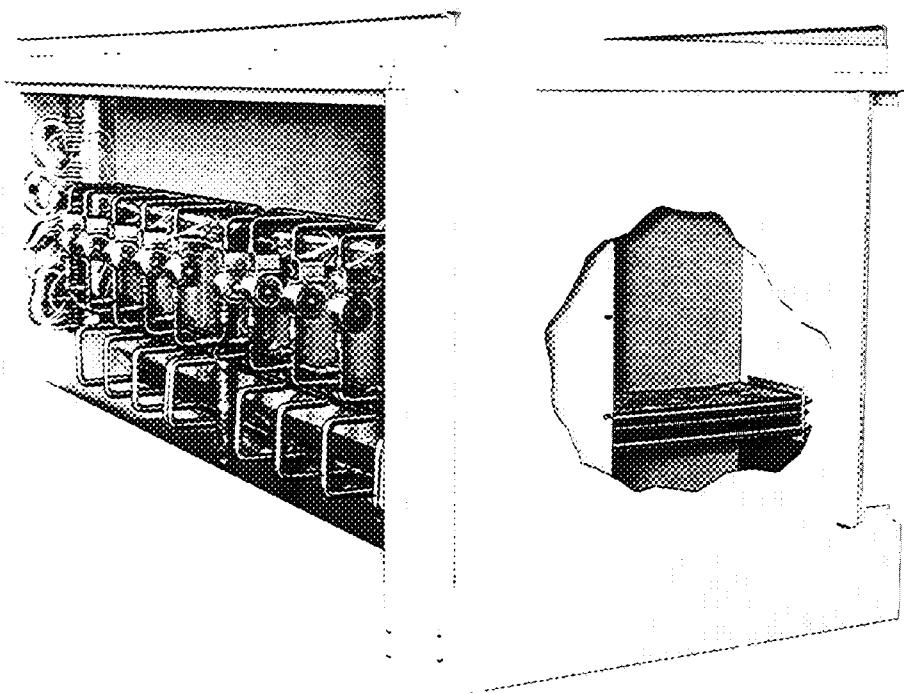


exhaust return air when unit is in "free cooling" mode. (Factory-Installed Option)


Cooling only unit (50ME) — Unit is available with all heating controls but without heater assemblies. Included are 24-volt control circuits and 115-volt power terminals for 2-stage control of steam heating coils field installed in the unit or in the zone ductwork.

Electric heat (50ME) — Each zone module is equipped with its own independent heater assembly. Two- and 3-stage heat is available to provide close air temperature control without wide temperature swings associated with rapid-cycle, full-on, full-off systems.

Three heat-to-cool ratios are available: .75:1, 1:1 and 1.5:1 to match almost any heating load requirement. (Factory-Installed Option)

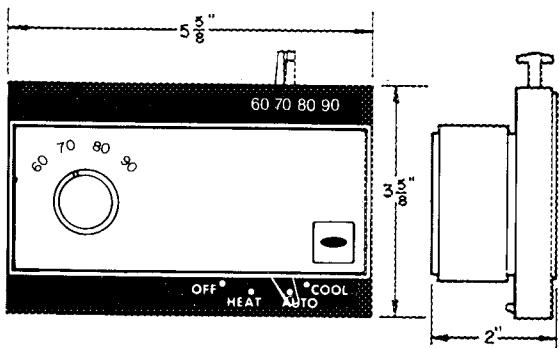

Zone thermostat (24 volts) provides 2-stage heating and one- or 2-stage cooling for control of individual modules. Matching subbases are available with or without tamperproof switches and automatic changeover. (Accessory)

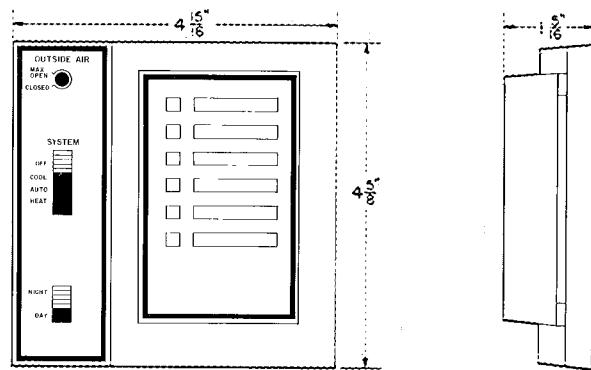


Remote control panel (24 volts) — This decorative central control for the entire unit has switches for HEAT, COOL, AUTOMATIC CHANGEOVER, OFF and DAY/NIGHT settings; dial to adjust outdoor air damper to rapidly ventilate conditioned spaces. A dirty filter warning light and knockouts for additional warning lights are also provided. (Accessory)

Physical data

UNIT 48MA/50ME	016	024	028	030	034	040
Zone Modules	8	8	10	10	12	12
Nominal Cooling Capacity (tons)	15	20	25	28	30	37
OPERATING WEIGHT (lb)						
Base Unit 48MA	3385	3805	4075	4080	4800	5700
Base Unit 50ME (with heat)	2985	3405	3665	3670	4400	5250
Roof Curb	506	506	506	506	630	630
REFRIG CHARGE (lb, R-22)	28	32	43	43	57	66 1
COMPRESSOR			Reciprocating Hermetic, 1725 Rpm			
No. 1 Type	06DE537	06DE824	06DE537	06DE537	06DE537	06EE250
Cylinders. Unloaders	6 2	6 .2	6 ..2	6 .2	6 .2	4 .1
No. 2 Type	—	06DA824	06DA824	06DA537	06DA537	06EA250
Cylinders (has no unloaders)	—	6	6	6	6	4
System Oil Charge (pts)	11	22	22	22	21	31
Unloader Settings (psig)			Compressor No 1 Only			
Left Bank	Loads		71 0 ± 1 5			—
	Unloads		57 5 ± 2 5			75 5 ± 1 5
Right Bank	Loads		76 0 ± 1 5			58 0 ± 2 5
	Unloads		62 5 ± 2 5			
Capacity Steps (%)	100,67,33	100,83,67 50,33,17	100,80,60 40,20	100,80,60 40,20	100,83,67 50,33,17	100,75, 50,25
OUTDOOR AIR FANS			Propeller, Direct Drive			
Motor Hp .Rpm...Frame (NEMA)						
No 1			1 1075	56 (1-phase)		
No 2			1 1140	56 (3-phase)		
No 3					1 1140	56 (3-phase)
Nominal Cfm	16,500	15,000	15,000	15,000	24,000	23,000
INDOOR AIR FANS			Centrifugal; Belt Drive			
No. ...Size (in.)	2 15 x 15	2 15 x 15	2 15 x 15	2 15 x 15	3 .15 x 9	3 .15 x 9
Cfm (Nom)	6000	8000	10,000	10,000	12,000	12,000
Motor Hp .Rpm	5 1725	7-1/2 1725	10 1725	10 1725	15 1725	15 1725
Fan Pulley					20 1725	20 1725
Outside Diameter (in)	10 6	10 6	8 0	8 0	8.0	8 0
Bore (in.)	1-3/16	1-3/16	1-3/16	1-3/16	1-11/16	1-11/16
Fan Belt No ..Size	1 3V630	1 3V630	2 3V560	2 3V560	2 3V630	2 3V630
w/Std Mtr					3 3V670	3 3V670
w/Opt Mtr						
Motor Pulley A			Factory Installed			
Outside Diam (in.)	5 3	6 0	5 0	5 0	5 0	5 0
w/Std Mtr					6 0	6 0
w/Opt Mtr						
Bore (in.)	1-1/8	1-3/8	1-3/8	1-3/8	1-5/8	1-5/8
Resulting Fan Rpm	880	995	1095	1095	1095	1095
w/Std Mtr					1320	1320
w/Opt Mtr						
Motor Pulley B			Shipped With Unit			
Outside Diam (in.)	6 0	6 9	5 6	5 6	5 6	5 6
w/Std Mtr					6 5	6 5
w/Opt Mtr					1230	1230
Resulting Fan Rpm	995	1145	1230	1230	1425	1425
OUTDOOR AIR COOLING COIL			Thermostatic Expansion Valve, Hot Gas Bypass			
Face Area (sq ft)	6 8	6 8	6 8	6 8	10 2	10 2
Corrugated Fins/in ...Rows	13 2	13 2	13 2	13 2	13 2	13 3
EVAPORATOR COILS (zone)			Solenoid Valve and Capillary Tube for each			
No ...Face Area (sq ft, ea)	8 .2 12	8 .2 12	10 .2 12	10 .2 12	12 .2 01	12 .2 01
Corrugated Fins/in ...Rows	13 3	13 3	13 3	13 3	12 3	15 3
HEATING SECTION (48MA)			Furnace Assembly in Each Zone Module			
Rise Range			25 F to 55 F at 0 75 in wg ESP			
Input (1000 Btuh)	Total	432	540	540	648	648
	Each Module	54	54	54	54	54
→ Bonnet Cap (1000 Btuh)	Total	324	405	405	486	486
	Full Rate	40 5	40 5	40 5	40 5	40 5
HEATING SECTION (50ME Electric)			2- or 3-Stage, Nichrome, Open-Wire Resistance Elements in Each Zone Module			
Electric Heaters	8 2 or 3	8 2 or 3	10 2 or 3	10 2 or 3	12 2 or 3	12 2 or 3
No ..Elements (ea)						
HEATING SECTION (50ME Glycol)			One Heating Coil in Each Zone Module			
Max Allowable Inlet Temp			200F			
Max Allowable Flow, Each Coil			6 Gpm			
Solution Mixture			20% Glycol			
Max Allowable Working Pressure			30 Psig			
Total Internal Volume (gallons)	2 61	2 61	3 15	3 15	3 76	3 76
PRESSURE SWITCHES						
Low-Pressure Cutout			29 ± 5 Psig			
Cut-in			39 ± 5 Psig			
High-Pressure Cutout			400 ± 5 Psig			
Cut-in			300 ± 5 Psig			
Indoor Airflow Switch (AFS 1)						
Factory Setting (cfm)			6000			
Adjustment Range (cfm)			4000-600			
INDOOR AIR FILTERS					9000	9000-9000
Std No ..Size (in)						
High Efficiency (optional)						
No . Size (in)						
Roll Media (optional)						
OUTDOOR AIR FILTERS			12 20 x 25 x 2			
No . Size (in)			Same but with 36 5% efficiency (NBS Dust Spot Test)			
			65 ft of 2-in media			
			2 20 x 25 x 1			
					2 32 x 35 x 1	


Roof curb dimensions (48MA)

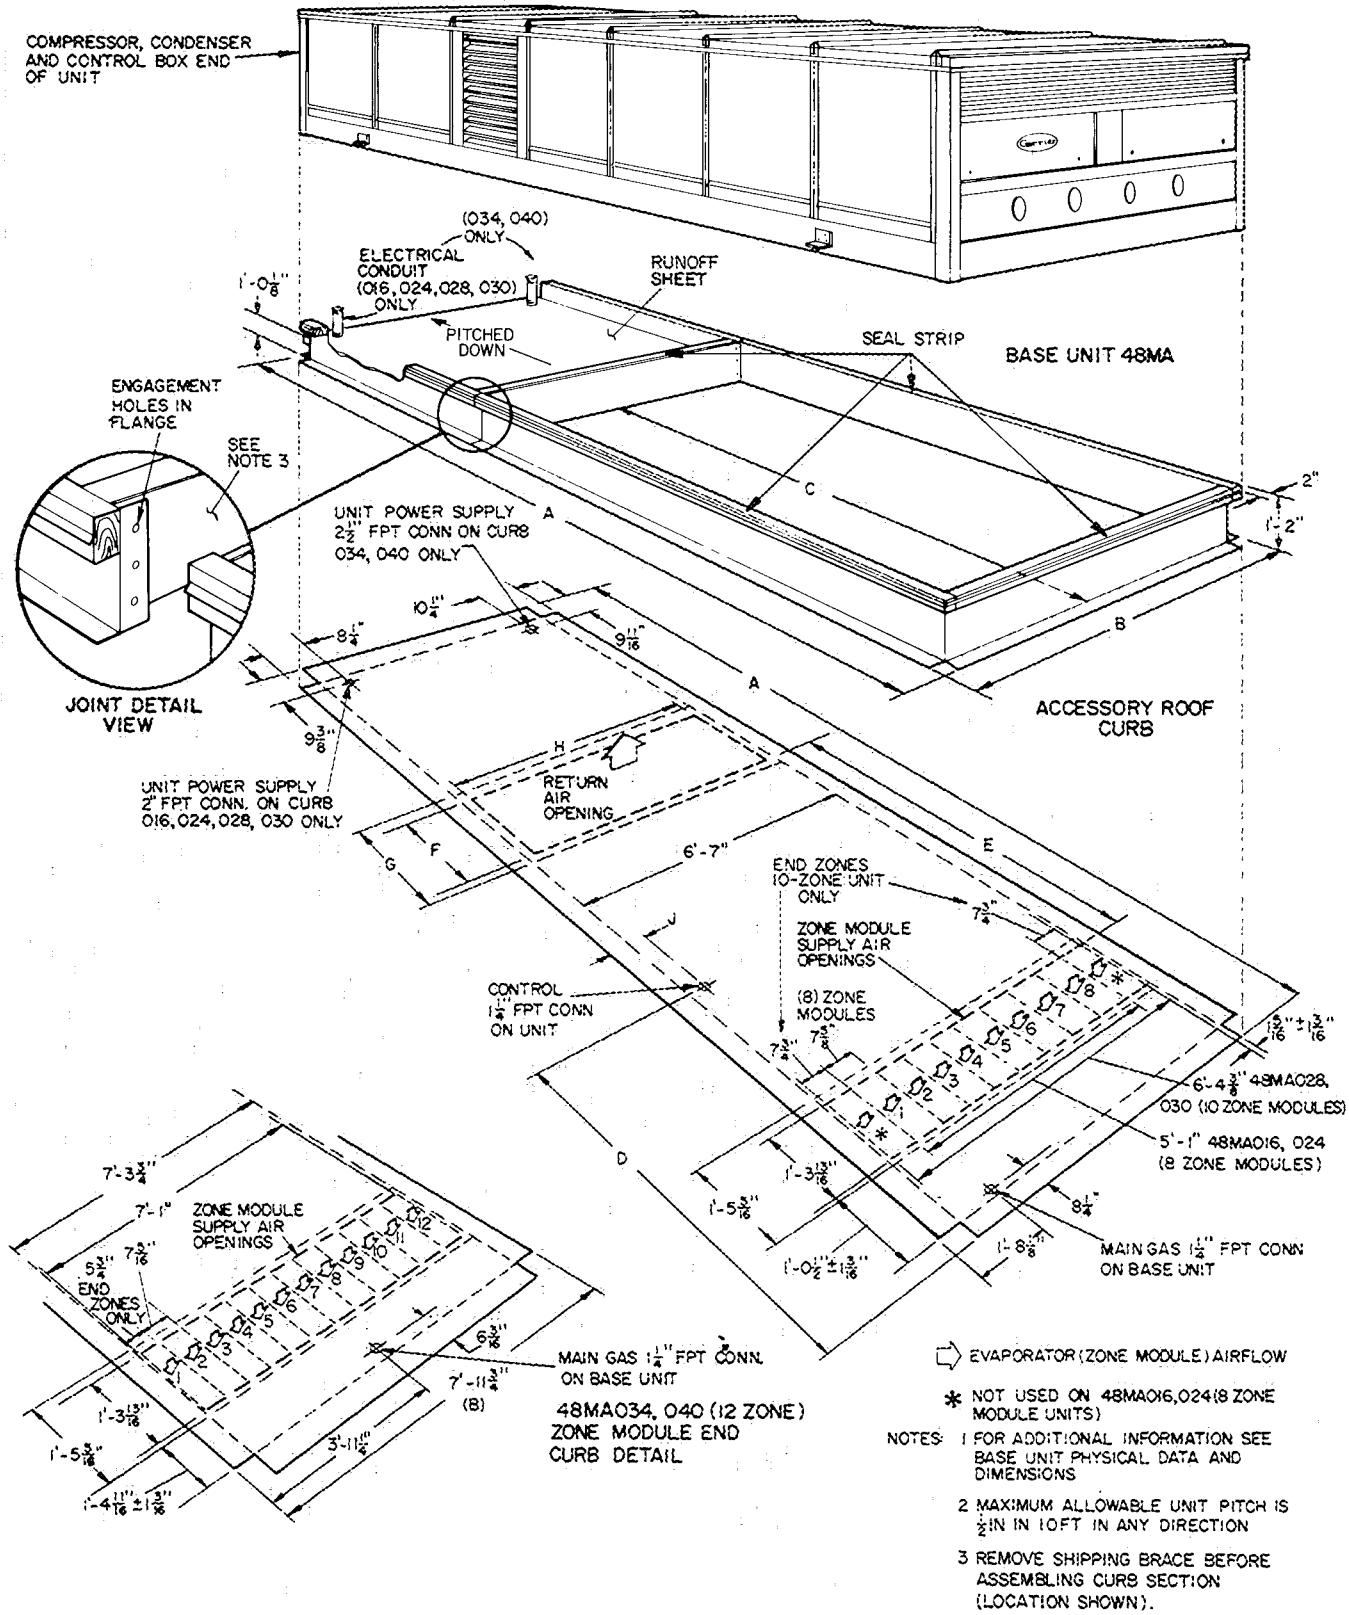

Certified dimension drawings available on request.


UNIT 48MA	DIMENSIONS (ft-in.)								
	A	B	C	D	E	F	G	H	J
016, 024, 028, 030	18- 2 1/2	7- 3	11-9	5-6 1/4	7-2 1/2	1-10 1/16	2-2 3/16	6-0 1/2	0- 7 1/2
034, 040	21-11 1/8	7-11 1/4	14-1 1/4	6-7 1/16	8-4 3/16	2- 9 1/8	3-1	6-8 1/2	0-10 1/4

Base unit dimensions (48MA)

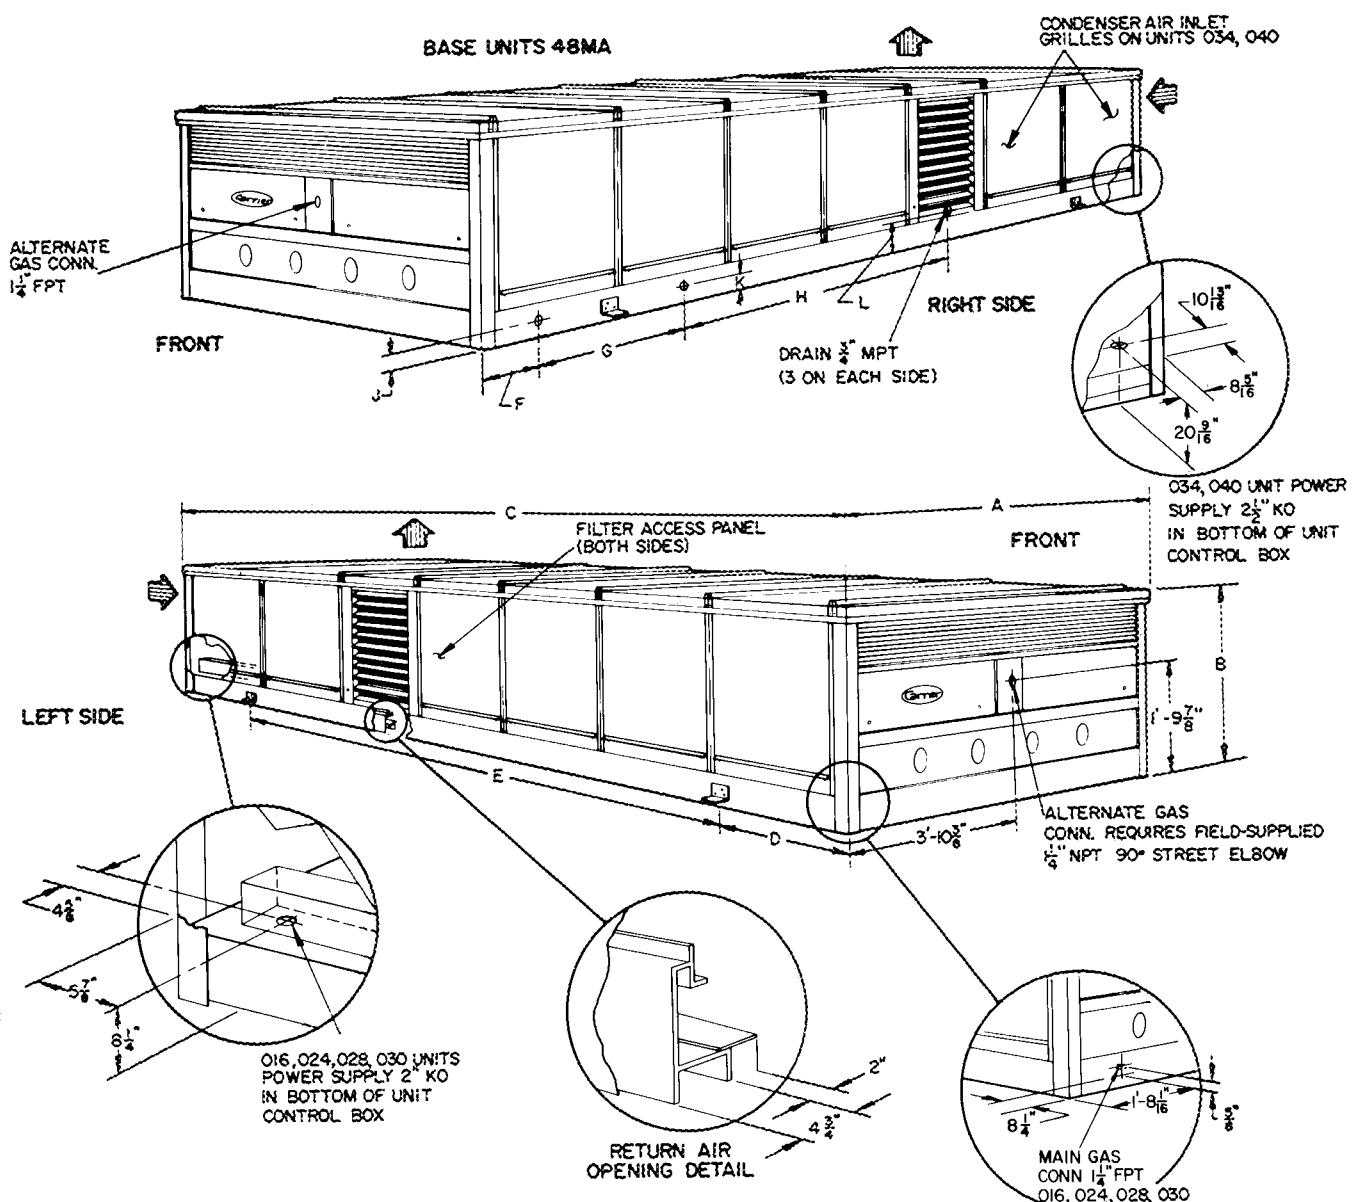

CONDENSER AIRFLOW

- NOTES:
1. SPACE REQUIRED FOR SERVICE AND AIR FLOW ALL AROUND AND ABOVE UNIT IS 36 IN.
 2. FOR ADDITIONAL INFORMATION SEE ACCESSORY ROOF CURB DIMENSION.
 3. CENTER OF GRAVITY IS WITHIN 6 IN. RADIUS OF GEOMETRIC CENTER OF UNIT
 4. MAXIMUM ALLOWABLE PITCH OF UNIT IS $\frac{1}{2}$ IN. IN 10 FT IN ANY DIRECTION.

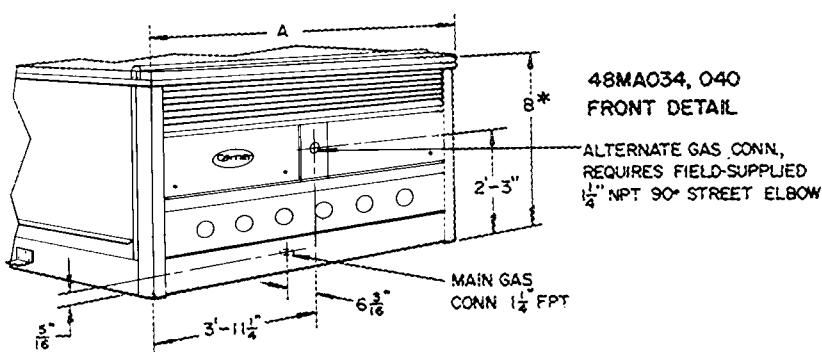


Certified dimension drawings available on request.

UNIT 48MA	DIMENSIONS (ft.-in.)										
	A	B	C	D	E	F	G	H	J	K	L
016, 024, 028, 030	7- 2 $\frac{3}{4}$	3-0%	17-11 $\frac{1}{16}$	2-2 $\frac{1}{16}$	13-5 $\frac{1}{2}$	0- 9 $\frac{1}{16}$	2-10	7-3 $\frac{3}{16}$	0-3 $\frac{1}{2}$	0-3 $\frac{1}{2}$	0-3 $\frac{1}{2}$
034, 040	7-11	3-9 $\frac{1}{16}$ *	21- 9 $\frac{1}{16}$	4-2 $\frac{1}{8}$	13-5 $\frac{1}{2}$	0-11 $\frac{1}{16}$	3- 4 $\frac{1}{16}$	8-6 $\frac{3}{4}$	0-3 $\frac{1}{32}$	0-2 $\frac{1}{16}$	0-7 $\frac{1}{2}$

*Overall height; includes 1 3/4-in. for fan guards (48MA034 and 040)

Base unit dimensions (50ME)

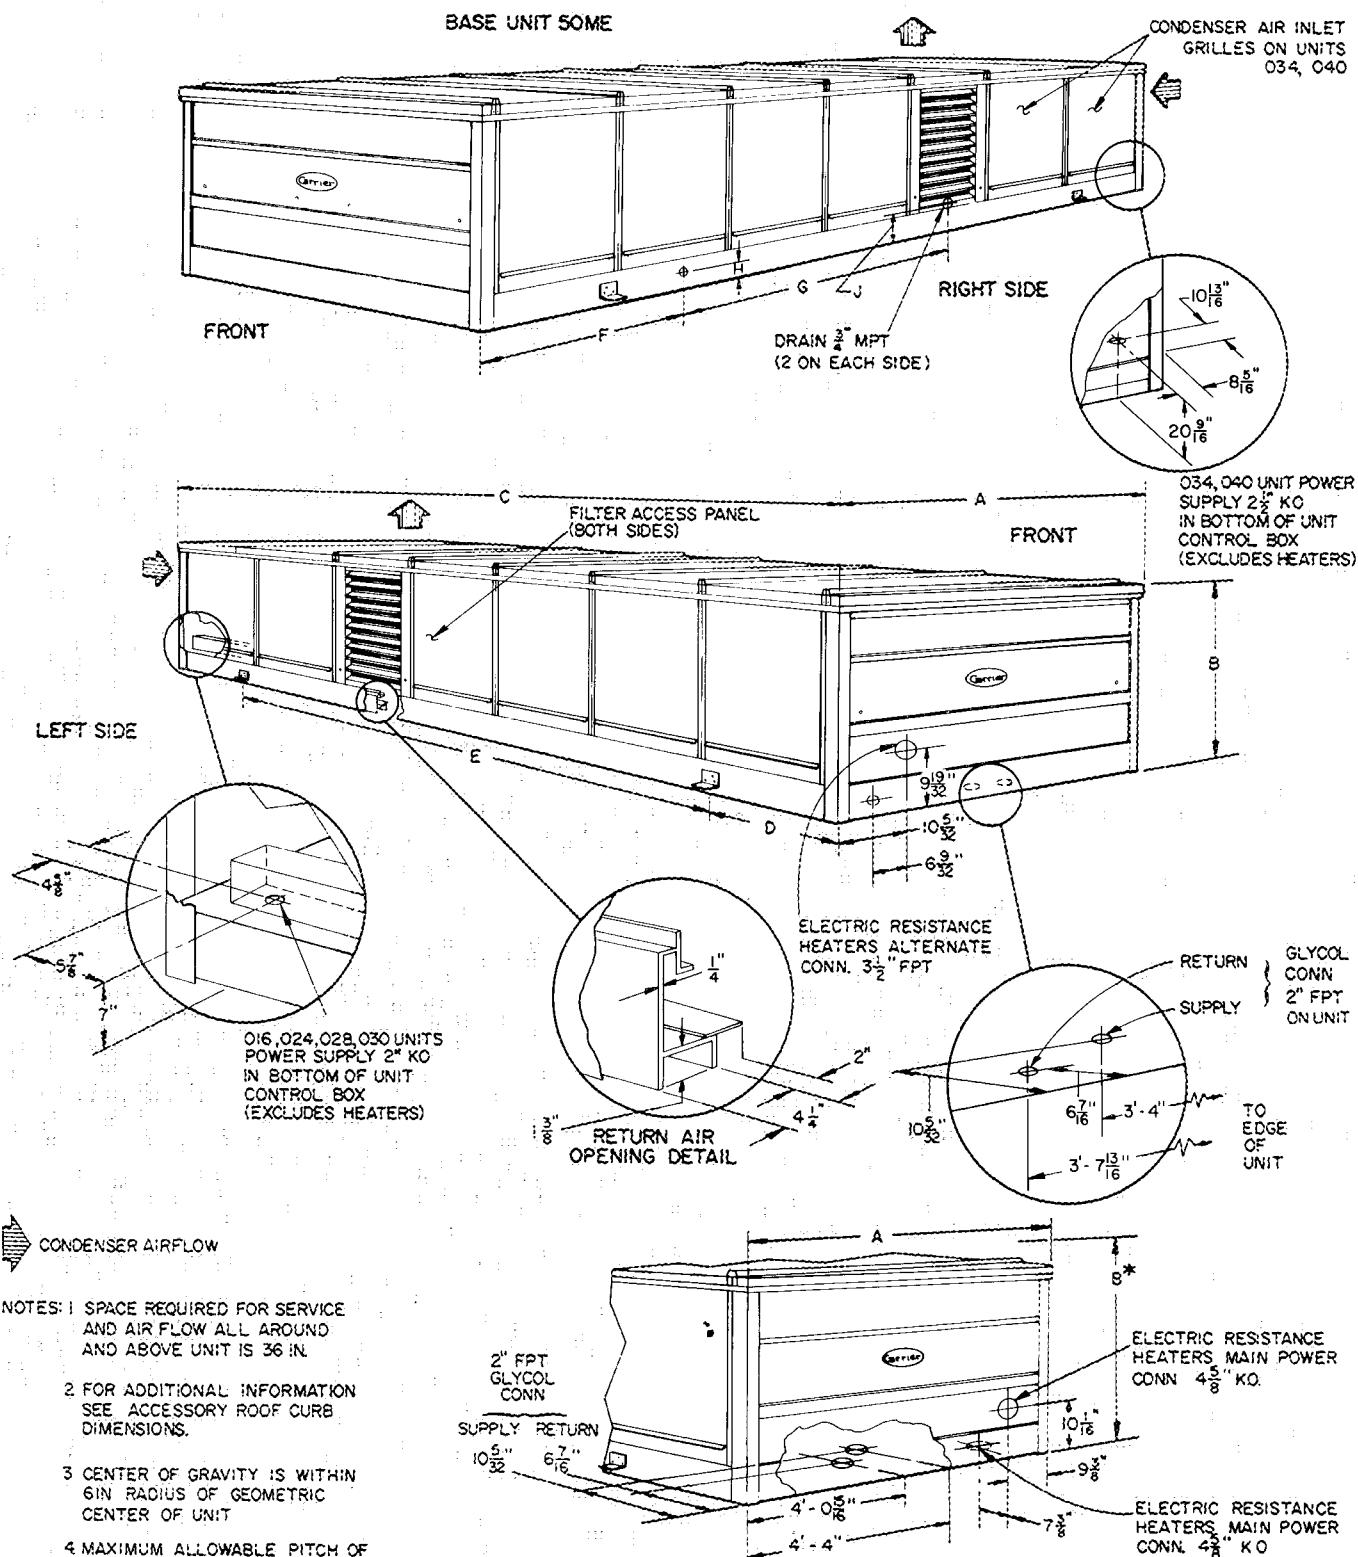


Certified dimension drawings available on request.

UNIT 50ME	DIMENSIONS (ft-in.)								
	A	B	C	D	E	F	G	H	J
016,024,028,030	7- 2 $\frac{3}{4}$	3-0 $\frac{1}{16}$	17-11 $\frac{1}{16}$	2-2 $\frac{1}{16}$	13-5 $\frac{1}{2}$	3-7 $\frac{1}{16}$	7-3 $\frac{3}{16}$	0-3 $\frac{1}{16}$	0-3 $\frac{1}{16}$
034,040	7-11	3-9 $\frac{1}{16}$ *	21- 9 $\frac{1}{16}$	4-2 $\frac{1}{8}$	13-5 $\frac{1}{2}$	4-4	8-6 $\frac{3}{4}$	0-2 $\frac{1}{16}$	0-7 $\frac{1}{4}$

*Overall height, includes 1 3/4 in. for fan guards (50ME034 and 040).

Roof curb dimensions (50ME)

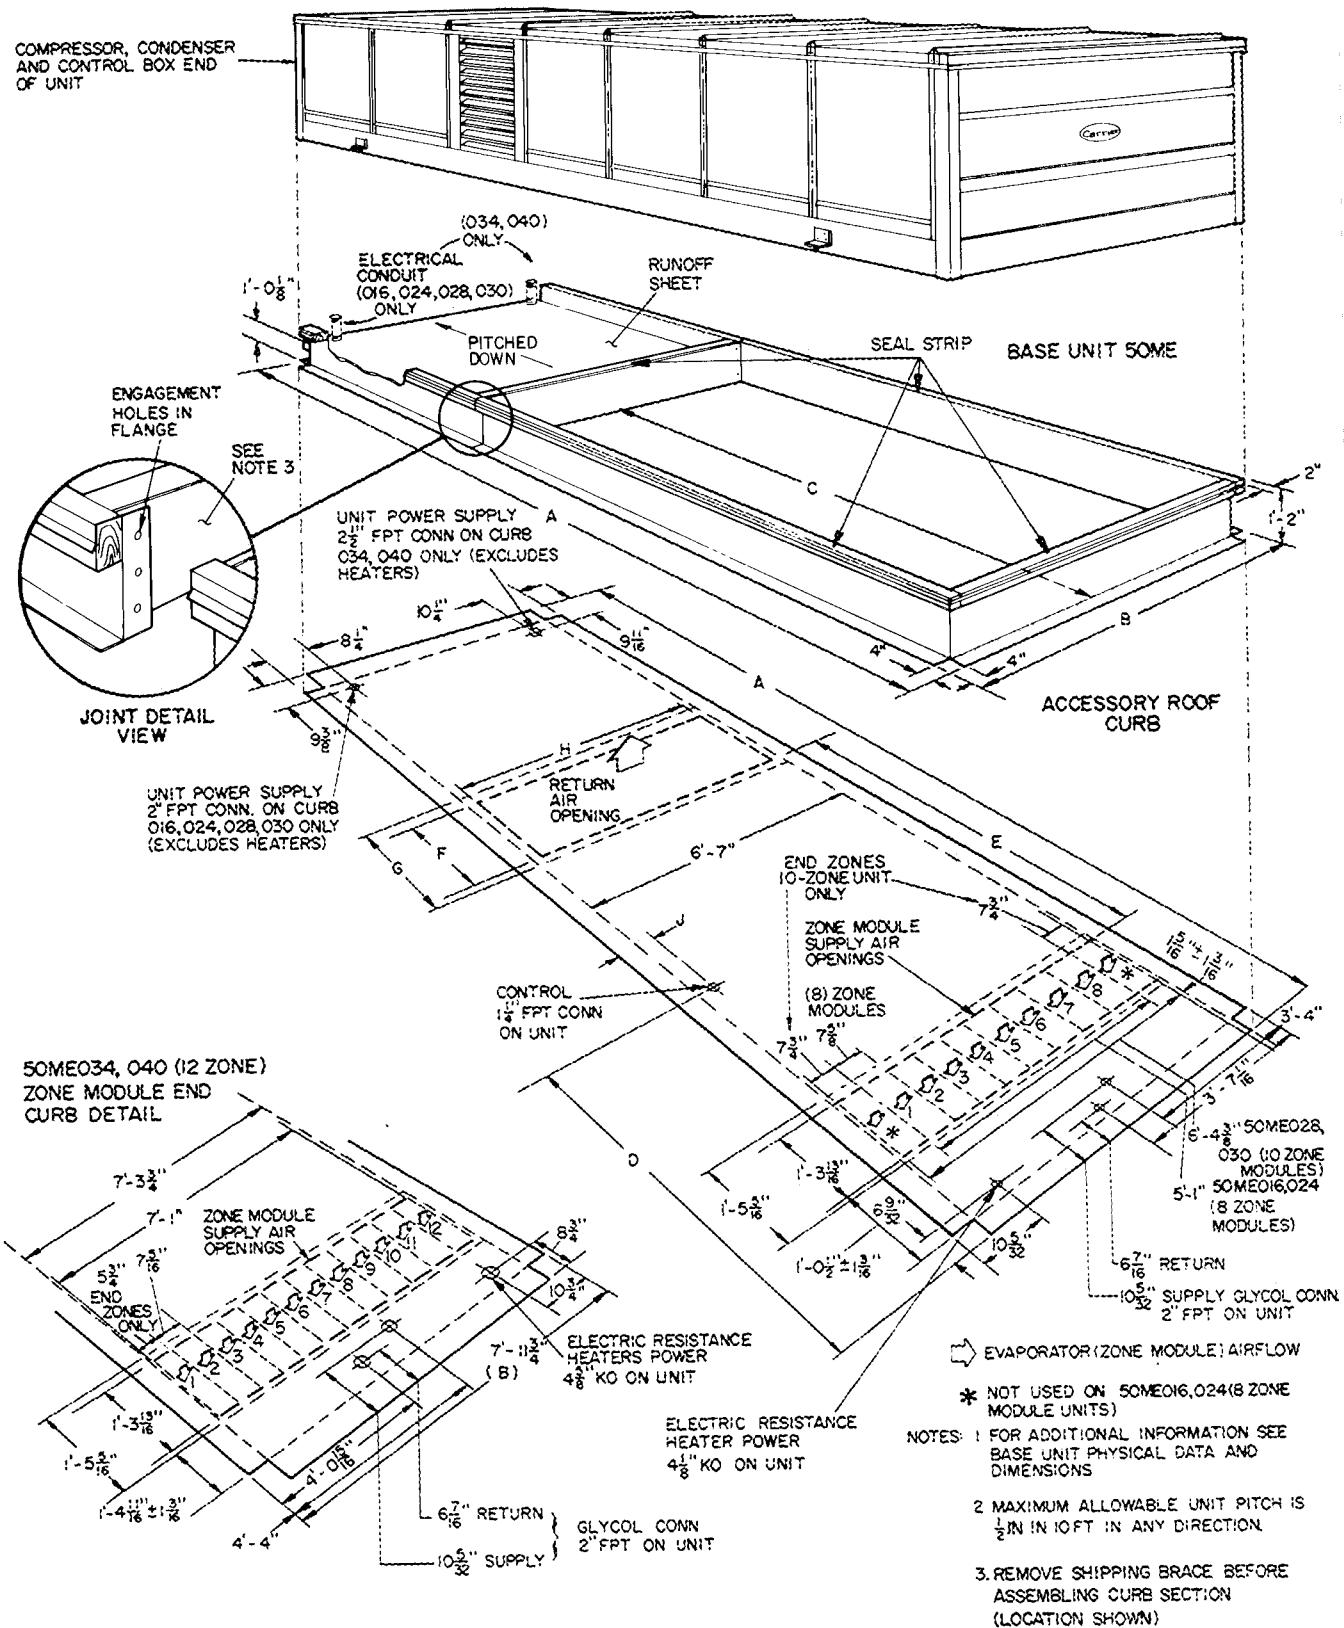

Certified dimension drawings available on request

UNIT 48MA	DIMENSIONS (ft-in.)								
	A	B	C	D	E	F	G	H	J
016, 024, 028, 030	18- 2 1/8	7- 3	11-9	5-6 1/4	7-2 1/8	1-10 1/8	2-2 1/16	6-0 3/8	0- 7 1/8
034, 040	21-11 1/8	7-11 1/4	14-1 1/4	6-7 1/16	8-4 1/16	2- 9 1/8	3-1	6-8 1/2	0-10 1/8

Selection procedure (with example)

Refer to Carrier's Engineering Guide for Multizone Unit Systems and contents of this booklet for typical multizone design considerations. Using the Engineering Guide, calculate cooling and heating load estimates for the areas to be served by the multizone unit. Divide each area into zones based on the peak load and control requirements within the area.

The resulting loads calculated for a typical building are:

Cooling

Grand Total Load (GTL) 272,440 Btuh
 Sensible Load (SL) 219,000 Btuh
 Room Design 75 F db/50% Rh
 Outdoor Air (OA) Cfm 1000
 OA Ambient Temperature 95 F db/75 F wb
 Electric Power Source 460/3/60

Zone No.	Room Total Load* (RTL)/Zone	Room Sensible Load (RSL)/Zone
1	19,000 Btuh	16,935 Btuh
2	25,000 Btuh	22,505 Btuh
3	25,000 Btuh	22,505 Btuh
4	70,000 Btuh	59,160 Btuh
5	22,000 Btuh	19,720 Btuh
6	25,000 Btuh	22,505 Btuh
7	40,000 Btuh	33,870 Btuh
Total	226,000 Btuh	197,200 Btuh

*Loads are peak loads

Heating (Electric Resistance Heat required)

Zone No.	Heating Load/Zone	Electric Resistance/Zone
1	34,000 Btuh	10.0 kw
2	44,000 Btuh	12.9 kw
3	44,000 Btuh	12.9 kw
4	111,000 Btuh	32.5 kw
5	42,000 Btuh	12.3 kw
6	44,000 Btuh	12.9 kw
7	81,000 Btuh	23.7 kw
Total*	400,000 Btuh	117.2 kw

*Zone Peak Capacities

Selection:

Base the multizone unit selection on cooling load requirements. Enter the 48MA/50ME rating tables in the Performance Data Section and select the unit that meets or exceeds the grand total load at the specified conditions. (Interpolation may be necessary to obtain unit rating at certain conditions; extrapolations are not advised. Contact Carrier Application Engineering for performance data at points beyond the range of published tables.) The 024 size unit does not have sufficient capacity to meet load requirements at any cfm. The 028 size exceeds load requirements; however, it is the smallest unit that meets specifications. Thus, the 48MA/50ME028 at: 9000 cfm; 1000 cfm OA; 95 F/75 OA temperature; and 75 F/50% Rh room design has a Total Capacity (TC) of 282,000 Btuh, Sensible Heat Capacity (SHC) of 219,000 Btuh and a compressor kw of 27.5. Calculate the Room Total Capacity (RTC) and the Room Sensible Heat Capacity (RSHC) by deducting the outdoor air load from the unit capacity. The outdoor air load with respect to room conditions is:

$$\begin{aligned} \text{Total Heat (OATH)} &= 4.5(h_{oa} - h_{room}) (\text{OA cfm}) \\ &= 4.5(38.61 - 28.29) (1000) \\ &= 46,440 \text{ Btuh} \end{aligned}$$

$$\begin{aligned} \text{Sensible Heat (OASH)} &= 1.09(t_{oa} - t_{room}) (\text{OA cfm}) \\ &= 1.09(95 - 75) (1000) \\ &= 21,800 \text{ Btuh} \end{aligned}$$

The unit capacity available to offset room loads is:

$$\begin{aligned} \text{Room TC} &= \text{Unit TC} - \text{Outdoor Air TC} \\ &= 282,000 - 46,440 \\ &= 235,560 \text{ Btuh} \end{aligned}$$

$$\begin{aligned} \text{Room SHC} &= \text{Unit SHC} - \text{Outdoor Air Sensible Heat} \\ &= 219,000 - 21,800 \\ &= 197,200 \text{ Btuh} \end{aligned}$$

For comparison.

Actual Load	Actual Unit Capacity
GTL = 272,440 Btuh	TC = 282,000 Btuh
SL = 219,000 Btuh	SHC = 219,000 Btuh
RTL = 226,000 Btuh	RTC = 235,560 Btuh
RSL = 197,200 Btuh	RSHC = 197,200 Btuh

The 48MA/50ME size meets or exceeds the total and zone load requirements at the specified conditions. The excess RTC decreases space average relative humidity slightly below the room design of 50%. By increasing air quantity above 9000 cfm, this excess latent capacity can be converted to additional sensible capacity if desired.

Since the modular multizone is a constant volume machine, proportion the selected supply cfm per zone to satisfy each zone's peak load condition.

Divide room sensible capacities (RSC) equally among the modules if an equal cfm is going to each. In this example, the 48MA/50ME028 has 10 modules and the nominal cfm is 900 cfm per module and equal cfm's are not going to each.

Vary the cfm to each zone (with field-supplied manual dampers in zone ducts) to match different zone requirements. Since the original rating was based on 9000 cfm supply air, all variations must total 9000 cfm. When the cfm is changed (by some percent) from the nominal in a specific module, use the room capacity multipliers in the Zone Cooling Capacity Multiplier Table to correct room TC and room SHC for that zone. Capacity versus cfm changes for the example is given in the Capacity vs Cfm Change table.

By analyzing each zone's ratio of deviation from equal sensible heat allocation, determine the proper cfm change. In the example, if building room SHC is 197,200 Btuh and 10 zones are used, each zone's normal room SHC is 19,720 Btuh. But if Zone 3 has 22,505 Btuh room SHC, then by ratio of 22,505: 19,720 or 1.14, the cfm change is +20%. Correspondingly, if Zone 1 had 16,935 Btuh room SHC, the cfm change is -20%.

In applications where the zone selection is not an increment of the number of unit modules (i.e. one zone requiring 500 cfm in a 48MA/50ME028 with 10,000 cfm), refer to Module Cfm Limits (page 36), Application Data section for details on using cfm's below 600 cfm/module.

Formulas required to use ratings are:

Outdoor Air Total Heat (OATH)

$$\text{OATH} = 4.5(\text{OA cfm})(h_{oa} - h_{room})$$

CAPACITY VS CFM CHANGES

ZONE NO.	NO. OF MODULES	RSL/ZONE PEAK LOAD	% DEVIATION (RSL/NOM UNIT RSHC)	% CFM CHANGE FROM NOMINAL	UNIT TOTAL CFM	X NOMINAL RTC/ZONE	ADJUSTED UNIT RTC
1	1	16,935	16,935/19,720 = .86	-20	720	9	23,556
2	1	22,505	22,505/19,720 = 1.14	+20	1080	11	23,556
3	1	22,505	22,505/19,720 = 1.14	+20	1080	11	23,556
4	3	59,160	59,160/3 x 19,720 = 1.00	0	2700	10	3 x 23,556 = 70,668
5	1	19,720	19,720/19,720 = 1.00	0	900	1.0	23,556
6	1	22,505	22,505/19,720 = 1.14	+20	1080	11	23,556
7	2	33,870	33,870/2 x 19,720 = .86	-20	1440	.9	2 x 23,556 = 42,400
10		197,200			9000		235,560

RSHC — Room Sensible Heat Capacity

RSL — Room Sensible Load

RTC — Room Total Capacity

ZONE COOLING CAPACITY MULTIPLIERS

% CFM CHANGE*	ROOM TOTAL CAPACITY (RTC)	ROOM SENSIBLE HEAT CAPACITY (RSHC)
+35	1.15	1.21†
+20	1.10	1.14†
+10	1.05	1.07†
0	1.00	1.00
-10	0.95	0.93
-20	0.90	0.86
-35	0.85	0.79

* Must not be greater than 1200 cfm nor less than 600 cfm per module.

† If resulting RSHC is greater than RTC, then RSHC equals RTC

Stages of heat are controlled individually in the small zones or collectively in large zones to provide flexible and continuous control for each zone.

Determine fan requirements

For 48MA/50ME operation, cfm range per module is 600 to 1200 cfm. Lower flow volumes are permissible if only first stage of heat is operated. Volumes above 1200 cfm may cause water blow-off during cooling.

Since the various unit zones operate at different air quantities and different external resistances, identify the zone having the highest static pressure requirement for the supply duct and supply outlet.

Usually, the longest duct run to the last outlet, with the greatest number of offsets and elbows, has the greatest static pressure requirement. Assume a duct friction analysis has been made and the cfm and static pressure are:

Zone No.	CFM	ESP (in. wg)	No. Modules	CFM/Module
1	720	6	1	720
2	1080	8	1	1080
3	1080	5	1	1080
4	2700	6	3	900
5	900	4	1	900
6	1080	4	1	1080
7	1440	5	2	720
Totals	9000		10	

The total unit (028 or 030) cfm is 9000. Zones 4 and 7 have 3 and 2 modules, respectively, "ganged" together to comply with the limitation of 1200 cfm per module.

The cfm for Zone 2 is 1080 with an ESP of 0.8 in. wg. This module appears to possess the highest friction loss. Therefore, the main fan static pressure is established at 8 in. wg ESP.

Enter Fan Performance table at 9000 cfm, .8 in. wg ESP and read: 1020 rpm and 5.4 bhp. The 028 indoor fan motor data shows the standard 10 hp motor with a maximum bhp of 11.5. Therefore, 5.4 bhp for this selection is satisfactory. In the Physical Data table, 2 pulley selections are available with the 028: Pulley A, shipped mounted; Pulley B, shipped in the blower compartment. Pulley A has a fixed pitch and at 1095 rpm is close enough to the required cfm and should be used. Pulley B at 1230 rpm allows selection of the unit at higher cfm's and static pressures.

$$\text{Outdoor Air Sensible Heat (OASH)}$$

$$\text{OASH} = 1.09 \text{ (OA cfm)} (\text{toa} - \text{troom})$$

$$\text{Room Total Capacity (RTC)}$$

$$\text{RTC} = \text{Unit TC} - \text{OASH}$$

$$\text{Room Sensible Heat Capacity (RSHC)}$$

$$\text{RSHC} = \text{Unit SHC} - \text{OASH}$$

$$\text{Leaving Air Temperature (LAT)}$$

$$\text{LAT} = \text{room temperature} - \frac{\text{RSHC}}{1.09 \text{ cfm}}$$

Determine Heating Capacity:

The specified requirement for electric heat dictates the selection of a 50ME028 unit with a kw option that meets or exceeds the heating load.

The Electric Resistance Heater Data table (page 30) indicates that the 028 unit has heating capacity options of 66, 88 and 132 kw. The 132 kw option is selected as it provides adequate heat for this application. The kw/zone and number of heat stages available are:

Zone No.	Load	Zone Heating Capacity	Stages of Heat
1	10.0 kw	13.2 kw	3
2	12.9 kw	13.2 kw	3
3	12.9 kw	13.2 kw	3
4	32.5 kw	39.6 kw	9
5	12.3 kw	13.2 kw	3
6	12.9 kw	31.2 kw	3
7	23.7 kw	26.4 kw	6
Total	117.2 kw	132.0 kw	30

Performance data

Room Design 75 F/50% Rh

COOLING CAPACITIES

48MA/50ME016

OUTDOOR AIR TEMP		TOTAL UNIT CFM											
		4,000						5,000					
		Outdoor Air Cfm						Outdoor Air Cfm					
Db	Wb	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw
85	65	168	118	14.8	174	126	15.1	177	134	15.2	176	130	15.2
	70	168	118	14.8	178	122	15.3	184	124	15.6	176	130	15.2
90	65	164	116	15.4	169	129	15.7	172	140	15.8	171	128	15.8
	70	164	116	15.4	173	124	15.9	179	131	16.2	171	128	15.8
95	73	164	116	15.4	176	121	16.0	183	125	16.4	171	128	15.8
	75	164	116	15.4	177	119	16.1	186	121	17.1	171	128	15.8
100	65	160	114	16.0	165	131	16.2	168	146	16.4	167	126	16.3
	70	160	114	16.0	169	126	16.4	174	137	16.7	167	126	16.3
105	75	160	114	16.0	173	121	16.6	182	127	17.1	167	126	16.3
	78	160	114	16.0	175	118	16.8	186	121	17.4	167	126	16.3
110	80	160	114	16.0	177	116	16.9	189	116	17.5	167	126	16.3
	70	156	112	16.5	164	128	17.0	170	143	17.3	163	124	16.9
115	75	156	112	16.5	168	123	17.2	177	133	17.7	163	124	16.9
	78	156	112	16.5	171	120	17.4	181	127	18.0	163	124	16.9
120	70	152	110	17.0	160	130	17.5	165	149	17.9	158	123	17.4
	75	152	110	17.0	164	125	17.8	172	139	18.3	158	123	17.4
125	78	148	109	17.5	161	124	18.5	171	139	19.1	154	121	17.9
	80	148	109	17.5	161	124	18.5	171	139	19.1	154	121	17.9
130	75	144	107	18.0	155	130	18.8	162	152	19.4	149	119	18.4
	78	144	107	18.0	155	130	18.8	162	152	19.4	149	119	18.4
135	70	140	107	18.5	150	128	19.2	165	155	19.8	157	130	19.2
	75	140	107	18.5	153	128	19.2	168	158	19.8	157	130	19.2
140	78	140	107	18.5	153	128	19.2	168	158	19.8	157	130	19.2
	80	140	107	18.5	153	128	19.2	168	158	19.8	157	130	19.2
145	75	136	103	19.0	144	122	19.7	156	144	20.0	146	120	19.7
	78	136	103	19.0	144	122	19.7	156	144	20.0	146	120	19.7
150	70	132	100	19.5	139	120	20.2	147	149	20.5	151	123	19.5
	75	132	100	19.5	139	120	20.2	147	149	20.5	151	123	19.5
155	78	128	97	20.0	135	117	20.7	144	146	21.0	148	120	20.7
	80	128	97	20.0	135	117	20.7	144	146	21.0	148	120	20.7
160	75	124	94	20.5	131	114	21.2	141	143	21.5	145	117	20.5
	78	124	94	20.5	131	114	21.2	141	143	21.5	145	117	20.5
165	70	120	91	21.0	127	111	21.7	138	139	22.0	141	114	21.0
	75	120	91	21.0	127	111	21.7	138	139	22.0	141	114	21.0
170	78	116	88	21.5	123	107	22.2	140	141	22.5	143	117	21.5
	80	116	88	21.5	123	107	22.2	140	141	22.5	143	117	21.5
175	75	112	85	22.0	119	104	22.7	136	137	23.0	139	118	21.5
	78	112	85	22.0	119	104	22.7	136	137	23.0	139	118	21.5
180	70	108	82	22.5	115	101	23.2	133	134	23.5	136	119	21.5
	75	108	82	22.5	115	101	23.2	133	134	23.5	136	119	21.5
185	78	104	79	23.0	111	98	23.7	130	131	24.0	133	120	21.5
	80	104	79	23.0	111	98	23.7	130	131	24.0	133	120	21.5
190	75	100	76	23.5	107	95	24.2	127	128	24.5	130	117	21.5
	78	100	76	23.5	107	95	24.2	127	128	24.5	130	117	21.5
195	70	96	73	24.0	103	92	24.5	124	125	24.8	126	114	21.5
	75	96	73	24.0	103	92	24.5	124	125	24.8	126	114	21.5
200	78	92	70	24.5	99	89	25.0	121	122	25.3	123	111	21.5
	80	92	70	24.5	99	89	25.0	121	122	25.3	123	111	21.5
205	75	88	67	25.0	95	85	25.5	118	119	25.8	120	108	21.5
	78	88	67	25.0	95	85	25.5	118	119	25.8	120	108	21.5
210	70	84	64	25.5	91	81	26.0	115	116	26.3	117	105	21.5
	75	84	64	25.5	91	81	26.0	115	116	26.3	117	105	21.5
215	78	80	61	26.0	87	77	26.5	112	113	26.8	114	102	21.5
	80	80	61	26.0	87	77	26.5	112	113	26.8	114	102	21.5
220	75	76	58	26.5	83	73	27.0	109	110	27.3	111	99	21.5
	78	76	58	26.5	83	73	27.0	109	110	27.3	111	99	21.5
225	70	72	55	27.0	79	69	27.5	106	107	27.8	108	96	21.5
	75	72	55	27.0	79	69	27.5	106	107	27.8	108	96	21.5
230	78	68	52	27.5	75	65	28.0	103	104	28.3	105	93	21.5
	80	68	52	27.5	75	65	28.0	103	104	28.3	105	93	21.5
235	75	64	49	28.0	71	61	28.5	100	101	28.8	102	90	21.5
	78	64	49	28.0	71	61	28.5	100	101	28.8	102	90	21.5
240	70	60	46	28.5	67	58	29.0	97	98	29.3	99	87	21.5
	75	60	46	28.5	67	58	29.0	97	98	29.3	99	87	21.5
245	68	56	43	29.0	63	54	29.5	94	95	29.8	96	84	21.5
	72	56	43	29.0	63	54	29.5	94	95	29.8	96	84	21.5
250	65	52	40	29.5	59	50	30.0	91	92	30.3	93	81	21.5
	68	52	40	29.5	59	50	30.0	91	92	30.3	93	81	21.5
255	62	48	37	30.0	55	46	30.5	88	89	30.8	90	78	21.5
	65	48	37	30.0	55	46	30.5	88	89	30.8	90	78	21.5
260	58	44	34	30.5	51	42	31.0	85	86	31.3	87	75	21.5
	62	44	34	30.5	51	42	31.0	85	86	31.3	87	75	21.5
265	55	40	31	31.0	47	38	31.5	82	83	31.8	84	72	21.5
	58	40	31	31.0	47	38	31.5	82	83	31.8	84	72	21.5
270	52	36	28	31.5	43	34	32.0	79	80	32.3	81	69	21.5
	55	36	28	31.5	43	34	32.0	79	80	32.3	81	69	21.5
275	48	32	25	32.0	39	30	32.5	76	77	32.8	78	66	21.5
	52	32	25	32.0	39	30	32.5	76	77	32.8	78	66	21.5
280	45	28	22	32.5	35	27	33.0	73	74	33.3	75	63	21.5
	48	28	22	32.5	35	27	33.0	73	74	33.3	75	63	21.5
285	42	24	19	33.0	31	24	33.5	70	71	33.8	72	60	21.5
	45	24	19	33.0	31	24	33.5	70	71	33.8	72	60	21.5
290	38	20	16	33.5	27	17	34.0	67	68	34.3	69	57	21.5
	42	20	16	33.5	27	17	34.0	67	68	34.3	69	57	21.5
295	35	17	13	34.0	24	14	34.5	64	65	34.8	66	54	21.5
	38	17	13	34.0	24	14	34.5	64	65	34.8	66		

Performance data
Room Design 75 F/50% Rh

COOLING CAPACITIES

48MA/50ME030

OUTDOOR AIR TEMP				TOTAL UNIT CFM																					
				8,000								10,000													
				Outdoor Air Cfm								Outdoor Air Cfm													
Db	Wb	TC	SHC	0	1000	2000	2500	0	1000	2000	2500	0	1000	2000	2500	TC	SHC	Kw							
85	65	298	215	29.7	311	229	30.5	317	240	30.9	319	245	31.0	309	238	30.4	322	31.2	328	263	31.6	330	267	31.7	
	70	298	215	29.7	317	223	30.9	326	228	31.5	329	230	31.7	309	238	30.4	327	31.5	335	251	32.1	339	253	32.3	
	65	292	212	30.7	304	231	31.6	309	247	31.9	312	254	32.1	303	235	31.5	315	32.4	323	270	32.7	322	277	32.8	
	70	292	212	30.7	309	225	31.9	318	235	32.5	322	240	32.8	303	235	31.5	320	32.6	328	258	33.1	331	263	33.3	
	73	292	212	30.7	313	222	32.2	324	228	32.9	328	230	33.2	303	235	31.5	323	32.8	332	251	33.5	336	253	33.7	
	75	292	212	30.7	315	219	32.3	328	222	33.2	333	234	33.5	303	235	31.5	325	32.4	330	236	345	337	340	246	
	65	285	209	31.8	297	234	32.6	303	255	33.0	305	264	33.2	296	232	32.5	307	32.6	333	314	277	33.8	316	286	33.9
	70	285	209	31.8	302	228	33.0	311	243	33.6	314	250	33.8	296	232	32.5	312	33.7	319	266	34.2	322	273	34.4	
	95	285	209	31.8	308	222	33.4	320	230	34.2	325	234	34.6	296	232	32.5	317	34.0	328	253	34.8	332	257	35.1	
	78	285	209	31.8	311	217	33.6	326	222	34.7	332	223	35.1	296	232	32.5	320	34.2	333	244	35.1	—	—	—	
	80	285	209	31.8	314	215	33.8	330	216	34.9	337	216	35.4	296	232	32.5	322	34.4	336	238	35.4	—	—	—	
	70	279	207	32.8	295	230	34.0	303	250	34.6	307	260	34.9	289	229	33.5	304	34.7	312	273	35.2	315	282	35.5	
	75	279	207	32.8	300	224	34.4	312	237	35.3	317	244	35.6	289	229	33.5	304	34.6	319	260	35.8	324	267	36.1	
	78	279	207	32.8	303	220	34.7	318	229	35.7	324	234	36.1	289	229	33.5	312	35.3	324	252	36.2	—	—	—	
	70	273	204	33.7	288	232	34.9	297	258	35.7	300	269	35.9	282	226	34.5	296	35.6	305	280	36.3	308	291	36.6	
	75	273	204	33.7	293	226	35.4	304	245	36.3	309	254	36.6	282	226	34.5	301	36.0	311	268	36.8	315	276	37.1	
	110	78	266	201	34.6	289	224	36.6	303	244	37.7	308	254	38.1	276	223	35.4	297	37.2	—	—	—	—	—	
	115	75	261	199	35.5	279	231	37.1	291	260	38.2	296	274	38.6	270	220	36.3	287	37.8	297	282	38.7	302	296	39.1

OUTDOOR AIR TEMP				TOTAL UNIT CFM																					
				11,000								12,000													
				Outdoor Air Cfm								Outdoor Air Cfm													
Db	Wb	TC	SHC	0	1000	2000	2500	0	1000	2000	2500	0	1000	2000	2500	TC	SHC	Kw							
85	65	314	248	30.7	326	263	31.5	332	273	31.8	334	278	31.9	317	259	30.9	330	273	31.7	335	284	32.0	337	289	32.1
	70	314	248	30.7	331	257	31.8	339	262	32.3	312	264	32.5	317	259	30.9	334	268	32.0	342	272	32.5	345	274	32.7
	65	307	245	31.8	319	265	32.5	324	281	32.9	326	288	33.1	310	256	32.0	322	275	32.8	328	291	33.1	330	298	33.3
	70	307	245	31.8	323	259	32.9	331	269	33.4	334	274	33.6	310	256	32.0	327	270	33.1	334	280	33.6	337	284	33.8
	90	307	245	31.8	326	256	33.1	336	261	33.7	339	264	33.9	310	256	32.0	329	266	33.3	338	272	33.9	342	275	34.1
	75	307	245	31.8	328	253	33.2	339	256	33.9	343	257	34.2	310	256	32.0	331	263	33.4	341	267	34.1	345	268	34.3
	65	300	242	32.8	311	267	33.9	317	287	34.1	319	297	34.2	303	253	33.0	314	277	33.9	321	298	34.3	323	307	34.4
	70	300	242	32.8	315	261	33.9	323	276	34.4	325	283	34.6	303	253	33.0	319	272	34.1	326	287	34.6	328	294	34.8
	95	300	242	32.8	321	255	34.3	330	263	35.0	334	267	35.2	303	253	33.0	323	265	34.5	333	274	35.1	—	—	—
	78	300	242	32.8	323	251	34.5	335	255	35.3	—	—	—	—	—	303	253	33.0	326	261	34.7	—	—	—	—
	80	300	242	32.8	325	249	34.6	—	—	—	—	—	—	—	—	303	253	33.0	328	258	34.8	—	—	—	—
	70	293	240	33.8	307	263	34.9	315	283	35.5	318	292	35.7	306	250	34.1	310	274	35.2	318	294	35.7	321	303	35.9
	75	293	240	33.8	312	257	35.3	322	271	36.0	326	277	36.3	306	250	34.1	315	268	35.5	324	281	36.2	—	—	—
	78	293	240	33.8	315	253	35.5	327	263	36.4	—	—	—	—	—	296	250	34.1	318	263	35.7	—	—	—	—
	70	286	237	34.8	300	266	35.9	309	290	36.6	311	302	36.8	289	247	35.1	303	276	36.1	311	300	36.8	314	312	37.0
	75	286	237	34.8	304	259	36.3	313	278	37.0	—	—	—	—	—	289	247	35.1	367	270	36.5	316	289	37.2	—
	110	78	279	234	35.7	300	257	37.4	—	—	—	—	—	—	—	282	244	36.0	302	268	37.6	—	—	—	—
	115	75	273	231	36.6	289	264	38.0	300	293	38.9	—	—	—	—	276	241	36.8	292	275	38.3	—	—	—	—

Kw — Compressor Motor Power Input
SHC — Sensible Heat Capacity (1000 Btuh)
TC — Total Capacity (1000 Btuh)

NOTES: 1. No values are given where unit cannot maintain the assumed room design relative humidity since the moisture content of the air leaving the unit is higher than the assumed room moisture content

2. Ratings are gross and do not include fan motor heat deduction.

Performance data
Room Design 75 F/50% Rh

COOLING CAPACITIES
48MA/50ME034

OUTDOOR		TOTAL UNIT CFM											
AIR TEMP		9,000						10,000					
		Outdoor Air Cfm						Outdoor Air Cfm					
		0			1000			2000			2500		
Db	Wb	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw
85	65	314	231	28.6	326	246	29.2	333	257	29.6	336	262	29.7
	70	314	231	28.6	332	240	29.5	342	245	30.0	347	247	30.3
90	65	307	228	29.6	318	248	30.3	325	264	30.6	327	272	30.8
	70	307	228	29.6	324	242	30.6	334	253	31.1	339	257	31.4
	73	307	228	29.6	328	239	30.8	341	245	31.5	346	248	31.7
	75	307	228	29.6	330	236	30.9	345	240	31.7	351	242	32.0
95	65	300	225	30.7	311	250	31.3	322	275	32.0	325	286	32.2
	70	300	225	30.7	316	244	31.6	326	260	32.2	330	267	32.4
	75	300	225	30.7	322	238	32.0	336	247	32.8	342	252	33.1
	78	300	225	30.7	326	234	32.2	343	239	33.2	350	241	33.6
	80	300	225	30.7	329	231	32.4	348	233	33.4	356	234	33.9
100	70	293	222	31.8	308	246	32.7	318	267	33.3	321	277	33.5
	75	293	222	31.8	314	240	33.1	328	254	33.9	333	261	34.2
	80	293	222	31.8	318	236	33.3	334	246	34.3	341	251	34.7
105	70	285	219	32.8	300	248	33.8	314	278	34.7	319	291	35.0
	75	285	219	32.8	306	242	34.1	319	262	35.0	324	271	35.3
110	78	278	215	33.8	301	240	35.4	316	261	36.4	—	—	—
115	75	271	212	34.7	290	246	36.1	306	280	37.3	312	295	37.8

OUTDOOR		TOTAL UNIT CFM											
AIR TEMP		11,000						12,000					
		Outdoor Air Cfm						Outdoor Air Cfm					
		0			1000			2000			0		
Db	Wb	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw
85	65	325	254	29.1	336	268	29.7	343	279	30.1	345	285	30.2
	70	325	254	29.1	341	262	30.0	352	268	30.5	355	270	30.7
90	65	318	251	30.2	328	270	30.8	335	287	31.1	342	299	31.5
	70	318	251	30.2	334	264	31.1	343	275	31.6	347	280	31.8
	73	318	251	30.2	337	261	31.3	349	268	31.9	354	271	32.1
	75	318	251	30.2	339	258	31.4	353	262	32.1	358	264	32.4
95	65	310	247	31.3	324	275	32.1	332	298	32.5	335	308	32.7
	70	310	247	31.3	325	267	32.2	334	282	32.7	338	290	32.9
	75	310	247	31.3	331	260	32.5	344	270	33.2	349	274	33.5
	78	310	247	31.3	334	256	32.7	350	262	33.5	—	314	258
	80	310	247	31.3	337	253	32.8	354	256	33.8	—	314	258
100	70	302	244	32.4	317	268	33.2	326	290	33.8	334	304	34.3
	75	302	244	32.4	322	262	33.6	335	277	34.3	340	284	34.6
	78	302	244	32.4	325	258	33.8	340	269	34.7	—	—	—
105	70	294	241	33.4	308	270	34.3	322	301	35.2	326	313	35.4
	75	294	241	33.4	313	264	34.6	325	284	35.4	330	294	35.7
110	78	287	238	34.4	308	262	35.9	—	—	—	—	290	248
115	75	279	234	35.4	296	268	36.6	312	303	37.8	—	282	245

Performance data
Room Design 75 F/50% Rh

COOLING CAPACITIES

48MA/50ME040

OUTDOOR AIR TEMP		TOTAL UNIT CFM												
		11,000						12,000						
Outdoor Air Cfm														
Db	Wb	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw	
65	367	262	36.8	402	294	39.0	416	311	40.2	420	322	40.8	368	268
85	70	367	262	36.8	410	290	39.5	426	300	40.8	434	305	41.6	368
65	364	263	38.3	394	297	40.4	403	316	41.6	404	330	42.3	366	270
90	70	364	263	38.3	401	293	40.9	412	304	42.3	418	314	43.1	366
73	364	263	38.3	408	291	41.4	419	298	42.8	427	303	43.7	366	270
75	364	263	38.3	413	290	41.5	425	293	43.1	434	295	44.1	366	270
65	361	264	39.8	386	300	41.8	390	321	43.1	388	339	43.8	364	272
95	75	361	264	39.8	392	295	42.3	398	309	43.8	402	323	44.6	364
70	361	264	39.8	398	289	43.1	408	296	44.6	416	304	45.6	364	272
78	361	264	39.8	402	285	43.4	413	287	45.2	427	292	46.3	364	272
80	361	264	39.8	405	282	43.6	418	281	45.6	433	284	46.7	364	272
70	355	264	41.3	397	294	43.9	381	313	45.4	384	331	46.3	359	273
100	75	355	264	41.3	383	288	44.6	390	300	46.2	399	313	47.2	359
78	355	264	41.3	387	284	44.9	397	291	46.7	410	302	47.8	359	273
105	70	351	263	42.8	365	294	45.5	364	316	46.9	366	338	48.0	354
75	351	263	42.8	368	287	46.1	373	303	47.8	381	322	48.8	354	271
110	78	342	260	44.3	354	280	48.2	360	298	50.1	373	319	51.4	347
115	75	334	257	45.8	336	283	49.4	338	309	51.3	347	336	52.9	339

OUTDOOR AIR TEMP		TOTAL UNIT CFM												
		13,000						14,000						
Outdoor Air Cfm														
Db	Wb	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw	
65	371	273	36.9	409	310	39.2	426	333	40.5	432	345	41.1	374	279
85	70	371	273	36.9	417	307	39.8	437	322	41.2	446	329	42.0	374
65	369	276	38.5	402	315	40.7	415	339	42.0	417	354	42.7	371	282
90	70	369	276	38.5	409	312	41.2	423	328	42.6	430	338	43.5	371
73	369	276	38.5	416	311	41.7	431	321	43.2	439	327	44.0	371	282
75	369	276	38.5	423	312	41.8	436	316	43.4	445	319	44.3	371	282
65	367	279	40.0	395	320	42.1	403	345	43.4	401	362	44.2	369	286
70	367	279	40.0	401	316	42.7	410	333	44.1	414	347	45.0	369	286
95	75	367	279	40.0	408	311	43.4	418	319	45.0	427	328	46.0	369
78	367	279	40.0	412	307	43.7	423	310	45.5	436	315	46.6	369	286
80	367	279	40.0	415	304	44.0	427	304	45.9	442	307	47.0	369	286
70	362	280	41.6	388	317	44.3	393	336	45.7	395	353	46.7	364	287
100	75	362	280	41.6	394	310	45.0	400	322	46.6	408	336	47.6	364
78	362	280	41.6	397	307	45.3	406	314	47.1	417	324	48.2	364	287
105	70	357	281	43.1	376	317	45.9	375	338	47.3	376	359	48.4	365
75	357	281	43.1	379	310	46.5	383	325	48.2	390	344	49.2	359	321
110	78	349	279	44.7	364	302	48.6	371	320	50.5	380	341	51.7	352
115	75	342	278	46.3	347	305	49.9	350	331	51.7	359	354	53.3	345

Kw — Compressor Motor Power Input
SHC — Sensible Heat Capacity (1000 Btu/h)
TC — Total Capacity (1000 Btu/h)

NOTES: 1. No values are given where unit cannot maintain the assumed room design relative humidity since the moisture content of the air leaving the unit is higher than the assumed room moisture content

2. Ratings are gross and do not include fan motor heat deduction

Performance data
Room Design 78 F/50% Rh

COOLING CAPACITIES
48MA/50ME016

OUTDOOR AIR TEMP				TOTAL UNIT CFM												TOTAL UNIT CFM							
				5,000						6,000						7,000							
				Outdoor Air Cfm			Outdoor Air Cfm			Outdoor Air Cfm			Outdoor Air Cfm			Outdoor Air Cfm			Outdoor Air Cfm				
Db	Wb	TC	SHC	0	750	1500	0	750	1500	0	750	1500	0	750	1500	0	750	1500	0	750	1500		
85	65	183	132	15.5	186	141	15.7	188	148	15.8	188	144	15.8	192	153	16.0	193	160	16.0	192	156	16.0	
	70	183	132	15.5	190	136	15.9	194	139	16.1	188	144	15.8	194	148	16.1	198	151	16.3	192	156	16.4	
	65	178	131	16.1	182	143	16.3	183	154	16.4	183	143	16.4	187	155	16.5	188	166	16.6	190	154	16.1	
	70	178	131	16.1	185	138	16.5	189	145	16.7	183	143	16.4	189	150	16.7	193	157	16.9	187	154	16.8	
	73	178	131	16.1	187	136	16.6	193	139	16.9	183	143	16.4	191	148	16.8	196	151	17.0	187	154	16.9	
	75	178	131	16.1	188	134	16.6	195	135	17.0	183	143	16.4	193	146	16.9	198	148	17.2	187	154	16.3	
	65	174	129	16.7	177	145	16.9	179	160	17.0	178	141	17.0	182	157	17.1	183	172	17.2	182	152	17.1	
	70	174	129	16.7	180	140	17.0	184	151	17.3	178	141	17.0	184	152	17.3	188	163	17.5	182	152	17.1	
	75	174	129	16.7	183	136	17.2	190	141	17.6	178	141	17.0	187	148	17.4	193	154	17.8	182	152	17.6	
	78	174	129	16.7	186	133	17.4	194	135	17.7	178	141	17.0	189	145	17.6	192	152	17.7	190	159	17.9	
	80	174	129	16.7	187	130	17.4	196	131	17.8	178	141	17.0	191	142	17.6	193	154	17.8	192	152	17.7	
	70	169	127	17.3	175	143	17.6	179	157	17.8	174	139	17.5	179	155	17.9	183	169	18.1	177	150	17.7	
	75	169	127	17.3	178	138	17.8	185	148	18.2	174	139	17.5	182	150	18.0	188	160	18.3	177	150	18.2	
	78	169	127	17.3	181	135	17.9	188	141	18.4	174	139	17.5	184	147	18.1	177	150	18.3	177	150	18.2	
	70	165	125	17.8	170	145	18.2	174	163	18.4	169	137	18.1	174	157	18.4	177	175	18.6	172	148	18.3	
	75	165	125	17.8	173	140	18.4	179	154	18.8	169	137	18.1	177	152	18.6	182	166	18.9	172	148	18.3	
	110	78	160	123	18.4	170	139	19.1	178	154	19.5	164	135	18.6	174	151	19.3	177	167	18.8	176	162	19.4
	115	75	156	121	18.9	164	19.5	169	166	19.9	159	133	19.2	167	156	19.7	171	162	144	19.4	169	168	19.9

48MA/50ME024

OUTDOOR AIR TEMP				TOTAL UNIT CFM												TOTAL UNIT CFM							
				6,000						7,500						9,000							
				Outdoor Air Cfm			Outdoor Air Cfm			Outdoor Air Cfm			Outdoor Air Cfm			Outdoor Air Cfm			Outdoor Air Cfm				
Db	Wb	TC	SHC	0	750	1500	0	750	1500	0	750	1500	0	750	1500	0	750	1500	0	750	1500		
85	65	220	158	18.9	227	167	19.2	230	175	19.4	228	176	19.3	235	185	19.6	238	193	19.8	234	192	19.6	
	70	220	158	18.9	231	163	19.4	236	167	19.7	228	176	19.3	238	181	19.8	243	184	20.1	234	192	20.3	
	65	216	156	19.7	222	169	20.0	225	181	20.2	223	174	20.1	229	187	20.4	233	199	20.6	229	190	20.4	
	70	216	156	19.7	226	165	20.2	231	172	20.5	223	174	20.1	233	183	20.6	238	190	20.9	238	200	20.9	
	73	216	156	19.7	228	163	20.4	235	167	20.8	223	174	20.1	235	180	20.7	241	185	21.1	229	190	20.4	
	75	216	156	19.7	230	161	20.5	238	163	20.9	223	174	20.1	236	178	20.8	244	181	21.2	229	190	21.5	
	65	211	154	20.4	217	171	20.8	220	187	21.0	218	172	20.9	224	189	21.2	228	204	21.4	223	188	21.8	
	70	211	154	20.4	220	167	21.0	226	178	21.3	218	172	20.9	227	185	21.4	232	196	21.2	223	188	21.2	
	75	211	154	20.4	224	163	21.2	232	169	21.7	218	172	20.9	231	180	21.6	238	187	22.0	235	197	21.9	
	78	211	154	20.4	227	160	21.4	237	163	22.0	218	172	20.9	233	177	21.8	242	181	22.3	223	188	22.0	
	80	211	154	20.4	229	157	21.5	240	159	22.2	218	172	20.9	235	175	21.9	244	176	22.4	223	188	21.2	
	70	206	152	21.2	215	169	21.7	220	184	22.1	213	170	21.6	220	187	22.2	227	202	22.5	218	186	21.8	
	75	206	152	21.2	219	164	22.0	227	175	22.5	213	170	21.6	225	182	22.4	232	193	22.8	216	186	22.0	
	78	206	152	21.2	221	161	22.2	231	169	22.8	213	170	21.6	227	179	22.5	236	187	23.1	218	186	22.3	
	70	201	150	21.9	210	171	22.5	215	190	22.9	208	167	22.4	216	188	22.9	221	207	23.3	213	184	22.7	
	75	201	150	21.9	213	166	22.7	221	181	23.2	208	167	22.4	219	184	23.1	226	198	23.6	213	184	22.8	
	110	78	196	148	22.6	210	165	23.6	219	181	24.2	203	165	23.1	216	183	24.0	223	198	24.6	207	182	23.4
	115	75	191	146	23.3	202	170	24.1	210	192	24.7	197	163	23.8	207	187	24.5	214	209	25.1	202	180	24.8

48MA/50ME028

OUTDOOR AIR TEMP				TOTAL UNIT CFM												TOTAL UNIT CFM						
				8,000						10,000						12,000						
				Outdoor Air Cfm			Outdoor Air Cfm			Outdoor Air Cfm			Outdoor Air Cfm			Outdoor Air Cfm			Outdoor Air Cfm			
Db	Wb	TC	SHC	0	1000	2000	0	1000	2000	0	1000	2000	0	1000	2000	0	1000	2000	0	1000	2000	
85	65	282	205	24.9	290	218	25.4	294	227	25.6	292	228	25.4	300	241	25.9	303	251	26.0	298	250	25.8
	70	282	205	24.9	295	212	25.6	302	216	26.0	292	228	25.4	304	235	26.1	310	239	26.4	298	250	25.8
	65	276	203	25.9	284	220	26.3	287	235	26.5	285	225	26.4	293	243	26.8</						

Performance data
Room Design 78 F/50% Rh

COOLING CAPACITIES
48MA/50ME030

OUTDOOR AIR TEMP	8,000												TOTAL UNIT CFM																		
	Outdoor Air Cfm												10,000																		
	0				1000				2000				2500				0				1000				2000				2500		
Db	Wb	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw			
85	65	310	217	30.5	321	231	31.2	325	241	31.4	327	246	31.5	321	241	31.2	333	254	31.9	337	265	32.2	338	269	32.2	334	269	32.2			
	70	310	217	30.5	327	226	31.5	334	230	32.0	337	232	32.2	321	241	31.2	338	249	32.2	345	253	32.6	347	255	32.8	345	255	32.8			
	65	304	215	31.5	314	234	32.2	318	249	32.5	320	256	32.6	315	238	32.3	325	257	33.0	329	272	33.3	331	279	33.4	331	279	33.4			
90	70	304	215	31.5	319	228	32.6	327	237	33.1	329	242	33.3	315	238	32.3	330	251	33.3	336	261	33.7	339	265	33.9	336	265	33.9			
	73	304	215	31.5	323	224	32.8	332	230	33.5	336	232	33.7	315	238	32.3	333	248	33.5	341	253	34.1	344	256	34.3	344	256	34.3			
	75	304	215	31.5	325	222	33.0	336	225	33.7	340	226	34.0	315	238	32.3	335	245	33.6	345	248	34.3	348	250	34.5	348	250	34.5			
	65	297	212	32.6	307	236	33.3	312	256	33.7	313	266	33.8	308	235	33.4	318	259	34.1	323	279	34.4	324	288	34.5	324	288	34.5			
95	70	297	212	32.6	312	230	33.7	319	245	34.2	321	252	34.3	308	235	33.4	322	253	34.4	328	268	34.8	330	275	35.0	330	275	35.0			
	75	297	212	32.6	317	224	34.1	328	232	34.8	332	236	35.1	308	235	33.4	327	247	34.7	336	256	35.4	340	260	35.6	340	260	35.6			
	78	297	212	32.6	321	220	34.3	334	224	35.2	339	226	35.6	308	235	33.4	330	243	34.9	341	248	35.7	346	250	36.0	346	250	36.0			
	80	297	212	32.6	324	217	34.5	338	218	35.5	344	219	35.9	308	235	33.4	332	241	35.1	345	242	36.0	350	243	36.3	350	243	36.3			
100	70	291	209	33.7	304	233	34.7	311	252	35.2	314	262	35.4	301	232	34.4	314	256	35.4	321	275	35.9	323	284	36.1	323	284	36.1			
	75	291	209	33.7	310	226	35.1	320	240	35.9	324	246	36.2	301	232	34.4	319	250	35.8	328	263	36.4	331	270	36.7	331	270	36.7			
	78	291	209	33.7	313	222	35.4	326	232	36.3	331	236	36.7	301	232	34.4	322	246	36.0	333	255	36.8	337	260	37.1	337	260	37.1			
105	70	284	206	34.7	297	235	35.7	305	260	36.3	308	271	36.5	294	229	35.4	306	258	36.4	314	283	37.0	316	294	37.2	316	294	37.2			
	75	284	206	34.7	302	229	36.1	312	248	36.9	316	256	37.2	294	229	35.4	311	252	36.8	320	271	37.5	323	279	37.7	323	279	37.7			
110	78	278	204	35.6	298	227	37.3	310	247	38.3	315	257	38.7	287	226	36.4	306	250	38.0	316	271	38.8	320	280	39.1	320	280	39.1			
115	75	272	201	36.5	288	234	37.9	298	263	38.8	303	277	39.2	280	224	37.3	296	257	38.6	305	285	39.5	309	299	39.8	309	299	39.8			

OUTDOOR AIR TEMP	11,000												TOTAL UNIT CFM																		
	Outdoor Air Cfm												12,000																		
	0				1000				2000				2500				0				1000				2000				2500		
Db	Wb	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw			
85	65	326	252	31.4	337	265	32.1	341	276	32.4	342	280	32.5	329	262	31.7	340	276	32.4	344	287	32.6	346	291	32.7	346	291	32.7			
	70	326	252	31.4	342	260	32.4	348	265	32.9	351	266	33.0	329	262	31.7	345	271	32.7	351	271	33.1	354	277	33.2	354	277	33.2			
	65	319	249	32.6	329	267	33.2	334	283	33.5	335	290	33.6	322	260	32.8	332	279	33.5	337	294	33.8	339	301	33.9	339	301	33.9			
90	70	319	249	32.6	333	262	33.5	340	272	34.0	342	276	34.1	322	260	32.8	337	273	33.7	343	283	34.2	345	287	34.3	345	287	34.3			
	73	319	249	32.6	336	259	33.7	345	265	34.3	348	267	34.5	322	260	32.8	339	269	33.9	397	276	34.5	350	278	34.7	350	278	34.7			
	75	319	249	32.6	338	256	33.9	348	260	34.5	351	261	34.7	322	260	32.8	341	267	34.1	351	271	34.7	354	271	34.9	354	271	34.9			
	65	312	246	33.6	322	270	34.4	327	290	34.7	328	299	34.8	315	257	33.9	325	281	34.6	330	301	34.9	332	309	35.0	332	309	35.0			
95	70	312	246	33.6	325	264	34.6	332	279	35.1	334	286	35.2	315	257	33.9	328	275	34.8	335	329	35.3	337	354	35.4	337	354	35.4			
	75	312	246	33.6	330	258	35.0	339	267	35.6	343	271	35.8	315	257	33.9	333	269	35.2	342	278	35.8	345	282	36.0	342	278	36.0			
	78	312	246	33.6	333	254	35.2	344	259	35.9	348	261	36.2	316	257	33.9	336	265	35.4	346	270	36.1	—	—	—	—	—	—			
	80	312	246	33.6	335	252	35.3	347	253	36.2	—	—	—	315	257	33.9	338	262	35.5	349	264	36.3	—	—	—	—	—	—			
100	70	304	243	34.7	317	267	35.7	324	286	36.2	327	295	36.3	308	254	34.9	320	277	35.9	327	297	36.4	329	306	36.6	329	306	36.6			
	75	304	243	34.7	322	261	36.0	331	274	36.7	334	281	36.9	308	254	34.9	325	271	36.2	333	285	36.8	336	292	37.1	336	292	37.1			
	78	304	243	34.7	325	257	36.7	335	266	37.0	339	271	37.3	308	254	34.9	328	267	36.4	338	277	37.2	—	—	—	—	—	—			
105	70	297	240	35.7	310	269	36.7	317	294	37.3	320	305	37.5	301	251	36.0	317	274	37.2	325	303	37.9	327	301	38.1	327	301	38.1			
	75	297	240	35.7	314	263	37.0	322	282	37.7	325	290	37.9	301	251	36.0	317	274	37.2	327	303	37.9	327	301	38.1	327	301	38.1			
110	78	290	238	36.7	309	261	38.2	319	282	39.0	—	—	—	294	248	36.9	312	272	38.4	321	292	39.2	—	—	—	—	—	—			
115	75	284	235	37.6	299																										

Performance data
Room Design 78 F/50% Rh

COOLING CAPACITIES
48MA/50ME034

OUTDOOR				TOTAL UNIT CFM												
AIR TEMP				10,000												
				Outdoor Air Cfm												
Db	Wb	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw
85	65	333	246	29.6	343	260	30.1	349	271	30.3	350	276	30.4	338	258	29.8
	70	333	246	29.6	349	254	30.4	357	260	30.8	361	262	31.0	338	258	29.8
	65	326	243	30.7	335	262	31.2	340	278	31.4	347	290	31.8	331	255	30.9
	70	326	243	30.7	341	257	31.5	349	267	31.9	352	272	32.1	331	255	30.9
90	73	326	243	30.7	344	253	31.6	355	260	32.2	359	263	32.4	331	255	30.9
	75	326	243	30.7	346	251	31.8	359	255	32.4	364	256	32.7	331	255	30.9
	65	319	240	31.8	331	267	32.5	337	289	32.9	340	299	33.0	323	252	32.1
	70	319	240	31.8	333	259	32.6	341	274	33.0	344	282	33.2	323	252	32.1
95	75	319	240	31.8	338	253	32.9	350	262	33.5	354	266	33.8	323	252	32.1
	78	319	240	31.8	342	249	33.1	356	254	33.9	362	256	34.2	323	252	32.1
	80	319	240	31.8	344	246	33.2	360	249	34.1	367	250	34.5	323	252	32.1
100	70	311	237	32.9	324	261	33.7	331	282	34.1	339	296	34.6	315	248	33.2
	75	311	237	32.9	329	255	34.0	341	269	34.7	345	276	34.9	315	248	33.2
	78	311	237	32.9	333	251	34.2	347	261	35.0	352	266	35.4	315	248	33.2
105	70	303	234	34.0	315	263	34.8	328	293	35.6	331	305	35.8	307	245	34.2
	75	303	234	34.0	321	257	35.1	331	277	35.8	335	286	36.1	307	245	34.2
110	78	295	231	35.0	315	255	36.4	328	276	37.2	333	286	37.6	299	242	35.3
115	75	287	228	36.0	304	261	37.1	318	295	38.2	323	310	38.6	291	239	36.3

OUTDOOR				TOTAL UNIT CFM												
AIR TEMP				12,000												
				Outdoor Air Cfm												
Db	Wb	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw
85	65	343	269	30.1	352	282	30.5	357	293	30.8	359	298	30.9	346	280	30.2
	70	343	269	30.1	358	277	30.8	366	282	31.2	369	284	31.4	346	280	30.2
	65	335	266	31.2	344	284	31.6	354	305	32.1	356	312	32.3	339	277	31.3
	70	335	266	31.2	349	279	31.9	357	290	32.3	360	294	32.5	339	277	31.3
90	73	335	266	31.2	352	276	32.1	362	282	32.6	366	285	32.8	339	277	31.3
	75	335	266	31.2	354	273	32.2	366	278	32.8	370	279	33.0	339	277	31.3
	65	327	263	32.3	339	289	33.0	346	312	33.3	348	322	33.5	347	295	31.8
	70	327	263	32.3	340	281	33.0	348	297	33.4	350	304	33.6	331	273	32.3
95	75	327	263	32.3	345	275	33.3	356	285	33.9	361	289	34.1	331	273	32.5
	78	327	263	32.3	349	271	33.5	362	277	34.2	367	279	34.5	331	273	32.5
	80	327	263	32.3	351	269	33.6	366	271	34.4	—	—	—	331	273	32.5
100	70	319	259	33.4	332	283	34.1	343	308	34.8	346	318	35.0	322	270	33.6
	75	319	259	33.4	336	277	34.4	347	292	35.0	351	299	35.3	322	270	33.6
	78	319	259	33.4	339	273	34.6	352	284	35.4	357	289	35.7	322	270	33.6
105	70	311	256	34.5	326	288	35.4	335	315	36.0	338	328	36.2	314	267	34.7
	75	311	256	34.5	327	279	35.5	337	299	36.2	341	309	36.4	314	267	34.7
110	78	302	253	35.5	321	277	36.8	333	298	37.6	—	—	—	305	264	35.7
115	75	295	250	36.5	310	283	37.6	323	318	38.6	328	328	38.9	297	260	36.7

Performance data
Room Design 78 F/50% Rh

COOLING CAPACITIES

48MA/50ME040

OUTDOOR AIR TEMP		11,000												12,000											
		Outdoor Air Cfm												Outdoor Air Cfm											
		0			1000			2000			3000			0			1000			2000			3000		
Db	Wb	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw
85	65	372	262	37.9	410	298	39.3	425	318	40.4	431	329	41.1	375	268	37.0	414	307	39.5	431	329	40.7	438	342	41.3
	70	372	262	37.9	417	295	39.8	438	307	41.2	445	312	41.9	375	268	37.0	421	304	39.9	443	320	41.4	452	325	42.1
90	65	371	266	38.5	403	302	40.8	415	324	41.9	417	339	42.6	374	273	38.7	407	312	40.9	421	337	42.2	424	352	42.9
	70	371	266	38.5	411	299	41.3	426	314	42.7	431	323	43.4	374	273	38.7	415	310	41.5	432	327	42.9	437	336	43.6
	73	371	266	38.5	417	298	41.7	433	307	43.2	441	313	44.0	374	273	38.7	422	308	41.9	439	320	43.4	448	326	44.2
	75	371	266	38.5	423	298	41.8	439	303	43.5	448	305	44.4	374	273	38.7	429	306	42.1	445	316	43.8	455	319	44.6
95	65	370	269	40.2	396	306	42.2	405	331	43.4	402	348	44.2	374	277	40.4	400	317	42.4	411	344	43.6	411	361	44.5
	70	370	269	40.2	404	303	42.8	414	320	44.2	416	333	44.9	374	277	40.4	409	315	43.1	420	334	44.4	423	345	45.2
	75	370	269	40.2	411	298	43.4	423	307	45.1	431	315	46.0	374	277	40.4	417	310	43.7	429	320	45.3	438	328	46.2
	78	370	269	40.2	416	295	43.8	429	299	45.6	442	306	46.7	374	277	40.4	421	307	44.0	435	311	45.9	447	316	46.9
100	70	364	269	41.7	393	304	44.4	398	324	45.8	398	340	46.7	368	277	41.9	398	317	44.6	404	337	46.0	404	353	47.0
	75	364	269	41.7	399	299	45.0	407	311	46.7	414	324	47.7	368	277	41.9	405	311	45.2	414	325	46.9	420	337	47.9
	78	364	269	41.7	404	295	45.4	412	303	47.2	425	312	48.3	368	277	41.9	410	308	45.6	417	315	47.5	429	325	48.5
	75	359	268	43.2	383	306	46.0	381	328	47.4	381	347	48.5	362	278	43.4	388	319	46.2	388	341	47.7	387	360	48.7
105	70	359	268	43.2	383	299	46.6	391	315	48.3	397	333	49.3	362	278	43.4	393	312	46.8	399	329	48.4	402	345	49.5
	78	352	267	44.8	372	293	48.8	379	311	50.6	387	330	51.9	355	277	45.0	378	306	49.0	385	324	50.8	392	342	52.1
	75	345	265	46.4	358	298	49.9	356	322	51.9	363	347	53.4	348	275	46.6	363	311	50.2	363	334	52.1	369	358	53.6

OUTDOOR AIR TEMP		13,000												14,000											
		Outdoor Air Cfm												Outdoor Air Cfm											
		0			1000			2000			3000			0			1000			2000			3000		
Db	Wb	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw
85	65	378	276	37.2	416	314	39.5	434	337	40.8	442	352	41.4	382	283	37.4	418	321	39.6	437	346	40.9	445	363	41.5
	70	378	276	37.2	424	312	40.0	446	328	41.5	456	336	42.2	382	283	37.4	428	319	40.2	449	337	41.6	459	347	42.4
90	65	377	280	38.8	409	320	41.0	425	346	42.3	429	363	43.1	379	287	39.0	412	327	41.1	429	356	42.4	434	374	43.2
	70	377	280	38.8	418	318	41.6	436	336	43.0	442	347	43.8	379	287	39.0	421	326	41.7	439	346	43.1	448	359	43.9
	73	377	280	38.8	424	317	42.0	444	331	43.6	453	338	44.4	379	287	39.0	427	325	42.1	448	342	43.7	457	349	44.5
	75	377	280	38.8	431	317	42.2	450	328	43.9	460	331	44.7	379	287	39.0	434	326	42.4	454	339	44.0	465	344	44.8
95	65	375	284	40.4	403	325	42.5	416	355	43.8	417	373	44.7	377	291	40.5	405	334	42.6	420	365	43.9	424	385	44.8
	70	375	284	40.4	411	323	43.2	425	345	44.5	429	359	45.3	377	291	40.5	414	332	43.3	429	356	44.7	436	371	45.5
	75	375	284	40.4	420	319	43.8	434	332	45.4	442	340	46.4	377	291	40.5	423	328	43.9	439	344	45.6	447	352	46.5
	78	375	284	40.4	423	316	44.1	439	323	46.0	451	327	47.0	377	291	40.5	426	324	44.2	444	336	46.1	454	339	47.2
100	70	370	285	42.0	402	326	44.8	409	348	46.2	411	365	47.1	372	292	42.1	406	336	44.9	414	360	46.4	417	377	47.3
	75	370	285	42.0	408	321	45.4	419	336	47.0	424	348	48.0	372	292	42.1	412	331	45.5	423	348	47.2	429	360	48.1
	78	370	285	42.0	413	319	45.7	423	328	47.5	432	336	48.7	372	292	42.1	417	329	45.9	429	340	47.6	436	348	48.8
	75	364	285	43.5	392	330	46.3	393	352	47.8	394	371	48.9	367	293	43.6	397	340	46.5	398	364	48.0	399	382	49.1
105	70	364	285	43.5	397	323	46.9	403	341	48.6	407	357	49.6	367	293	43.6	401	334	47.1	407	352	48.8	411	369	49.8
	78	358	285	45.1	384	318	49.2	389	334	51.1	397	353	52.2	361	293	45.3	389	329	49.3	393	345	51.3	402	364	52.4
	75	351	285	46.7	368	322	50.4	368	345	52.3	375	368	53.9	354	294	46.9	373	333	50.5	374	357	52.5	381	377	54.1

Kw — Compressor Motor Power Input

SHC — Sensible Heat Capacity (1000 Btuh)

TC — Total Capacity (1000 Btuh)

NOTES: 1 No values are given where unit cannot maintain the assumed room design relative humidity since the moisture content of the air leaving the unit is higher than the assumed room moisture content

2. Ratings are gross and do not include fan motor heat deduction

Performance data
Room Design 80 F/50% Rh

COOLING CAPACITIES
48MA/50ME016

OUTDOOR AIR TEMP		TOTAL UNIT CFM																										
		5,000						6,000						7,000														
		Outdoor Air Cfm						Outdoor Air Cfm						Outdoor Air Cfm														
Db	Wb	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw									
65	188	133	15.8	191	141	15.9	192	148	16.0	193	146	16.0	196	153	16.2	197	160	16.2	199	165	16.3	201	172	16.4				
70	188	133	15.8	194	137	16.1	197	139	16.2	193	146	16.0	199	149	16.3	202	152	16.4	197	157	16.2	202	161	16.5	205	164	16.6	
65	183	131	16.4	186	143	16.5	187	154	16.6	188	144	16.6	191	156	16.8	192	167	16.8	192	155	16.8	194	167	16.9	195	178	17.0	
70	183	131	16.4	189	139	16.7	192	146	16.8	188	144	16.6	194	151	16.9	197	158	17.1	192	155	16.8	197	163	17.1	200	170	17.2	
73	183	131	16.4	191	136	16.8	196	140	17.0	188	144	16.6	195	149	17.0	200	152	17.2	192	155	16.8	199	160	17.2	202	164	17.4	
75	183	131	16.4	192	134	16.8	198	136	17.1	188	144	16.6	197	147	17.1	202	149	17.3	192	155	16.8	200	159	17.2	204	161	17.5	
65	179	130	17.0	181	145	17.1	182	160	17.1	183	142	17.2	186	158	17.3	186	173	17.4	187	153	17.4	189	169	17.5	190	184	17.6	
70	179	130	17.0	184	141	17.3	187	152	17.4	183	142	17.2	188	153	17.5	191	164	17.7	187	153	17.4	191	165	17.7	194	176	17.8	
75	179	130	17.0	187	137	17.4	193	142	17.7	183	142	17.2	191	149	17.7	196	155	17.9	187	153	17.4	194	161	17.8	199	167	18.1	
78	179	130	17.0	189	134	17.6	197	136	17.9	183	142	17.2	193	146	17.8	199	149	18.1	187	153	17.4	196	158	17.9	—	—	—	
80	179	130	17.0	191	131	17.6	199	132	18.1	183	142	17.2	195	144	17.8	—	—	—	187	153	17.4	197	155	18.0	—	—	—	
70	174	128	17.5	179	143	17.8	182	158	18.0	178	140	17.8	183	156	18.1	186	170	18.2	182	151	18.0	186	167	18.3	189	182	18.4	
75	174	128	17.5	182	139	18.0	188	149	18.3	178	140	17.8	186	151	18.2	191	161	18.5	182	151	18.0	189	163	18.4	193	173	18.7	
78	174	128	17.5	184	136	18.1	191	142	18.6	178	140	17.8	188	148	18.4	194	155	18.7	182	151	18.0	190	160	18.5	—	—	—	
70	169	126	18.1	174	145	18.4	177	164	18.6	173	138	18.4	178	158	18.7	180	176	18.8	176	150	18.6	181	169	18.8	183	19.0	—	
75	169	126	18.1	177	141	18.6	182	155	18.9	173	138	18.4	181	153	18.8	185	167	19.1	176	150	18.6	183	165	19.0	187	179	19.3	
110	78	165	124	18.7	174	140	19.3	180	155	19.7	168	136	18.9	177	152	19.5	—	—	—	171	148	19.1	179	164	19.7	—	—	—
115	75	160	122	19.2	167	145	19.7	172	167	20.1	164	134	19.5	170	157	19.9	175	20.2	167	146	19.7	173	169	20.1	—	—	—	

48MA/50ME024

OUTDOOR AIR TEMP		TOTAL UNIT CFM																										
		6,000						7,500						9,000														
		Outdoor Air Cfm						Outdoor Air Cfm						Outdoor Air Cfm														
Db	Wb	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw									
65	227	159	19.2	232	168	19.5	234	176	19.6	234	177	19.6	240	186	19.9	242	194	20.0	240	194	19.9	245	203	20.2	248	211	20.3	
70	227	159	19.2	236	164	19.7	241	167	20.0	234	177	19.6	243	182	20.1	238	185	20.3	240	194	19.9	249	200	20.4	253	203	20.6	
65	222	157	20.0	227	170	20.3	229	182	20.4	229	175	20.4	235	188	20.7	237	200	20.9	235	192	20.7	240	205	21.0	243	216	21.1	
70	222	157	20.0	231	166	20.5	235	173	20.8	229	175	20.4	238	184	20.9	242	191	21.2	235	192	20.7	243	201	21.2	247	209	21.4	
73	222	157	20.0	233	164	20.6	239	168	21.0	229	175	20.4	240	181	21.0	246	186	21.4	235	192	20.7	245	199	21.3	250	203	21.6	
75	222	157	20.0	235	162	20.7	242	164	21.2	229	175	20.4	242	180	21.1	248	182	21.5	235	192	20.7	246	197	21.4	253	199	21.7	
65	217	155	20.8	222	172	21.1	225	187	21.3	224	173	21.1	230	190	21.6	233	205	21.7	229	190	21.5	235	207	21.9	238	222	22.0	
70	217	155	20.8	225	168	21.3	230	179	21.6	224	173	21.2	232	186	21.7	236	197	22.0	229	190	21.5	237	203	22.0	241	214	22.2	
75	217	155	20.8	229	164	21.5	237	170	22.0	224	173	21.2	236	182	21.9	242	188	22.3	229	190	21.5	241	199	22.2	247	205	22.6	
78	217	155	20.8	232	161	21.7	241	164	22.2	224	173	21.2	238	179	22.1	246	182	22.5	229	190	21.5	243	196	22.3	250	199	22.8	
80	217	155	20.8	234	159	21.8	244	160	22.4	224	173	21.2	240	177	22.2	249	178	22.7	229	190	21.5	244	194	22.4	—	—	—	
70	212	153	21.6	220	170	22.1	224	185	22.3	219	171	22.0	227	188	22.5	231	203	22.8	224	188	22.3	231	205	22.8	236	210	23.1	
75	212	153	21.6	224	166	22.3	231	176	22.7	219	171	22.0	230	183	22.7	236	194	23.1	224	188	22.3	234	200	23.0	240	211	23.3	
78	212	153	21.6	226	163	22.5	235	170	23.0	219	171	22.0	232	181	22.9	240	188	23.3	224	188	22.3	237	198	23.1	244	205	23.6	
105	70	207	151	22.3	215	172	22.8	219	191	23.1	214	169	22.8	221	190	23.3	226	208	23.6	218	186	23.1	226	207	23.6	230	225	23.9
110	75	207	151	22.3	218	167	23.1	225	182	23.5	214	169	22.8	224	185	23.5	230	200	23.9	218	186	23.1	228	202	23.7	234	217	24.1
115	75	197	23.7	207	171	24.5	214	193	25.0	203	165	24.2	212	189	24.9	219	211	25.4	207	181	24.5	216	206	25.2	222	25.6	—	—

48MA/50ME028

OUTDOOR AIR TEMP		TOTAL UNIT CFM																	
		8,000						10,000						12,000					
		Outdoor Air Cfm						Outdoor Air Cfm						Outdoor Air Cfm					

Performance data
Room Design 80 F/50% Rh

COOLING CAPACITIES

48MA/50ME030

OUTDOOR AIR TEMP		TOTAL UNIT CFM											
		8,000						10,000					
Outdoor Air Cfm													
Db	Wb	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw
85	65	319	218	31.0	329	231	31.6	332	241	31.8	332	246	31.9
	70	319	218	31.0	334	226	32.0	341	230	32.4	343	232	32.5
	65	312	215	32.1	321	233	32.7	325	249	33.0	326	256	33.0
	70	312	215	32.1	327	228	33.1	333	238	33.5	335	242	33.6
90	73	312	215	32.1	330	225	33.3	338	230	33.9	341	233	34.1
	75	312	215	32.1	332	222	33.5	342	225	34.1	346	227	34.4
	65	306	212	33.2	315	236	33.8	318	256	34.1	319	257	34.2
	70	306	212	33.2	319	231	34.2	325	245	34.6	327	252	34.7
95	75	306	212	33.2	325	225	34.6	334	233	35.2	338	237	35.5
	78	306	212	33.2	328	221	34.8	340	225	35.6	344	227	35.9
	80	306	212	33.2	331	218	35.0	344	219	35.9	349	220	36.3
	70	299	210	34.3	311	233	35.2	318	253	35.7	320	262	35.8
100	75	299	210	34.3	317	227	35.6	326	241	36.3	329	247	36.6
	78	299	210	34.3	320	223	35.9	332	233	36.7	336	237	37.0
	70	292	207	35.3	304	235	36.2	311	260	36.8	313	272	37.0
	75	292	207	35.3	309	229	36.6	318	248	37.3	321	257	37.6
110	78	266	201	35.6	305	228	37.9	316	248	38.8	319	258	39.1
	75	261	198	35.5	295	234	38.5	304	263	39.3	308	277	39.7
115	75	292	236	38.3	306	269	39.5	314	297	40.2	317	311	40.5

OUTDOOR AIR TEMP		TOTAL UNIT CFM											
		11,000						12,000					
Outdoor Air Cfm													
Db	Wb	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw
85	65	335	252	32.0	344	266	32.6	348	276	32.8	348	277	32.8
	70	335	252	32.0	349	260	32.9	355	265	33.3	357	267	33.4
	65	327	249	33.1	336	268	33.7	340	283	34.0	342	290	34.1
90	70	327	249	33.1	341	263	34.0	347	273	34.4	348	277	34.5
	73	327	249	33.1	344	259	34.2	351	265	34.7	354	268	34.9
	75	327	249	33.1	346	257	34.4	354	260	34.9	357	262	35.1
	65	320	247	34.2	329	270	34.9	334	290	35.2	335	299	35.3
	70	320	247	34.2	333	265	35.1	338	280	35.5	340	286	35.6
95	75	320	247	34.2	338	259	35.5	346	268	36.0	349	272	36.2
	78	320	247	34.2	341	255	35.7	350	260	36.4	354	262	36.6
	80	320	247	34.2	343	253	35.8	354	255	36.6	358	255	36.9
	70	313	244	35.3	325	267	36.2	331	287	36.6	333	296	36.8
100	75	313	244	35.3	329	261	36.5	337	275	37.1	340	282	37.3
	78	313	244	35.3	332	258	36.8	342	268	37.5	345	272	37.7
	70	306	241	36.4	317	270	37.3	323	294	37.8	306	295	38.0
	75	306	241	36.4	321	264	37.6	329	283	38.2	331	292	38.4
110	78	298	238	37.3	316	262	38.8	325	282	39.5	328	292	39.7
	75	292	236	38.3	306	269	39.5	314	297	40.2	317	311	40.5

Kw — Compressor Motor Power Input

SHC — Sensible Heat Capacity (1000 Btuh)

TC — Total Capacity (1000 Btuh)

NOTES: 1. No values are given where unit cannot maintain the assumed room design relative humidity since the moisture content of the air leaving the unit is higher than the assumed room moisture content.

2. Ratings are gross and do not include fan motor heat deduction.

Performance data
Room Design 80 F/50% Rh

COOLING CAPACITIES
48MA/50ME034

OUTDOOR		TOTAL UNIT CFM																								
AIR TEMP		10,000																								
		Outdoor Air Cfm																								
Db	Wb	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw				
85	65	343	247	30.1	352	260	30.5	356	271	30.9	358	281	30.8	349	259	30.4	357	272	30.8	361	283	31.0	363	292	31.1	
	70	343	247	30.1	357	255	30.8	365	260	31.2	370	264	31.4	349	259	30.4	362	267	31.0	369	272	31.4	374	276	31.6	
	65	336	244	31.2	344	262	31.6	352	282	32.1	355	297	32.2	341	256	31.5	349	274	31.0	357	294	32.3	360	309	32.5	
90	70	336	244	31.2	349	257	31.9	357	268	32.3	361	277	32.5	341	256	31.5	354	269	32.1	361	279	32.5	365	289	32.8	
	73	336	244	31.2	352	254	32.1	362	261	32.6	369	266	32.9	341	256	31.5	357	266	32.3	366	272	32.8	372	278	33.1	
	75	336	244	31.2	355	252	32.2	366	256	32.8	374	259	33.2	341	256	31.5	359	263	32.4	370	267	33.0	377	271	33.4	
	65	328	241	32.3	339	267	32.9	345	289	33.3	348	309	33.4	333	253	32.6	344	279	33.2	350	301	33.5	353	321	33.7	
95	70	328	241	32.3	341	259	33.0	348	275	33.4	352	290	33.7	333	253	32.6	345	271	33.3	352	287	33.7	356	301	33.9	
	75	328	241	32.3	346	254	33.3	357	263	33.9	365	272	34.4	343	333	253	32.6	350	265	33.6	360	275	34.1	368	283	34.6
	78	328	241	32.3	350	250	33.5	363	255	34.3	373	260	34.8	333	253	32.6	354	261	33.8	366	267	34.4	376	272	35.0	
	80	328	241	32.3	352	247	33.7	367	250	34.5	378	252	35.1	333	253	32.6	356	259	33.9	370	261	34.7	381	264	35.3	
100	70	320	238	33.5	332	261	34.2	342	286	34.8	348	305	35.1	325	250	33.7	336	273	34.4	347	298	35.0	352	317	35.4	
	75	320	238	33.5	337	256	34.5	348	270	35.1	355	284	35.5	325	250	33.7	341	267	34.7	351	282	35.3	358	296	35.7	
	78	320	238	33.5	341	252	34.7	353	263	35.4	363	273	36.0	325	250	33.7	345	263	34.9	356	274	35.6	365	284	36.2	
105	70	312	235	34.6	326	266	35.5	335	293	36.0	340	318	36.4	317	246	34.8	330	278	35.7	338	305	36.2	344	329	36.6	
	75	312	235	34.6	328	258	35.6	338	278	36.2	345	297	36.7	317	246	34.8	332	269	35.8	341	289	36.4	348	308	36.9	
110	78	304	232	35.6	323	256	36.9	334	777	37.7	343	298	38.3	308	243	35.9	326	268	37.1	337	289	37.9	345	309	38.4	
115	75	296	229	36.6	311	262	37.7	325	296	38.7	332	325	39.3	300	240	36.9	314	273	37.9	327	308	38.9	335	335	39.5	

OUTDOOR		TOTAL UNIT CFM																							
AIR TEMP		12,000																							
		Outdoor Air Cfm																							
Db	Wb	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw			
85	65	353	270	30.6	361	283	31.0	365	294	31.2	367	304	31.3	357	281	30.8	365	294	31.2	369	305	31.4	370	310	31.4
	70	353	270	30.6	366	278	31.2	373	283	31.6	378	287	31.8	357	281	30.8	370	289	31.4	377	294	31.7	379	296	31.9
	65	345	267	31.7	353	285	32.1	361	305	32.5	365	320	32.7	349	278	31.9	356	296	32.3	365	316	32.7	367	324	32.8
90	70	345	267	31.7	358	280	32.3	365	291	32.7	369	300	32.9	349	278	31.9	361	291	32.5	368	302	32.9	370	306	33.0
	73	345	267	31.7	361	277	32.5	370	283	33.0	376	289	33.3	349	278	31.9	364	287	32.7	373	295	33.1	376	298	33.3
	75	345	267	31.7	363	274	32.6	373	279	33.2	381	282	33.5	349	278	31.9	366	285	32.8	376	290	33.3	380	291	33.5
	65	337	264	32.8	348	290	33.4	354	312	33.8	357	332	33.9	340	275	33.0	352	301	33.6	357	323	34.0	359	333	34.1
95	70	337	264	32.8	349	282	33.5	355	298	33.9	359	312	34.1	340	275	33.0	352	293	33.7	358	309	34.0	360	316	34.1
	75	337	264	32.8	354	276	33.8	363	286	34.3	371	295	34.7	340	275	33.0	357	287	33.9	366	297	34.5	370	301	34.7
	78	337	264	32.8	357	272	34.0	369	278	34.6	378	283	35.1	340	275	33.0	360	283	34.1	371	289	34.7	376	292	35.0
	80	337	264	32.8	359	270	34.1	373	273	34.8	—	—	—	340	275	33.0	362	281	34.2	375	283	34.9	—	—	—
100	70	329	261	34.0	340	284	34.6	350	309	35.2	356	328	35.6	332	271	34.2	343	295	34.8	353	320	35.4	356	330	35.6
	75	329	261	34.0	345	278	34.9	354	293	35.5	361	307	35.9	332	271	34.2	347	289	35.1	356	304	35.6	360	311	35.8
	78	329	261	34.0	348	274	35.1	359	285	35.8	368	295	36.3	332	271	34.2	350	285	35.3	361	296	35.9	365	302	35.2
105	70	320	257	35.1	334	289	35.9	342	316	36.5	347	340	36.8	323	268	35.3	337	300	36.1	345	327	36.6	348	339	36.8
	75	320	257	35.1	335	280	36.0	344	300	36.6	350	319	37.0	323	268	35.3	338	291	36.2	346	311	36.7	350	321	37.0
110	78	312	254	36.1	329	278	37.3	339	300	38.0	—	—	—	315	265	36.4	332	289	37.5	341	311	38.2	—	—	—
115	75	304	251	37.2	317	284	38.1	330	319	39.1	337	337	39.6	306	262	37.4	319	295	38.3	332	333	39.3	336	39.5	

Performance data
Room Design 80 F/50% Rh

COOLING CAPACITIES

48MA/50ME040

OUTDOOR AIR TEMP		TOTAL UNIT CFM												11,000 Outdoor Air Cfm						12,000 Outdoor Air Cfm					
		11,000 Outdoor Air Cfm						12,000 Outdoor Air Cfm						0			1000			2000			3000		
		0			1000			2000			3000			TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw
Db	Wb	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw
85	65	378	256	37.1	417	292	39.5	434	314	40.8	440	327	41.3	381	263	37.4	421	300	39.7	438	324	41.0	445	338	41.5
	70	378	256	37.1	424	288	40.0	446	304	41.5	456	312	42.3	381	263	37.4	427	296	40.1	451	314	41.7	462	324	42.5
90	65	377	259	38.8	411	297	41.1	425	322	42.3	429	338	43.0	380	266	39.0	415	305	41.2	431	334	42.5	436	351	43.1
	70	377	259	38.8	419	293	41.6	436	312	43.0	444	323	43.8	380	266	39.0	422	302	41.7	442	323	43.2	450	336	44.0
95	65	377	259	38.8	425	292	42.0	445	306	43.5	454	313	44.4	380	266	39.0	429	302	42.1	449	319	43.7	460	326	44.6
	70	377	259	38.8	431	292	42.2	453	303	43.9	460	306	44.8	380	266	39.0	433	302	42.3	459	317	44.0	469	320	45.0
100	65	376	262	40.5	405	302	42.6	416	330	43.8	418	350	44.6	379	269	40.6	409	311	42.8	423	343	44.1	428	364	44.8
	70	376	262	40.5	413	298	43.1	427	319	44.5	431	335	45.3	379	269	40.6	417	308	43.3	433	332	44.7	438	348	45.5
105	70	376	262	40.5	421	295	43.8	438	308	45.5	444	316	46.5	379	269	40.6	425	305	44.0	444	322	45.7	452	330	46.7
	75	376	262	40.5	426	292	44.2	446	301	46.1	455	305	47.2	379	269	40.6	430	302	44.4	452	314	46.2	462	318	47.3
110	70	372	263	42.1	404	301	44.7	413	325	46.2	414	343	47.1	375	270	42.3	408	312	44.9	419	338	46.4	421	356	47.4
	75	372	263	42.1	412	297	45.4	423	313	47.1	429	326	48.1	375	270	42.3	416	309	45.6	429	327	47.4	435	339	48.3
115	70	368	263	43.7	395	304	46.3	399	331	47.9	399	352	48.9	371	272	43.9	399	316	46.4	406	344	48.1	406	364	49.2
	75	368	263	43.7	402	300	47.1	408	319	48.8	413	336	49.8	371	272	43.9	407	312	47.3	414	332	49.0	418	349	50.0
120	70	368	263	45.3	394	297	49.3	399	315	51.1	406	335	52.3	365	271	45.5	399	310	49.5	404	328	51.4	410	347	52.5
	75	354	261	46.9	377	301	50.5	376	327	52.4	377	351	53.9	358	270	47.1	384	314	50.7	384	340	52.7	384	363	54.1
OUTDOOR AIR TEMP		TOTAL UNIT CFM												13,000 Outdoor Air Cfm						14,000 Outdoor Air Cfm					
		13,000 Outdoor Air Cfm						14,000 Outdoor Air Cfm						0	1000	Kw	TC	SHC	Kw	0	1000	Kw	TC	SHC	Kw
		0			1000			2000			3000			TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw
Db	Wb	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw	TC	SHC	Kw
85	65	384	268	37.5	422	305	39.7	441	332	41.1	448	347	41.6	387	278	37.6	422	311	39.7	444	340	41.2	452	356	41.7
	70	384	268	37.5	431	304	40.3	454	323	41.8	465	333	42.6	387	278	37.6	435	310	40.5	457	331	41.9	468	342	42.7
90	65	382	271	39.0	417	312	41.3	434	342	42.7	440	360	43.3	383	275	39.0	418	320	41.3	437	351	42.8	444	370	43.4
	70	382	271	39.0	425	311	41.9	445	332	43.3	454	346	44.1	383	275	39.0	429	320	42.1	448	342	43.4	458	356	44.2
95	65	380	274	40.6	412	318	42.9	427	352	44.3	432	374	45.0	380	278	40.5	414	327	42.9	430	362	44.4	437	385	45.1
	70	380	274	40.6	420	317	43.5	436	342	44.8	443	359	45.7	380	278	40.5	423	326	43.7	440	352	45.0	448	370	45.8
100	70	380	274	40.6	428	313	44.1	448	332	45.8	457	342	46.7	380	278	40.5	431	321	44.2	451	343	45.9	461	354	46.9
	75	380	274	40.6	436	310	44.7	453	328	43.8	464	337	44.7	383	275	39.0	435	320	42.5	456	337	43.9	467	348	44.9
105	70	380	274	40.6	428	313	44.1	448	332	45.8	457	342	46.7	380	278	40.5	431	321	44.2	451	343	45.9	461	354	46.9
	75	380	274	40.6	433	311	44.5	455	325	46.3	466	330	47.4	380	278	40.5	437	320	44.7	458	335	46.4	470	342	47.5
110	70	375	274	40.6	437	309	44.7	461	319	46.7	472	322	47.9	380	278	40.5	440	318	44.8	465	331	47.0	476	334	48.0
	75	377	277	42.4	411	321	45.0	424	349	46.6	426	367	47.5	379	284	42.5	414	330	45.2	429	359	46.7	432	379	47.7
115	70	377	277	42.4	419	317	45.7	433	338	47.5	440	351	48.5	379	284	42.5	422	326	45.9	438	349	47.6	444	363	48.6
	75	377	277	42.4	427	316	46.3	441	331	47.9	449	340	49.1	379	284	42.5	429	325	46.4	446	342	48.1	454	352	49.2
120	70	375	280	44.2	402	324	46.6	412	356	48.3	412	376	49.4	378	289	44.4	405	333	46.7	418	367	48.3	418	387	49.6
	75	375	280	44.2	410	322	47.4	419	344	49.2	423	361	50.2	378	289	44.4	413	331	47.5	425	355	49.3	428	373	50.3
125	70	378	279	45.7	403	321	49.6	408	339	51.5	415	359	52.6	371	287	45.9	408	332	49.7	413	351	51.7	419	370	52.7
	75	360	278	47.2	389	325	50.9	389	352	52.8	390	374	54.3	363	286	47.4	394	337	51.0	394	363	52.9	396	385	54.5

Kw — Compressor Motor Power Input

SHC — Sensible Heat Capacity (1000 Btuuh)

TC — Total Capacity (1000 Btuuh)

NOTES: 1. No values are given where unit cannot maintain the assumed room design relative humidity since the moisture content of the air leaving the unit is higher than the assumed room moisture content.

2. Ratings are gross and do not include fan motor heat deduction.

Performance data

FAN PERFORMANCE

UNIT 48MA/ 50ME	CFM	EXTERNAL STATIC PRESSURE (in. wg)										
		Fan Rpm										
		0.2	0.4	0.6	0.8	1.0	1.2	1.4	1.6	1.8	2.0	2.2
	5,000	—	—	740	810	880	945	1005	1060	1100	1160	1215
	6,000	—	—	710	790	865	935	1000	1050	1100	1155	1215
016 and 024	7,000	—	—	700	780	845	920	975	1045	1100	1150	1205
	8,000	—	—	765	830	910	990	1040	1100	1200	1200	1260
	9,000	—	—	830	900	990	1050	1100	1150	1200	1260	—
	9,600	—	—	870	950	1020	1075	1130	1190	1240	1290	—
	7,000	—	—	830	900	990	1050	1100	1150	1200	1260	—
	8,000	—	—	870	950	1020	1075	1130	1190	1240	1290	—
	9,000	—	—	910	990	1060	1120	1170	1220	1270	1320	1380
	10,000	—	—	910	970	1030	1075	1125	1175	1220	1270	1320
	11,000	—	—	980	1040	1090	1145	1190	1235	1280	1320	1380
	12,000	—	—	1050	1105	1160	1200	1260	—	—	—	—
028 and 030	8,000	—	—	900	940	975	1010	1040	1070	1110	1155	1200
	9,000	—	—	900	930	960	1000	1030	1070	1105	1145	1200
	10,000	—	—	970	1000	1030	1070	1105	1145	1180	1210	1250
	11,000	—	—	1045	1080	1115	1150	1180	1220	1250	1320	1380
	12,000	—	—	1130	1160	1195	1230	1260	1295	1330	1360	1420
	13,000	—	—	1210	1250	1280	1325	1350	1380	1400	1430	1460
	14,000	—	—	1315	1345	1370	1400	1435	1460	1485	—	—
				17.1	18.1	18.8	19.5	20.3	21.0	21.8	—	—

NOTES:

1 *Italics* indicate higher than standard horsepower motor is required Units 016 and 024 are shown in the same table *Underlined italicized values* apply to 024 only Units 016 and 024 may use 10-hp 215T (NEMA frame size) motor A larger motor may not be installed in units 028 and 030 Optional 20-hp motor for units 034 and 040 has 256T frame Motor drives on units 024,

028 and 030 are interchangeable to permit fan operation above or below standard fan speeds

2 Maximum fan motor bhp is based on conditions of minimum voltage and 80 F air across motor

3 Fan performance has deductions for unit casing, wet coils, heaters and clean filters

INDOOR AIR FAN MOTOR DATA

UNIT 48MA/ 50ME	MOTOR MAX BHP	FAN SPEED (Rpm)					
		Std Motor		Opt Motor			
		Pulley A	Pulley B	Pulley A	Pulley B	Pulley A	Pulley B
016	5.75	*	880	995	—	—	—
024	8.60	*	995	1145	—	—	—
028	11.50	—	1095	1230	—	—	—
030	11.50	—	1095	1230	—	—	—
034	17.25	22.8	1095	1230	1320	1425	—
040	17.25	22.2	1095	1230	1320	1425	—

*Field Supplied

Performance data

FILTER RESISTANCE (in. wg)

TYPE FILTER	UNITS 50ME016, 024 AND 028			UNITS 50ME030, 034 AND 040		
	CFM			CFM		
	6000	8000	10,000	10,000	12,000	14,000
Standard	.025	.044	.069	.069	.099	150
Hi Efficiency	.024	.043	.069	.069	.099	150
Roll Filter	120	220	.020	110	.015	280

ELECTRIC HEATER PERFORMANCE

UNIT 50ME	HEAT-TO- COOL RATIO	TOTAL HEATER KW	STEPS OF HEAT PER MODULE	KW/STEP PER MODULE
016	75:1	53	2	3 3
&	1:1	70	2	4 4
024	1 5 1	106	3	4 4
028	75 1	66	2	3 3
&	1:1	88	2	4 4
030	1 5 1	132	3	4 4
034	75 1	79	2	3 3
&	1:1	106	2	4 4
040	1 5 1	158	3	4 4

GAS HEATING CAPACITIES (1000 Btuh)

→ UNIT 48MA	INPUT		BONNET CAPACITY		
	Total	Each Zone Module	Total	Each Zone Module	Full
016	432		324		
024	432		324		
028	540		405		
030	540	54	405		40 5
034	648		486		
040	648		486		

NOTES:

- 1 Ratings are approved for altitudes to 2000 feet. At altitudes over 2000 ft, ratings are 4% less for each 1000 ft above sea level
- 2 At altitudes up to 2000 ft, the following formula may be used to calculate air temperature rise

$$\Delta t = \frac{\text{bonnet capacity}}{1 09 \times \text{air quantity}}$$
- 3 At altitudes above 2000 ft, the following formula may be used

$$\Delta t = \frac{\text{bonnet capacity}}{(24 \times \text{specific weight of air} \times 60) (\text{air quantity})}$$
- 4 Maximum allowable gas pressure is 10 5 in wg
 Minimum allowable gas pressure for full rated input is 5 0 in wg
- 5 Unit design is AGA certified



Electrical data

ELECTRICAL DATA, 48MA

UNIT MODEL	V/PH/HZ	VOLTAGE RANGE		COMPRESSOR NO. 1			COMPRESSOR NO. 2			OUTDOOR FAN MOTOR			COMBUST FAN MOTOR	INDOOR FAN MOTOR		POWER SUPPLY		
				Min	Max	RLA	LRA	CB MTA	RLA	LRA	CB MTA	No. 1	No. 2	No. 3	FLA	Hp	FLA	Min Ckt Amps
		200/3/60	180	229	63.6	266	89.0*	—	—	—	—	6.2	6.6	—	5.0	16.2	109.6	125
48MA016	230/3/60	207	264	57.2	266	80.0*	—	—	—	—	—	6.2	6.0	—	5.0	13.2	99.5	110
	460/3/60	414	528	28.6	120	40.0	—	—	—	—	—	6.2	3.0	—	5.0	6.6	49.8	60
	575/3/60	518	660	22.8	96	32.0	—	—	—	—	—	6.2	2.4	—	5.0	5.6	39.8	45
	200/3/60	180	229	44.4	170	63.0	44.4	170	62.0	62.0	6.2	6.6	—	7.5	24.0	137.5	150	
48MA024	230/3/60	207	264	40.0	170	56.0	40.0	170	56.0	56.0	6.2	6.0	—	7.5	22.0	124.8	150	
	460/3/60	414	528	19.9	77	27.8	19.9	77	27.8	27.8	6.2	3.0	—	7.5	11.0	62.2	70	
	575/3/60	518	660	15.7	62	22.0	15.7	62	22.0	22.0	6.2	2.4	—	7.5	9.0	49.4	60	
	200/3/60	180	229	63.6	266	89.0	44.4	170	62.0	62.0	6.2	6.6	—	10.0	29.0	168.1	200	
48MA028	230/3/60	207	264	57.2	266	80.0	40.0	170	56.0	56.0	6.2	6.0	—	10.0	25.0	152.3	175	
	460/3/60	414	528	28.6	120	40.0	19.9	77	27.8	27.8	6.2	3.0	—	10.0	12.5	76.1	90	
	575/3/60	518	660	22.8	96	32.0	15.7	62	22.0	22.0	6.2	2.4	—	10.0	9.5	60.4	70	
	200/3/60	180	229	63.6	266	89.0	63.6	266	89.0	89.0	6.2	6.6	—	10.0	29.0	187.3	200	
48MA030	230/3/60	207	264	57.2	266	80.0	57.2	266	80.0	80.0	6.2	6.0	—	10.0	25.0	169.5	200	
	460/3/60	414	528	28.6	120	41.0	28.6	120	41.0	41.0	6.2	3.0	—	10.0	12.5	84.2	100	
	575/3/60	518	660	22.8	96	33.0	22.8	96	33.0	33.0	6.2	2.4	—	10.0	9.5	67.5	90	
	200/3/60	180	229	63.6	266	89.0	63.6	266	89.0	89.0	6.2	6.6	—	18	15.0	46.2	210.8	225
48MA034	230/3/60	207	264	57.2	266	80.0	57.2	266	80.0	80.0	6.2	6.0	6.0	—	20.0	61.0	224.6	250
	460/3/60	414	528	28.6	120	40.0	28.6	120	40.0	40.0	6.2	3.0	3.0	—	15.0	46.2	188.9	200
	575/3/60	518	660	22.8	96	32.0	22.8	96	32.0	32.0	6.2	2.4	2.4	—	20.0	59.4	200.9	250
	200/3/60	180	229	80.0	332	112.0	80.0	332	112.0	112.0	6.2	6.6	6.6	—	15.0	21.0	94.5	100
48MA040	230/3/60	207	264	77.0	300	106.0	77.0	300	106.0	106.0	6.2	6.0	6.0	—	20.0	26.6	100.5	125
	460/3/60	414	528	37.3	150	54.0	38.5	150	54.0	54.0	6.2	3.0	3.0	—	15.0	15.4	75.6	90
	575/3/60	518	660	31.4	120	44.0	31.4	120	44.5	44.5	6.2	2.4	2.4	—	20.0	20.0	80.6	100
	200/3/60	180	229	80.0	332	112.0	80.0	332	112.0	112.0	6.2	6.6	6.6	—	15.0	46.2	247.7	300
48MA040	230/3/60	207	264	77.0	300	106.0	77.0	300	106.0	106.0	6.2	6.0	6.0	—	20.0	61.0	261.5	300
	460/3/60	414	528	37.3	150	54.0	38.5	150	54.0	54.0	6.2	3.0	3.0	—	15.0	46.2	233.5	300
	575/3/60	518	660	31.4	120	44.0	31.4	120	44.5	44.5	6.2	2.4	2.4	—	20.0	59.4	245.5	300
	200/3/60	180	229	80.0	332	112.0	80.0	332	112.0	112.0	6.2	6.6	6.6	—	15.0	21.0	116.7	150
48MA040	230/3/60	207	264	77.0	300	106.0	77.0	300	106.0	106.0	6.2	6.0	6.0	—	20.0	26.6	122.7	150
	460/3/60	414	528	37.3	150	54.0	38.5	150	54.0	54.0	6.2	3.0	3.0	—	15.0	15.4	95.0	125
	575/3/60	518	660	31.4	120	44.0	31.4	120	44.5	44.5	6.2	2.4	2.4	—	20.0	20.0	100.0	125

CB MTA — Circuit Breaker Must Trip Amps
FLA — Full Load Amps
LRA — Locked Rotor Amps
RLA — Rated Load Amps

*Unit has 2 mechanically interlocked circuit breakers Values are for each.

NOTES:

1 Combustion air fan — 115 volts

2 Outdoor fan motor is a 200/230-1-60 motor on all units



ELECTRICAL DATA, 50ME

UNIT MODEL	V/PH/HZ	VOLTAGE RANGE		COMPRESSOR NO. 1			COMPRESSOR NO. 2			OUTDOOR FAN MOTOR FLA			INDOOR FAN MOTOR		POWER SUPPLY			
				Min	Max	RLA	LRA	CB MTA	RLA	LRA	CB MTA	No. 1	No. 2	No. 3	Hp	FLA	Min Ckt Amps	Max Fuse Amps
50ME016	200/3/60	180	229	63 6	266	89 0*	—	—	—	—	—	6 2	6 6	—	5 0	16 2	109 8	125
	230/3/60	207	264	57 2	266	80 0*	—	—	—	—	—	6 2	6 0	—	5 0	13 2	98 9	110
	460/3/60	414	528	28 6	120	40 0	—	—	—	—	—	6 2	3 0	—	5 0	6 6	49 5	60
	575/3/60	518	660	22.8	96	32.0	—	—	—	—	—	6.2	2.4	—	5.0	5.6	39.6	45
50ME024	200/3/60	180	229	44 4	170	63 0*	44.4	170	62 0	6 2	6 6	—	—	7 5	24 0	138 0	150	
	230/3/60	207	264	40 0	170	56 0	40 0	170	56 0	6 2	6 0	—	—	7 5	22 0	124 2	150	
	460/3/60	414	528	19 9	77	27.8	19 9	77	27 8	6 2	3 0	—	—	7 5	11 0	61 9	70	
	575/3/60	518	660	15.7	62	22.0	15.7	62	22.0	6.2	2.4	—	—	7.5	9.0	49.2	60	
50ME028	200/3/60	180	229	63 6	266	89 0	44 4	170	62 0	6 2	6 6	—	—	10.0	29 5	168 9	200	
	230/3/60	207	264	57 2	266	80 0	40 0	170	56 0	6 2	6 0	—	—	10 0	26 0	151 7	175	
	460/3/60	414	528	28 6	120	40 0	19 9	77	27 8	6 2	3 0	—	—	10 0	13 0	75 8	90	
	575/3/60	518	660	22.0	96	32 0	15 7	62	22 0	6 2	2 4	—	—	10 0	10.5	60 2	70	
50ME030	200/3/60	180	229	63 6	266	89 0	63 6	266	89 0	6 2	6 6	—	—	10 0	29 6	188 0	200	
	230/3/60	207	264	57 2	266	80 0	57 2	266	80 0	6 2	6 0	—	—	10 0	26 0	168 9	200	
	460/3/60	414	528	28 6	120	41 0	28 6	120	41 0	6 2	3 0	—	—	10 0	13 0	84 5	100	
	575/3/60	518	660	22 8	96	33 0	22 8	228	33 0	6 2	2 4	—	—	10 0	10.5	67 3	90	
50ME034	200/3/60	180	229	63 6	266	89 0	63 6	266	89 0	6 2	6 6	6 6	6 6	15 0	46 2	210 8	225	
	230/3/60	207	264	57 2	266	80 0	57 2	266	80 0	6 2	6 0	6 0	6 0	15 0	46 2	188 9	200	
	460/3/60	414	528	28 6	120	40 0	28 6	120	40 0	6 2	3 0	3 0	3 0	15 0	21 0	94 5	100	
	575/3/60	518	660	22 8	96	32 0	22 8	96	32 0	6 2	2 4	2 4	2 4	15 0	16 0	75.6	90	
50ME040	200/3/60	180	229	80 0	332	112 0	80.0	332	112 0	6 2	6 6	6 6	6 6	15 0	46 2	247 7	300	
	230/3/60	207	264	77 0	300	106 0	77 0	300	106 0	6 2	6 0	6 6	6 6	15 0	46 2	233 5	300	
	460/3/60	414	582	39 3	150	54 0	39 3	150	54 0	6 2	3 0	3 0	3 0	15 0	21 0	116 7	150	
	575/3/60	518	660	31 4	120	44 0	31 4	120	44 0	6 2	2 4	2 4	2 4	15 0	16 0	95 0	125	

CB MTA — Circuit Breaker Must Trip Amps
FLA — Full Load Amps
LRA — Locked Rotor Amps
RLA — Rated Load Amps

*Unit has 2 mechanically interlocked circuit breakers Values are for each
 NOTE Outdoor air fan motor is a 200/230-1-60 motor on all units

Electrical data (cont)

ELECTRIC RESISTANCE HEATER DATA

UNIT 50ME	VOLTS (3-Ph 60-Hz)	ELEC HEAT KW (Unit Total)	HEATING ELEMENTS PER ZONE MODULE	FULL LOAD AMPS PER HEATING ELEMENT	CB MTA EACH ZONE MODULE	MAX FUSE AMPS EACH CIRCUIT	MIN WIRE AMPS EACH CIRCUIT
016 and 024	200	53	2	16.5	52	200	190.5
	230	53		14.4	52	175	165.6
	460	53		7.2	45	90	82.9
	200	70	2	22.0	52	300	254.0
	230	70		19.2	52	225	220.9
	460	70		9.6	45	125	110.5
	200	106	3	22.0	52	200	190.5
	230	106		19.2	52	175	165.8
	460	106		9.6	45	175	165.8
	575	106		7.7	45	150	132.5
028 and 030	200	66	2	16.5	52	250	238.1
	230	66		14.4	52	225	207.1
	460	66		7.2	45	110	102.8
	200	88	2	22.0	52	350	317.3
	230	88		19.2	52	300	276.1
	460	88		9.6	45	150	138.0
	200	132	3	22.0	52	250	238.3
	230	132		19.2	52	225	207.1
	460	132		9.6	45	225	207.1
	575	132		7.7	45	175	165.6
034 and 040	200	79	2	16.5	52	300	285.9
	230	79		14.4	52	250	248.5
	460	79		7.2	45	125	124.3
	200	106	2	22.0	52	200	190.5
	230	106		19.2	52	175	165.1
	460	106		9.6	45	175	165.6
	200	158	3	22.0	52	300	285.9
	230	158		19.2	52	250	248.5
	460	158		9.6	45	250	248.5
	575	158		7.7	45	200	198.8

CB MTA — Circuit Breaker Must Trip Amps


NOTE: Terminal boards provided for heater power wire connections
are suitable for use with copper or aluminum wire.

POWER WIRING DATA

UNIT	VOLTS (Nom)	KW (Unit Total)	MINIMUM CKT AMP					UNIT	VOLTS (Nom)	KW (Unit Total)	MINIMUM CKT AMP					
			Cooling		Heating Circuit	Common					Cooling		Heating Circuit	Common		
50ME016	200	53	109.8	190.5	—	206.7		15 Hp IFM	200	79	210.8	285.9	—	353.8		
	230	53	98.9	165.6	—	181.7			230	79	188.9	248.5	—	313.2		
	460	53	49.5	82.9	—	90.9			460	79	94.5	124.3	—	156.7		
	200	70	109.8	254.0	—	270.2			200	79	224.6	285.9	—	367.6		
	230	70	98.9	220.9	—	234.1			230	79	200.9	248.5	—	325.2		
	460	70	49.5	110.5	—	117.1			460	79	100.5	124.3	—	162.7		
	200	106	109.8	190.5	190.5	397.2		15 Hp IFM	200	106	210.8	190.5	190.5	427.0		
	230	106	98.9	165.8	165.8	344.8			230	106	188.9	165.1	165.1	369.8		
	460	106	49.5	165.8	—	172.4			460	106	94.5	165.6	—	185.4		
	575	106	39.6	132.5	—	138.1			50ME034	200	106	224.6	190.5	190.5	442.0	
	200	53	138.0	190.5	—	233.3			230	106	200.9	165.1	165.1	383.2		
50ME024	230	53	124.2	165.6	—	207.0			460	106	100.5	165.6	—	192.2		
	460	53	61.9	82.9	—	103.4		20 Hp IFM	200	158	210.9	285.9	285.9	617.8		
	200	70	138.0	254.0	—	278.0			230	158	188.9	248.5	248.5	536.6		
	230	70	124.2	220.9	—	242.9			460	158	94.5	248.5	—	268.3		
	460	70	61.9	110.5	—	121.5			575	158	75.6	198.8	—	214.8		
	200	106	138.0	190.5	190.5	405.0		20 Hp IFM	200	158	224.6	285.9	285.9	632.8		
	230	106	124.2	165.8	165.8	353.6			230	158	200.9	248.5	248.5	550.0		
	460	106	61.9	165.8	—	176.8			460	158	100.5	248.5	—	275.1		
	575	106	49.2	132.5	—	141.5			575	158	80.6	198.8	—	220.1		
	200	66	168.9	238.1	—	288.0		15 Hp IFM	200	79	247.7	285.9	—	390.7		
50ME028	230	66	151.7	207.1	—	255.2			230	79	233.5	248.5	—	357.8		
	460	66	75.8	102.8	—	127.2			460	79	116.7	124.3	—	178.9		
	200	88	168.9	317.3	—	346.8		20 Hp IFM	200	79	261.5	285.9	—	404.5		
	230	88	151.7	276.1	—	302.1			230	79	245.5	248.5	—	369.8		
	460	88	75.8	138.0	—	151.0			460	79	122.7	124.3	—	184.9		
	200	132	168.9	238.3	238.3	506.1		15 Hp IFM	200	106	247.7	190.5	190.5	438.2		
	230	132	151.7	207.1	207.1	440.2			230	106	233.5	165.1	165.1	398.6		
	460	132	75.8	207.1	—	220.1			460	106	116.7	165.6	—	199.5		
	575	132	60.2	165.6	—	176.1		20 Hp IFM	200	106	261.5	190.5	190.5	452.0		
	200	66	188.0	238.1	—	307.1			230	106	245.5	165.1	165.1	410.3		
50ME030	230	66	168.9	207.1	—	272.5			460	106	122.7	165.6	—	205.5		
	460	66	84.5	102.8	—	135.9		15 Hp IFM	200	158	247.7	285.9	285.9	628.9		
	200	88	188.0	317.1	—	346.6			230	158	233.7	248.5	248.5	565.0		
	230	88	168.9	276.1	—	307.0			460	158	116.7	248.5	—	282.4		
	460	88	84.5	138.0	—	153.5			575	158	95.0	198.8	—	227.5		
	200	132	188.0	238.3	238.3	506.1		20 Hp IFM	200	158	261.5	285.9	285.9	642.7		
	230	132	168.9	207.1	207.1	445.0			230	158	245.5	248.5	248.5	576.8		
	460	132	84.5	207.1	—	222.6			460	158	122.7	248.5	—	288.4		
	575	132	67.3	165.6	—	177.7			575	158	100.0	198.8	—	232.5		

IFM — Indoor Air Fan Motor

General information

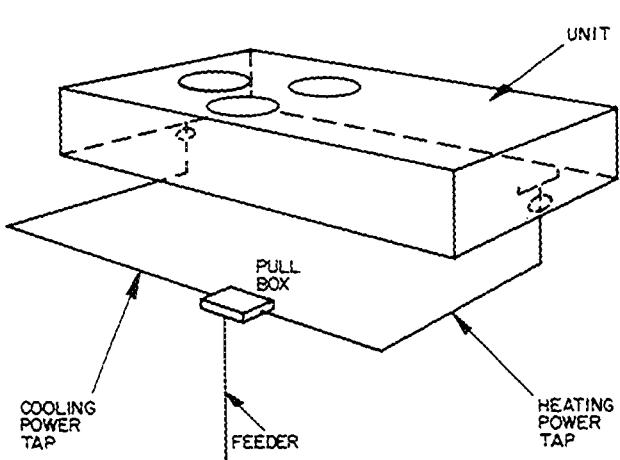

Where a single feeder is to be used, the cooling power tap may be sized according to the Cooling Minimum Wire Amps shown in the Power Wiring Data table provided the tap is 10 ft or less in length and enclosed in a raceway.

Similarly, the heating power tap may be sized according to the Heating Minimum Wire Amps shown in the table provided the tap is 25 ft or less in length and enclosed in a raceway.

If reheat is necessary for humidity control in all or part of the modules, use caution in sizing common feeder as heating and cooling can occur simultaneously in each reheat module.

For 200/230-volt units, line protection is internal to the unit. For 460/575-volt units, overcurrent protection must be provided in each power tap per NEC.

Electrical data (cont)

Operating sequence

When unit power is on and no zone thermostat is calling for cooling or heating, the indoor air fan and crankcase heaters are on. The outdoor air dampers are at the preset position, the burner pilots are lit and the forced-draft fan is on.

Cooling — On call for cooling from a zone, compressor no. 1 with 2 unloaders starts; a liquid line solenoid for that zone evaporator coil(s) opens and outdoor air fan motor no. 1 starts. Compressor will load or unload in response to suction pressure as required. If additional cooling is required (i.e. more zones call for cooling), compressor no. 2 (no unloaders) will be energized and cycle as required.

If the heat load is not sufficient to maintain operation of compressor no. 1 in an unloaded condition, the hot gas bypass valve will meter hot gas to the outdoor air evaporator coil to supply additional load. The Motormaster® head pressure control will vary speed of outdoor air fan motor no. 1 to regulate the airflow across the condenser coil.

As required, outdoor air fan no. 2 (and no. 3 on 034 and 040) will cycle on and off in response to head pressure via a fan cycling switch.

→ **Gas heating** — On call for heating from a zone, the gas valve is energized. The heat exchanger for that zone will be at full-rate firing. Reheat humidity control can be achieved by wiring a humidistat in parallel with the cooling thermostat. If zone temperature drops below setting of heating thermostat because humidistat is closed, heating mode will be energized to maintain zone space temperature.

Electric heating — On call for heating from a zone, the first-stage heating relay activates the first-stage contactor which energizes the first-stage heating element. On call for additional heating, the second stage of the thermostat activates the second-stage relay, contactor and heating element. If unit has 3-stage heat, the third (last) stage of heat can be energized only if the outdoor air temperature is below the outdoor air thermostat setting (adjustable). If the outdoor air temperature is above the outdoor air thermostat setting, the last stage of heat is locked out on all zone modules. The heating elements are connected so that the load on the 3-phase power supply is always nearly balanced.

Electric heat lockout — If any zone module is operating on mechanical cooling (compressor is operating as described previously) one heating element in each zone module is locked out and cannot be energized.

Hot water/glycol heating — On call for heat from a zone thermostat, the heating relay and heating coil solenoid valve for that zone are energized. If 2 or more zone modules are joined to serve a common zone, stage 2 of the heating thermostat may be used to provide staged heating capacity control.

Reheat humidity control can be achieved by wiring a humidistat in parallel with the cooling thermostat. If the zone temperature drops below setting of heating thermostat because humidistat is closed, heating mode will be energized to maintain zone space temperature.

Modulating outdoor air control (economizer) — When outdoor air temperature drops to outdoor thermostat setting (55 F adjustable), the compressors are locked out. When a zone calls for cooling, the mixed air thermostat (58 F adjustable) modulates the outdoor air dampers to permit cooling with outdoor air.

Exhaust air dampers — When unit is in economizer mode, the exhaust relay energizes the outdoor air fans at full speed. As the outdoor air dampers open and the return air dampers close in response to the mixed air thermostat, the exhaust air dampers open to permit power exhaust of returning indoor air.

Roll filter — As filter media becomes clogged, an air pressure switch activates a drive motor to automatically advance clean filter media into the return airstream. A filter light can be used to indicate that filter media roll has been expended.

Remote control panel — This central station control will operate the unit or override zone thermostat settings to lock out heating or cooling. Panel has a DAY/NIGHT switch and a damper position knob for in-space central control of these functions, and a FILTER light to indicate reduced airflow and need for clean filters.

Application data

Refrigeration system

Psychrometrics — The 48MA/50ME units differ psychrometrically from the conventional multizones due to the operation of the outdoor air coil. The coil in the Carrier units cools and dehumidifies the outdoor air entering the unit thus assuring that raw outdoor air is not passed along to the zones. This air treatment by the outdoor air coil (and also by the zone module evaporator coils) provides excellent low load performance and precise temperature control to the conditioned space. The only large load variation occurs on the outdoor air coil where a thermal expansion valve is used. This allows the use of simple capillary tube expansion devices on the zone coils. The zone coils cool and dehumidify a mixture of return air and outdoor air — outdoor air at the approximate dew point temperature of the return air.

The Psychrometric Chart illustrates this air treatment for a typical set of conditions. As an example: 1000 cfm of outdoor air at 95 F/75 F having 99 grains moisture content enters the outdoor air coil and is cooled and treated so that the air leaving the coil has 68 grains of moisture content. The outdoor air coil under these conditions has a capacity of 60,000 Btuh of which 39,000 Btuh is sensible. This is a coil sensible heat factor of 0.65. By examining the room conditions, it is evident that the outdoor air coil is very effective in removing the latent load. At 75 F/50%, the room content is 64 grains of moisture. The percent moisture removed with respect to room conditions is:

$$\% \text{ removed} = \frac{99 - 68}{99 - 64} \times 100 = \frac{31}{35} = 88.5\%$$

PSYCHROMETRIC CHART — EXAMPLE

NORMAL TEMPERATURES

Example:

48MA,50ME028
1000 cfm OA @ 95/75

9000 cfm supply
75/50% room design

RSHC — Room Sensible Heat Capacity
RSHF — Room Sensible Heat Factor
RTC — Room Total Capacity

The 1000 cfm of outdoor air at 68 grains is mixed with 8000 cfm of return air at 75 F/50% room conditions (64 grains). This mixture then enters the zone modules and is cooled and dehumidified by the zone coil.


Heating

Gas heating system — In special applications where natural gas supply is limited, modify units to operate under derated input/output conditions. Derate the modular multi-zone by changing the zone module burner spuds as follows:

TOTAL MODULE DERATED INPUT (%) HIGH FIRE	SPUD SIZE
100	No 38
90	No 41
80	No 43

Contact Carrier Service Department before derating to the above limits.

Hot water/glycol heating system — Multizone hot water/glycol heating systems are ideal for renovation of existing buildings where a hot water heating plant is usually available. Each zone module has its own high-capacity

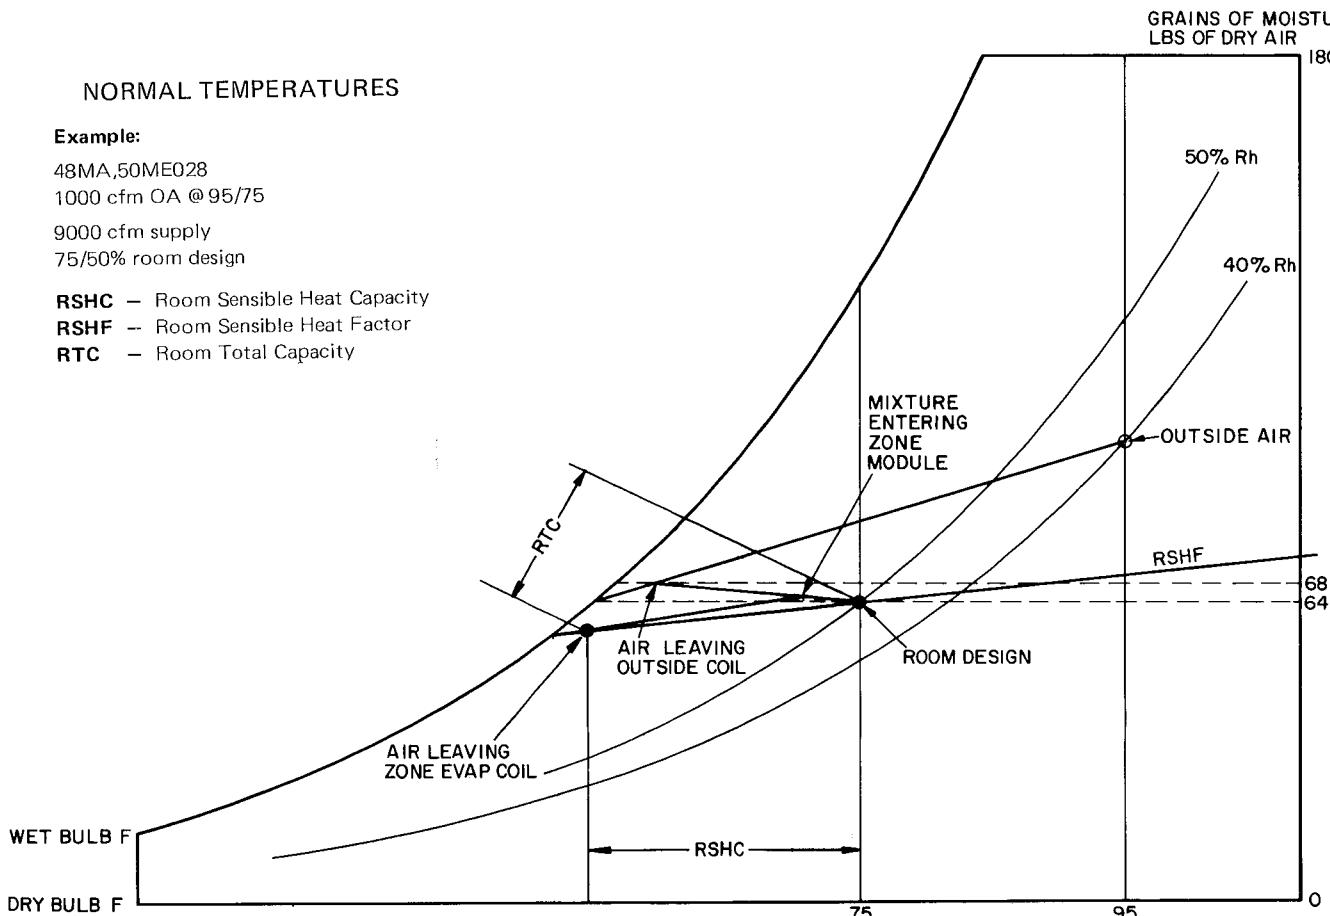

Application data (cont)

heating coil. One connection is required for supply and return hot water/glycol. Connect external piping to the unit in accordance with existing codes. Include proper relief for water flow (the maximum allowable hot water/glycol system working pressure is 30 psi) or a modulating control to compensate for decrease in water flow rate to zone coils under partial load conditions when some coils are cycled closed. System heater coils operate with a water/glycol solution of 20% minimum glycol for proper freeze-up protection. Select and rate hot water/glycol using Hot Water/Glycol Heating Capacities graphs.

Do not install hot water/glycol on a steam system. Where steam is the only heating medium available, use a steam-to-water converter or a steam-to-water interchanger.

Field-fabricated ductwork

To simplify supply air connection, field fabricate and install a zone duct plenum. Duct plenum may be installed prior to unit positioning if desired. Zone supply air duct openings on base unit are fitted with a tab slot connection similar to those on plenum except for end partitions which are

hemmed. This hem is positioned so that the 1-in. flange at the entering end of the field-fabricated plenum will force-fit between it and adjacent unit frame member.

Use standard flexible duct connections between duct plenum and duct system. Follow applicable codes.


Insulate supply air ducts passing thru unconditioned spaces and cover with vapor barrier. Separate parallel duct runs of longer than 5 ft by insulation to prevent heat transfer between zone ducts.

Return air duct connection consists of 4 sheet metal flanges.


Balancing dampers — Provide suitable balancing dampers in each zone duct run. Normally, a 2-bladed damper is preferred to a single blade. Adjust the balancing dampers to give the desired airflow and static pressures in each module. Ready access to balancing dampers is necessary in a multizone system.

Low cfm, long run zones — If possible, avoid small zones with long runs. As the cfm decreases at a given duct


HOT WATER/GLYCOL HEATING CAPACITIES
(Hot Water with 20% Ethylene Glycol Solution)

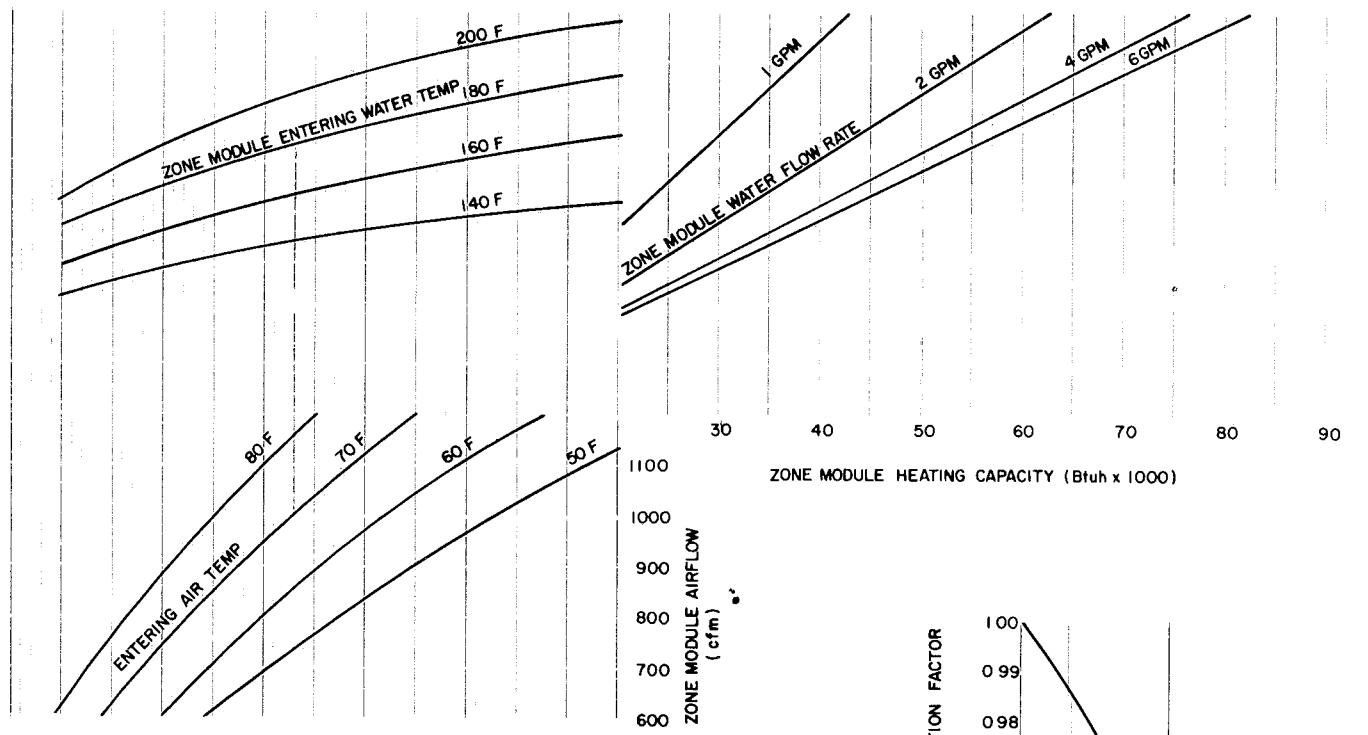

- Determine zone module air quantity as described in the Selection Procedure (1000 cfm)
- Enter curve at determined zone module air quantity. Project left to intersect with entering air temperature curve (70 F)
- From this intersection, project up to intersect with entering water temperature (180 F)
- From this intersection, project right to intersect with Water Flow Rate (4 gpm).
- From this intersection, project down to read Zone Module Heating Capacity (49,500 Btuh)
- When using solution mixtures above 20% glycol concentration, reduce the capacity using the correction factor
i.e. If 30% glycol concentration applies to the example,
Corrected Zone Module Heating Capacity
= Zone Module Heating Capacity x Correction Factor
= $49,500 \times 0.985$
= 48,750 Btuh
- See Module Pressure Drop graph. The Δp at 4 gpm is 8.2 psig.




MODULE PRESSURE DROP

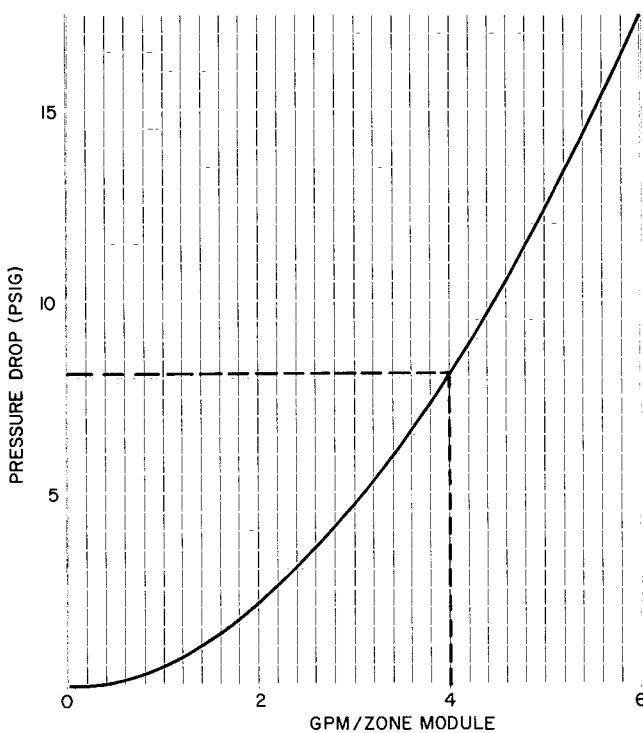

NOTE: Greatest module pressure drop represents entire coil pressure drop.

FIELD-FABRICATED ZONE DUCT PLENUM DETAIL

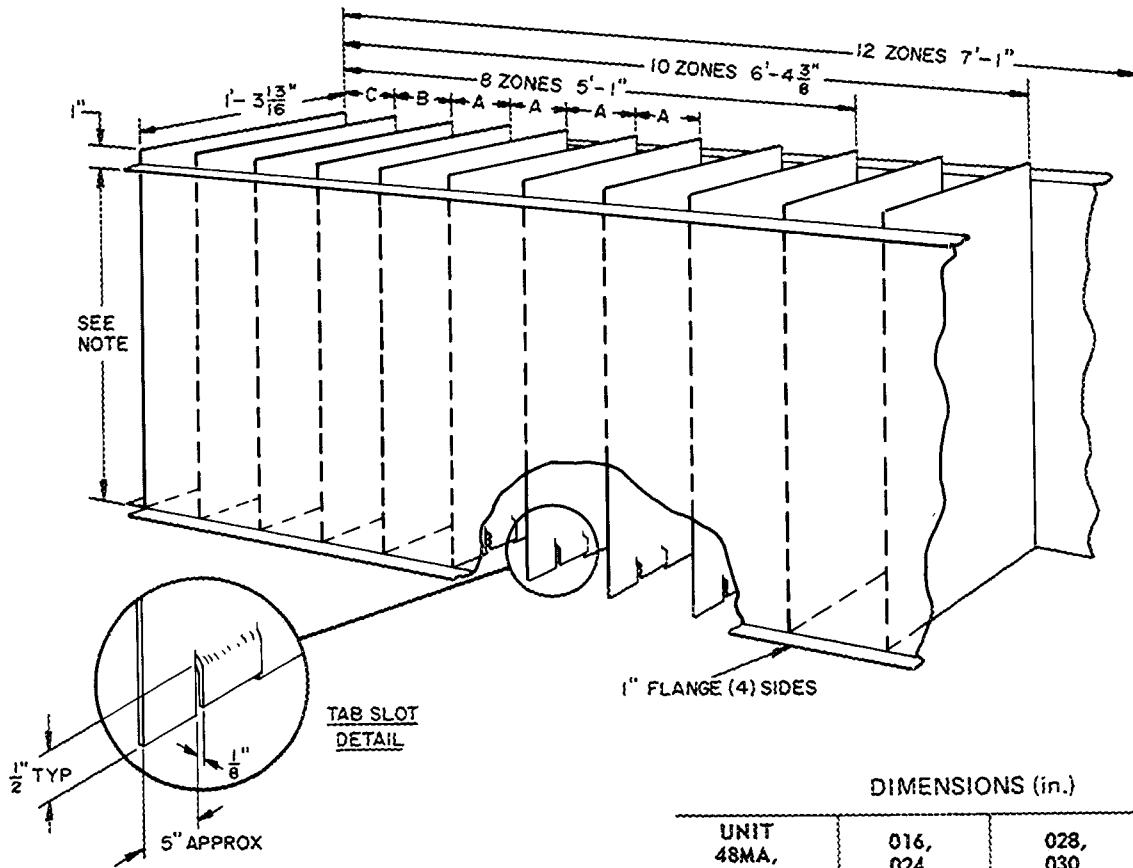

NOTE: Dimension to suit job requirements.

velocity, the friction loss per 100 ft increases significantly. Also, seam and joint leakage in a small duct of long length can prevent delivery of required cfm at the outlet grille. If long runs with low cfm are inevitable, oversize the ducts to give lower velocities, lower friction rates and reduced leakage rates.

Diversity

The size, shape and orientation of the building, as well as the application and location of zones, influence the degree of diversity applied to a multizone system.

Since the normal application of multizone units involves zones where loads are shifting due to solar energy, people, equipment and lights, diversity will exist.

The Carrier modular multizones will be affected by building diversity only on refrigeration system operation. When a particular zone (or zones) thermostats are satisfied, a solenoid shuts off the zone evaporator coil. This enables more refrigerant to flow to other operating zone coils, creating a larger capacity for that zone. However, the diversity will lower the selected unit total capacities.

The 48MA/50ME ratings do not reflect diversity but can be converted to diversity ratings by using the capacity

Application data (cont)

correction factors and formulas in the Capacity Correction Factor table.

CAPACITY CORRECTION FACTOR (CCF)

LOAD	DIVERSITY FACTOR		
TC (Unit)	1.0	90	80
SHC (Unit)	1.0	97	94
RTC (with diversity)	=	[TC (CCF) - OATH] Diversity Factor	
RSHC (with diversity)	=	[SHC (CCF) - OASH] Diversity Factor	

This is accomplished by rating the unit assuming that no more than 9 or 10 zones would be on at one time, 90% diversity. The same logic applies to other diversity factors on an average basis, such as 85 or 95%.

A rating with a diversity factor results in a lower room SHF, therefore, a reselection at a higher total unit cfm is advisable to take full advantage of the building diversity.

Limitations

Module cfm limits and fan performance — The cfm limits per zone are 1200 cfm maximum and 600 cfm minimum. The outboard zones in the 8-, 10- and 12-module units are limited to a maximum of 1000 cfm. The limitations are necessary to prevent blow-off to the heat exchangers and into the ductwork. The minimum limit prevents burner cycling on limit switches and prevents electric heater cycling. At reduced cfm's, zone evaporator coils overfeed refrigerant, but there is no liquid flood-back to the compressor as it is protected by a suction line accumulator.

For applications below 600 cfm, modify heating controls as follows:

Gas fired (300 to 599 cfm) — Derate burners as shown on page 33.

Electric Resistance (450 to 599 cfm) — Use first- and second-stage heat on 3-stage units.

Electric Resistance (300 to 449 cfm) — Use first-stage heat on 2- or 3-stage heat units.

Design the duct system so that differences between adjacent zones is kept to a minimum. This reduces internal air leakage between zones in the evaporator section.

Optimum performance is delivered in the 800 to 1000 cfm range. Extremely low cfm requirements reduce unit cooling capacity. For low zone cfm applications, size the zone for a higher cfm (to increase unit efficiency) and divert the extra air into the return air system or a larger interior space. Do not divert extra air into spaces with different perimeter wall orientations.

Fan performance data are based on 15% outdoor air. When the outdoor air dampers are closed and there is no outdoor ventilation air into the unit, unit cfm is reduced by 2% to 6%. This reduction is due to the static pressure drops existing in the separate airflows thru the unit. This reduction is significant in special applications where little or no ventilation is required and cfm requirements are critically designed.

Maximum ventilation limits — Under normal mechanical cooling, the amount of ventilation air that can be introduced

is a function of the outdoor air damper setting and negative static pressure at the return air intake of the unit. The Ventilation Air Charts show ventilation air versus negative static pressure at various settings of the outdoor air damper. A 5.5 setting of the ventilation control dial is the maximum opening of the dampers. The ventilation dial can be set in any position from 0 to 5.5 to obtain the desired cfm of outdoor air. The ventilation dial is located on the control panel adjacent to the heating section. NOTE: Outdoor air at other unit cfm values is proportional.

Dehumidification applications

A space with a high latent load and a very low sensible load may require tempering capability for dehumidification. Typical spaces of this type are conference rooms or visual aids rooms where people congregate with the lights out.

Dehumidification control is achieved on the 48MA/50ME unit by wiring a humidistat in parallel with the cooling thermostat on any zone requiring dehumidification. This may be done on one module or all modules. When using dehumidification control on electric resistance heat units, use extreme care with power wiring as heating and cooling can operate simultaneously in each module.

When the zone's humidity level reaches the setpoint of the humidistat, mechanical refrigeration is activated for that zone module and the air is dehumidified and then tempered on room thermostat demand before being discharged to the zoned space.

The 48MA/50ME economizer


The 48MA/50ME units can be equipped with an economizer control. The control functions as follows. With ambient temperatures above the economizer changeover point, the outdoor air damper is set at the ventilation position, cooling is accomplished by the compressors when the room thermostat calls for cooling. If the zone is not calling for cooling, the mixed air is circulated thru the space. When the ambient temperature drops below the economizer changeover point, the compressors are locked out and the damper motor is under control of a mixed air thermostat to maintain a mixed air temperature low enough to provide cooling when the room thermostat demands it. NOTE: If a non-critical zone opens the unit economizer when most other zones are in the heating mode, to save energy, disconnect the wire at spade terminal number 4 of non-critical zone cooling relay. This will prevent the non-critical zone from energizing the economizer. Mechanical cooling and heating are not affected.

If a zone thermostat calls for cooling while in economizer mode, a set of cooling relay contacts close, energizing the economizer relay as shown on the Economizer Condensing Schematic.


For economizer damper control, the economizer relay locks out the outside air damper adjustable potentiometer and shifts the damper control to a Mixed Air Thermostat (MAT.). The MAT. sensor, located in the fan section, adjusts the outside air damper to maintain a preset mixed air temperature as shown on the Economizer Damper Control Schematic.

The 48MA/50ME economizer operation provides economic use of outdoor air for low-cost cooling. When all


**VENTILATION AIR CHART,
48MA/50ME016**

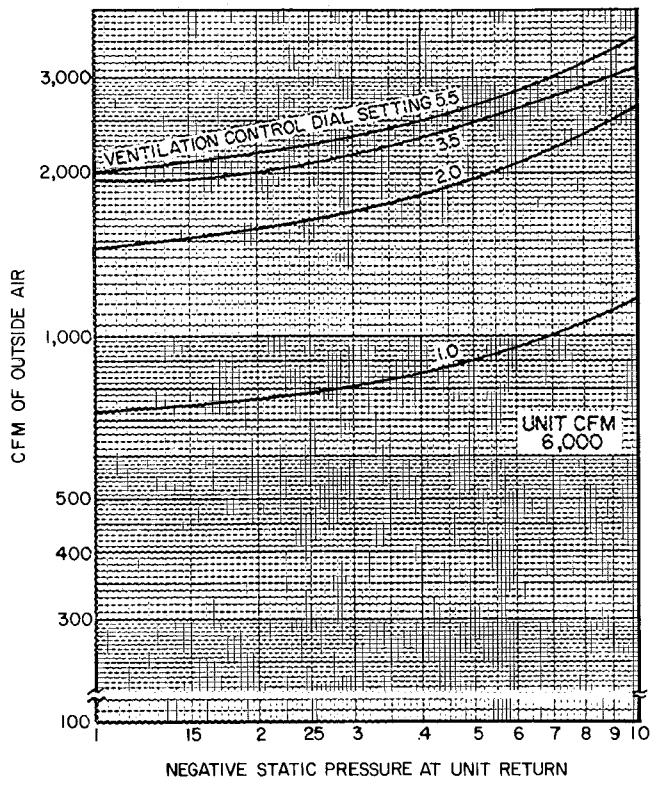


**VENTILATION AIR CHART,
48MA/50ME024**

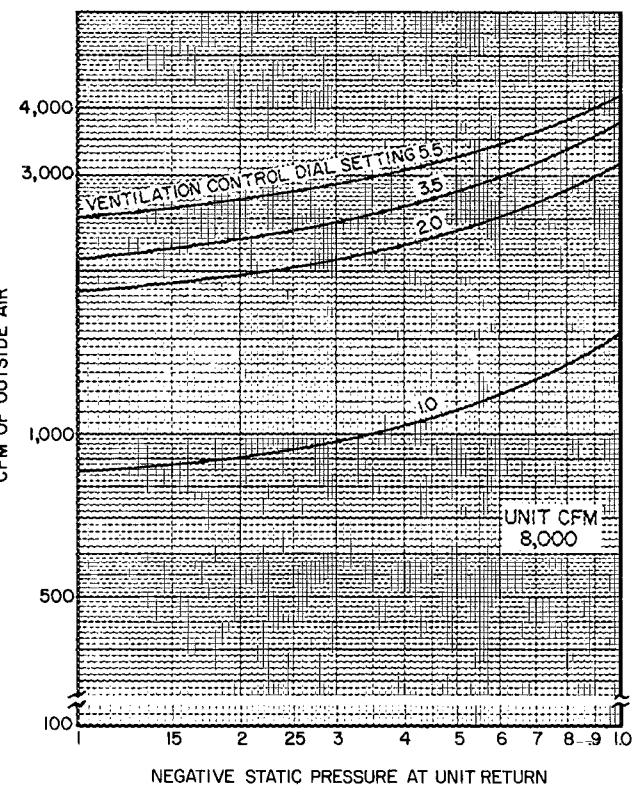

**VENTILATION AIR CHART,
48MA/50ME028,030**

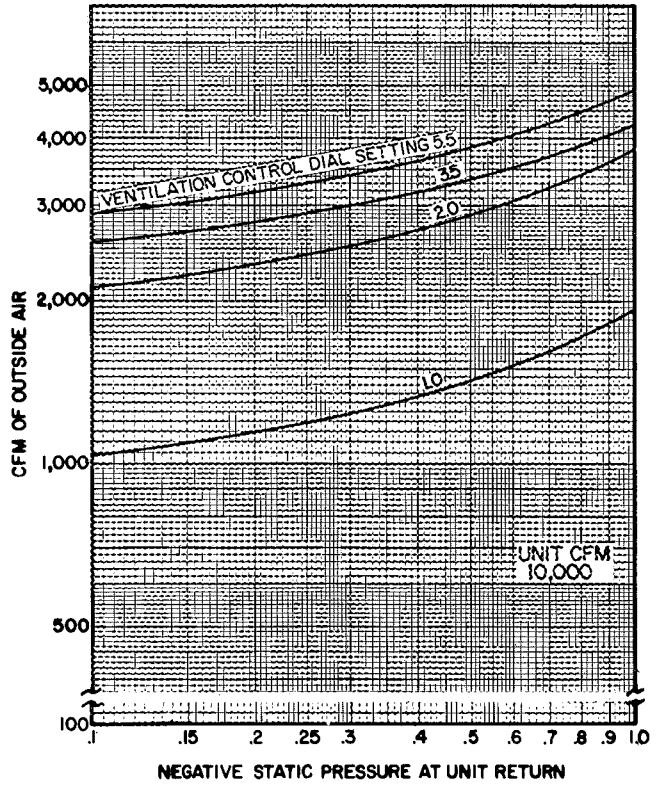

**VENTILATION AIR CHART,
48MA/50ME034,040**

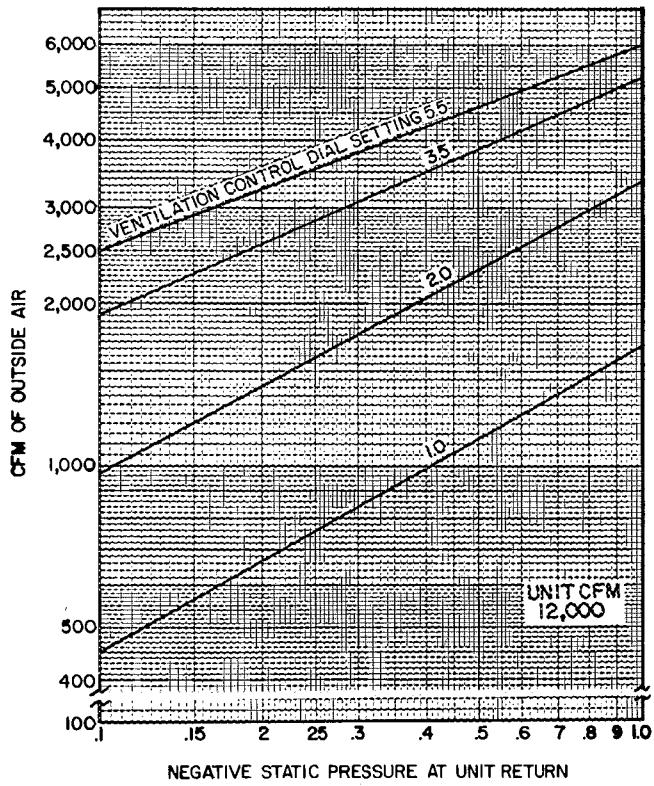

Application data (cont)

zone cooling thermostats are satisfied, economizer controls are bypassed and the outdoor dampers are modulated to the minimum ventilation position.

Refer to Economizer Economics to determine if the addition of an economizer is justified.

Economizer and exhaust performance

An economizer can be factory installed on the 48MA/50ME since the damper motor and outdoor air damper are standard equipment. The economizer package consists of a return air damper, linkage, plug-in relays, MAT, wiring, and mixed air thermostat.


When the 48MA/50ME unit is on full economizer control, the supply cfm to the space drops off slightly since the resistance of the outdoor air intake is generally greater than that of the return air ductwork. To partially offset this, the return air dampers have a built-in bypass.

When the outdoor air dampers are fully open and the return air dampers fully closed, the total cfm drops 15%. The total cfm consists of 70% outdoor air and 30% return air thru the built-in bypass. If, for example, the unit normally operates at 10,000 cfm supply air, the minimum supply cfm

when the economizer is operational is 8500. This 8500 cfm consists of 6000 cfm outdoor air and 2500 cfm return air. As the ambient temperature drops from 48 F (recommended economizer setpoint), the proportion of outdoor air to the supply air required to maintain mixed air temperature is less, the outdoor air damper begins to close, and return air damper begins to open. As this happens, total supply cfm progressively increases from 8500 cfm to 10,000 cfm (design).

An exhaust damper is also available for use with the economizer. It is located between the return air plenum and the condenser fans. The exhaust damper consists of a plug-in relay, an exhaust damper, and a plug-in jumper. The damper provides a forced exhaust of indoor air during the economizer operation. The exhaust damper opens when the return air damper is 25% closed. With the damper installed, exhaust relay and economizer relay are energized simultaneously. The exhaust relay locks out the outdoor fan motor controls. Outdoor (condensing) fan motors operate at full speed, discharging excess return air to the atmosphere thru the open exhaust damper as shown in Exhaust Damper Operation.


ECONOMIZER OPERATION

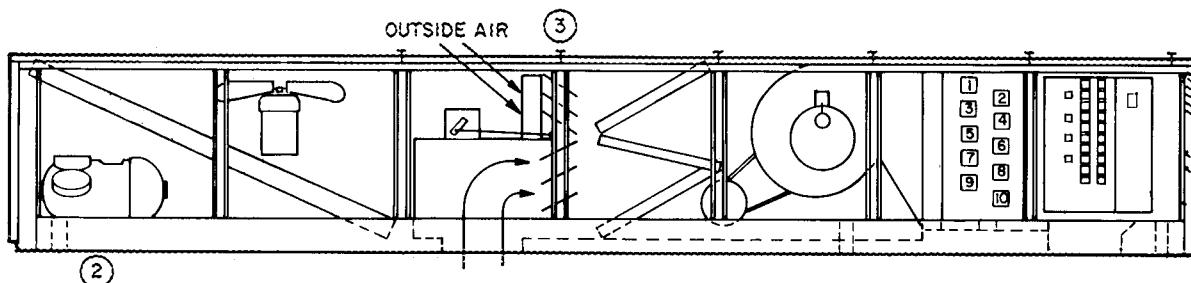

SEQUENCE:

- 1 -- Ambient temperature decreases.
- 2 -- Compressor is locked out by economizer control thermostat
- 3 -- Outside air damper is regulated by mixed air thermostat to maintain fixed mixed air temperature.

ECONOMIZER CONDENSING SCHEMATIC

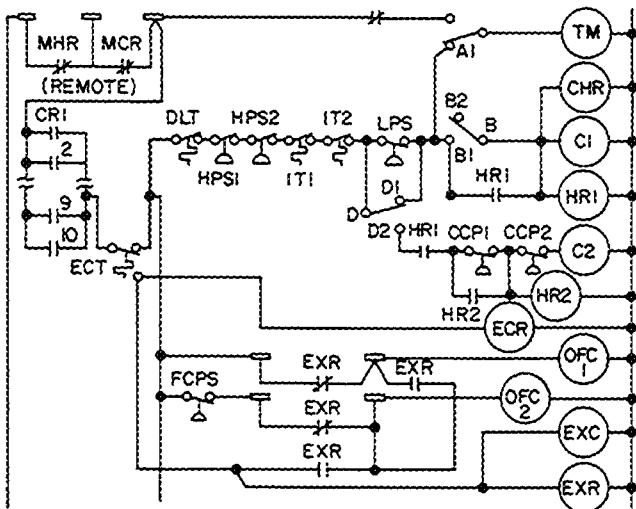

LEGEND

C	- Compressor Contactor
CCP	- Capacity Control Pressurestat
CHR	- Crankcase Heater Relay
CR	- Cooling Relay
DLT	- Discharge Line Thermostat
ECR	- Economizer Relay
ECT	- Economizer Thermostat
EXC	- Exhaust Motor Contactor
EXR	- Exhaust Relay
FCPS	- Fan Cycling Pressurestat
HPS	- High Pressure Switch
HR	- Holding Relay
IT	- Internal Thermostat
LPS	- Low-Pressure Switch
MCR	- Master Cooling Relay
MHR	- Master Heating Relay
OFC	- Outdoor Fan Contactor
TM	- Timer Motor

The 48MA/50ME exhaust operation is similar in performance to a relief damper except that the exhaust dampers are mechanically linked to the return air dampers and the condenser fans operate to produce a pressure differential which aids the exhaust cycle. At approximately 0 in. wg at the return air opening, the 48MA/50ME units exhaust between 150 to 200 cfm/ton. With positive return static, more air is exhausted. At -0.40 in. wg (.25 in. wg on the 016 unit) return air static, exhaust capabilities of the units drop to zero.


In the previous example, the 4000 cfm exhausted at 0 in. return static accounts for all but 1100 cfm outdoor air introduced by the economizer outside air section. In practice, this excess cfm is considered a nominal ventilation rate, slightly pressurizing a building to eliminate drafts and unwanted air seepage. This excess air filters out of the building thru doors and window spaces. The slight positive pressurization of the building aids the exhaust fans in removing air. If, however, the balance between the building static and exhaust system leaves the building with unacceptably high positive static pressures, a relief ventilator or roof power exhauster may be used. For extensive or complicated return air duct systems with static pressure greater than -0.2 in. wg at the return air plenum, duct mounted return air exhaust fans can be installed.

Return air systems

If the ceiling plenum on a top floor is used as a return air plenum, the return air is heated from the time it leaves the room and enters the unit. This added plenum heat is due to roof load or heat from lighting. The roof load does not raise the return air temperature significantly and its effect is negligible when selecting a unit.

Return air light troffers, however, can add considerable heat to the return air. A 48MA/50ME unit with a return air light troffer system can impose various design problems since the purpose of the system is to reduce the supply cfm to the space by reducing the space load. With the 48MA/50ME this may result in a very low supply cfm — much lower than the unit was designed for. If the supply cfm is raised to satisfy the unit, the purpose of the return air light troffers is defeated. As a general rule, a return air


ECONOMIZER DAMPER CONTROL SCHEMATIC

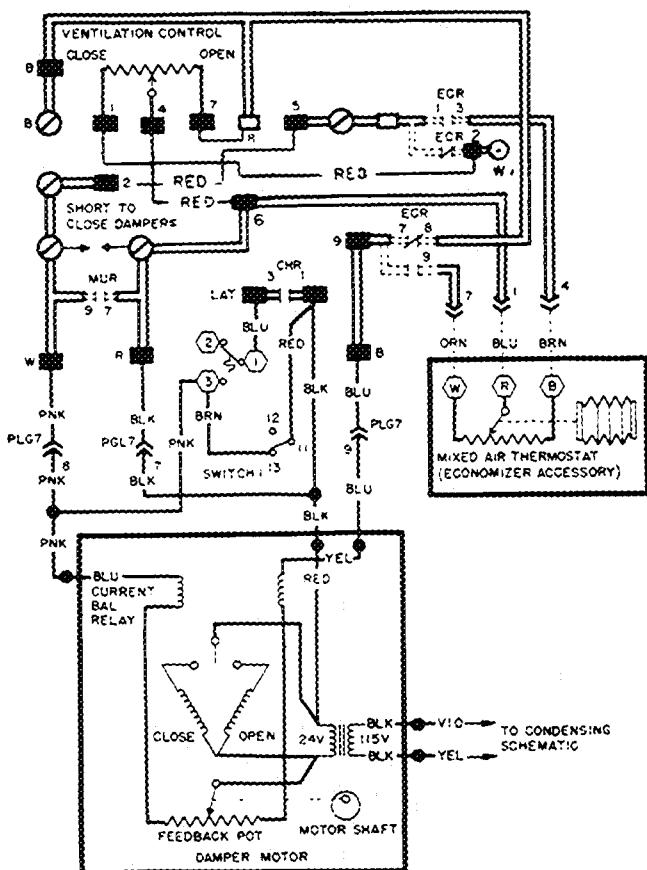

LEGEND

CHR	— Crankcase Heater Relay
ECR	— Economizer Relay
LAT	— Low Ambient Thermostat
MUR	— Master Unit Relay
PLG	— Plug

EXHAUST DAMPER OPERATION

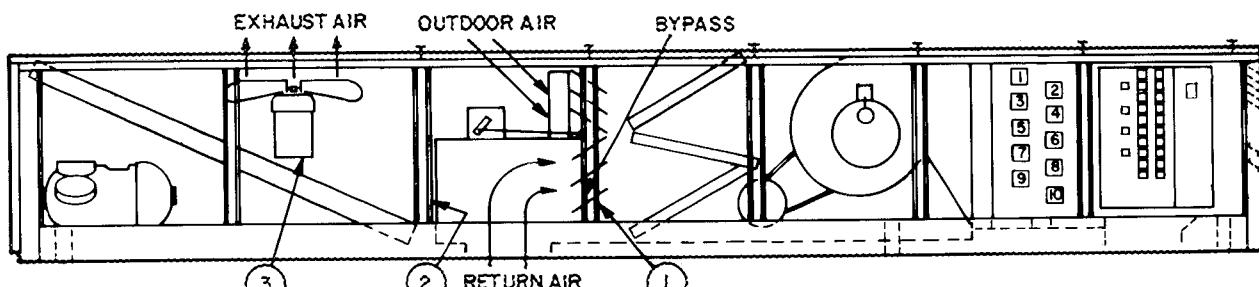

SEQUENCE:

- 1 -- Return damper closes 25%
- 2 -- The exhaust damper opens
- 3 -- The OFM (condensing fans) speed controls are bypassed and fans run full speed, exhausting return air to atmosphere

Application data (cont)

temperature rise of 5 to 10 F does not cause a problem, and special ratings can be made available.

In addition, when the supply cfm is reduced, as above, the outdoor air quantity remains constant. This results in a higher than normal percentage of outdoor air which the 48MA/50ME unit may not be capable of introducing. For return air light troffer systems, exercise care when using the light manufacturer's data concerning the amount of heat actually returned to the unit because with the higher return air temperature, a portion of the heat is transmitted back to the space thru the ceiling.

Economizer economics

Economizer control on a multizone unit does not necessarily reduce operating cost as it would on a single zone unit. A single zone unit either heats or cools; a multizone unit can do both simultaneously. Therefore, in a multizone, the economizer operates to maintain a mixed air temperature low enough to cool a zone with a high internal load. The remaining zones requiring less cooling or heating must have heat added to offset cooling capacity available but not needed. This is true of any multizone with any type of control system.

The amount of heat required to neutralize the overcooling capacity is dependent on:

1. The percent cooling capacity required from the unit, and
2. The mixed air temperature required to satisfy the zone with the highest internal load.

As the ambient temperature drops, the percent of outdoor air needed to maintain a mixed air temperature is less. Since the reheat or wasted heat added is a function of the difference between outdoor air introduced and ventilation rate, operating cost is reduced at lower ambients. A high ventilation rate also reduces the reheat requirement and associated cost. The following example illustrates the need for a careful analysis of job requirements before arbitrarily selecting economizer control.

Example.

A 48MA/50ME unit is operating with economizer control and supplying 10,000 cfm of 55 F mixed air. The normal ventilation rate is 2000 cfm. Assuming a realistic cooling load of 50%, 5000 cfm of the 55 F air is used for cooling. Since the ventilation rate is 2000 cfm, half is sent to the cooling zones leaving 4000 cfm of low-cost cooling. The remaining 5000 cfm of 55 F air, including 1000 cfm of ventilation air, is going to zones with either no load or a heating load and must be neutralized.

Although 4000 cfm of low-cost cooling is obtained, an extra 4000 cfm of air must be heated to some degree above that of a unit without economizer controls.

For an identical unit without economizer control, only 4000 cfm of the 5000 cfm needed for cooling requires mechanical cooling, since the 1000 cfm of ventilation air is already cooled. Of the other 5000 cfm, 4000 cfm is return air and is neutral, and 1000 cfm is ventilation air to be heated. In the final analysis, it must be determined if it is more economical to heat 4000 cfm from 55 F to 75 F, or to cool it from 75 F to 55 F. The answer depends on the efficiency of the cooling and heating source.

As an example of economizer economics, the Economizer Break-Even Point graph plots percent cooling load versus relative energy cost (electricity to gas) and is based on the following typical assumptions:

48MA028 — 10,000 cfm, 15% outdoor air
48 F outdoor changeover temperature
75 F room design
55 F supply air temperature
Compressor C.O.P. of 3.3 (100 F condensing temperature and unloaded compressor were used to obtain this value)

The relative cost figures are in \$/Btu input for gas and \$/kwh electric cost converted to Btu

Example:

\$.25/100,000 Btu (input) — gas cost
\$.031/kwh — electric cost

Convert electric cost:

$$\begin{aligned} \text{$.031/kwh} \times \text{kwh}/3413 \text{ Btu} &\times \frac{100,000 \text{ Btu}}{100,000 \text{ Btu}} \\ &= \text{$.91}/100,000 \text{ Btu} \end{aligned}$$

Cost Ratio.


$$\frac{\text{$.91}/100,000 \text{ Btu}}{\text{$.25}/100,000 \text{ Btu}} = 3.64$$

For 48MA units, the cooling load must be greater than 48% to justify use of economizer.

For 50ME electric heat units, the cooling load break-even point is 70%; the internal load must be greater than 70% to justify economizer control.

The cooling load for this comparison is the internal load (lights and people) minus the negative transmission at the changeover temperature (48 F). To determine the percent cooling load, compare this value to the unit design cooling capacity

48MA/50ME ECONOMIZER BREAK-EVEN POINT

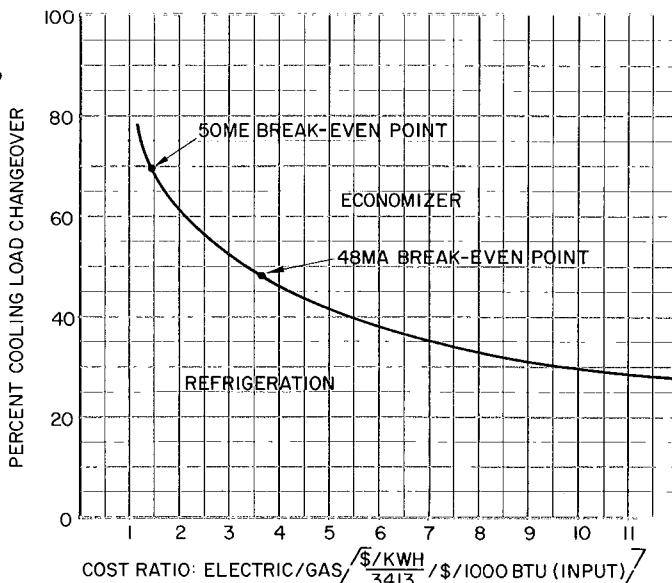

Night setback

Night setback control can be added to a 48MA/50ME unit using field-supplied components. There are 3 sets of terminals on the accessory section as shown in Zone Control Board. Terminal sets are: cooling lockout (CL), night setback (NS) and "Short To Close Dampers." Red jumpers are factory wired across CL and NS; "Short To Close Dampers" are bare. If the circuit between CL terminals is broken, 115-v power to the compressor control circuit liquid line solenoids and economizer thermostat (if used) is shut off. If the circuit between NS terminals is broken, 115-v power to the zone control transformers is shut off. By replacing both jumpers with appropriate switches and connecting proper switch across "Short To Close Dampers," NS control is attained. The 3 most common methods of Night Setback are described below.

For details of actual Night Setback wiring connections, refer to 48MA/50ME wiring booklets.

Method no. 1 — heating night setback cooling locked out, and continuous indoor fan operation

This NS system requires a 7-day timer, a night setback relay and a thermostat (heating type) 24-v service. In this system, when timer reaches the "Night" position, CL opens, dampers close and NS opens. The fan continues to operate.



As the temperature falls, the NS thermostat located in the average temperature space energizes the NS relay which in turn energizes the zone control transformers. The individual zones then heat until the NS thermostat is satisfied. The dampers remain closed and cooling is still locked out. If a day/night switch is used, the NS thermostat is overridden and heating is controlled by the normal thermostats.

Method no. 2 — heating night setback, cooling locked out and cycling indoor fans

This system requires a remote control panel, a 7-day timer, a night setback relay and a thermostat (cooling type). This system requires a master unit relay (MUR) and a master cooling relay (MCR) (24-v wiring). Install the timer and the NS relay in proximity to the remote control panel. This places all wiring inside the building in one area.

In this system, the MUR is energized by the NS controls. This opens a set of normally closed contacts and shuts down the unit, including indoor fans. The outdoor air dampers are also closed by the MUR. Cooling lockout is attained by energizing the MCR. Energizing these 2 relays turns the unit off and the NS system seems to work in reverse.

A cooling thermostat is used on heating NS. When temperature rises, the thermostat, in series with the night switch, energizes the NS relay. Its contacts close and, in series with the time clock contacts, energize the MUR. As the space temperature lowers to the NS setting, the NS thermostat de-energizes the NS relay which de-energizes the MUR, turning on the unit. The day/night switch overrides the NS clock and heating occurs because the NS relay is de-energized. The factory jumpers remain across CL and NS terminals. The dampers close when the indoor fans start. To keep them closed, short across the W-R terminals on the remote control panel or the "Short To Close Dampers" terminals during the NS period.

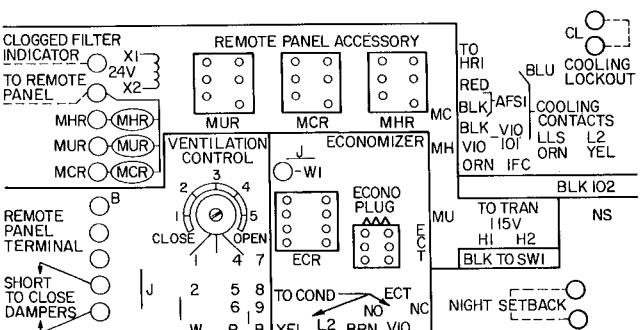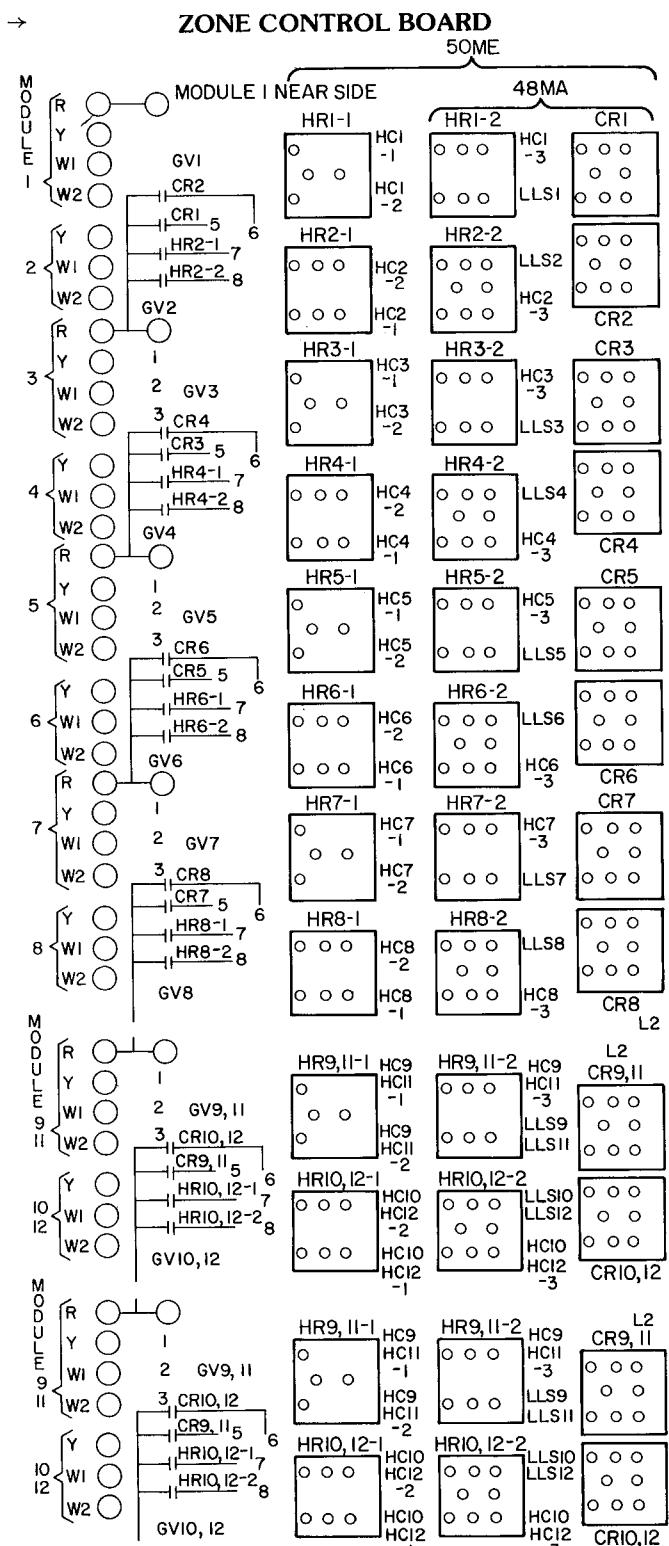

Method no. 3 — heating and cooling night setback and indoor fan cycling — This system requires a remote control panel, a heating and cooling thermostat with subbase, a night setback relay and a 7-day timer.

Because cooling is not locked out, the clock switches that close at night close the outdoor air dampers by connecting across R and W on the remote panel accessory. The MUR shuts down the unit (including the indoor fans). When the NS thermostats reach their settings, the NS relay is energized, opening the NC contacts and de-energizing the MUR.

However, if a "wild" zone exists, it is allowed to cool on heating NS or vice versa. This may be an advantage on some applications between zones. When the day/night is switched to "Day," the NS is overridden and the unit operates normally except the dampers remain closed at night. The 2 jumper wires have to be removed from the back of the remote panel to isolate the day/night switch.

Morning start-up — To conserve energy and lower total operating costs, the outdoor dampers may be closed when starting the system in the morning. During a warm-up period, when the system is operated for one or 2 hours before occupancy, heat only building return air. The extra load of cold outdoor air introduced uses extra heat energy. Ventilation is unnecessary until space is occupied, so the air introduced produces unnecessary heat waste.

This principle holds true on a cooling day, when outside air transmits heat and moisture to the evaporator coil. This extra load above the return air only load is an unnecessary expense.

To offset this, wire a heating or cooling thermostat across the "Short To Close Dampers" terminals on the zone control board. The thermostat senses return air

temperature and the outdoor air damper does not open until the building is at the required temperature.

A time clock can also be used and set as follows:

1. Occupied cycle: 8 a.m. to 6 p.m. Outdoor air damper is open and the system is controlled by individual zone thermostats.
2. Night setback cycle: 6 p.m. to 6 a.m. Individual zone thermostats are on night setback (NS) cycle. The outdoor air damper is closed, the unit is reset down and controlled by NS thermostat.
3. Warm-up (or cool-down) cycle: 6 a.m. to 8 a.m. Outside air damper is closed by time clock and the system is controlled by indoor zone thermostats.


Using any method, increased economy is achieved and building requirements are satisfied.

Sound and vibration

For maximum sound attenuation, locate roof-mounted multizone units over unoccupied space (i.e. storage areas, utility rooms, corridors) where slightly higher sound levels are not objectionable. Line supply and return duct systems with acoustic material to prevent sound transmission into occupied space. If open plenum return air systems are used, install an acoustical trap or fiberglass-lined chamber to attenuate sound. Use simple return duct elbows and tees with 5-ft minimum fiberglass-lined legs and low static pressure on open plenum return air systems. A method of forming an acoustical trap using the roof curb area under a multizone unit is shown on Acoustical Trap Installation.

Special vibration isolating bases and curbs designed for rooftop applications are available from some vibration isolator manufacturers. This equipment virtually eliminates vibration transmission on critical applications. However,

ACOUSTICAL TRAP INSTALLATION

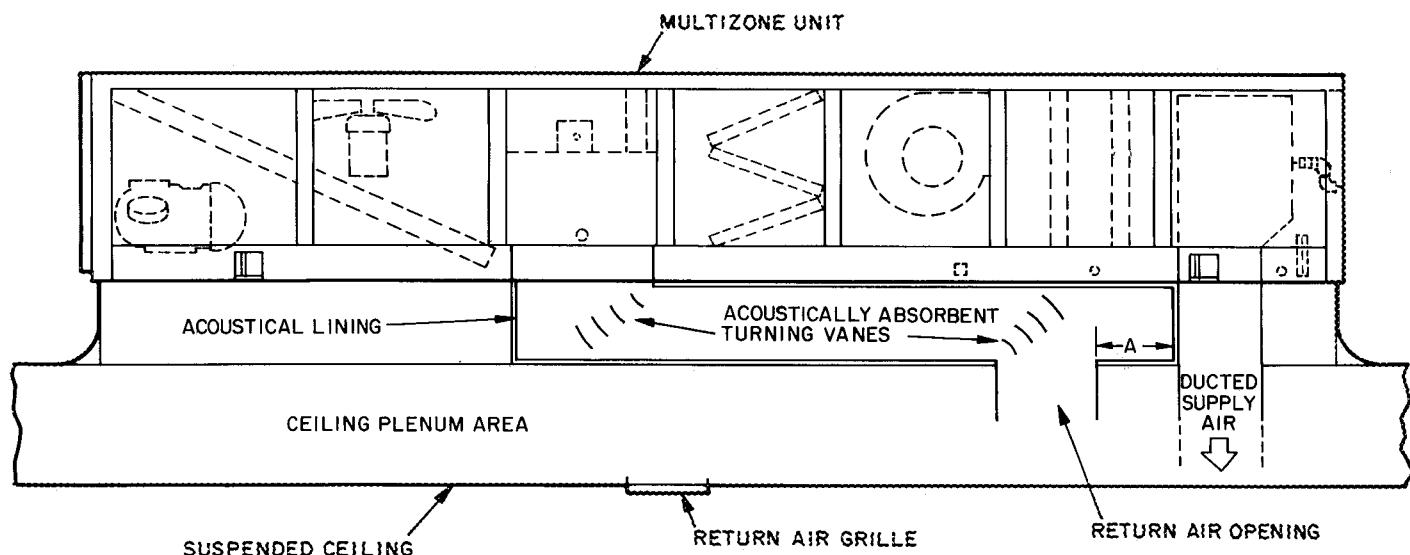

NOTES:

1. Dimension A is approximately 7 in. for optimum performance.
2. Acoustical lining is 1-in. 1-lb density, neoprene-coated fiberglass.
3. Return air grille should be located at least 15 ft from return air opening.

Application data (cont)

exercise care when selecting this equipment for use with a multizone. The design and installation of vibration rails on a Carrier 48MA/50ME should ensure that the interfacing of the vibration isolator and the curb maintain watertight integrity.


Thermostat usage and control

Usage — The thermostats used with the 48MA/50ME units are either a 2-step heat/1-step cool or 2-step heat/2-step cool. A single module can have only one step of cooling and heating. When 2 or more modules are grouped together, use the 2-step heat/2-step cool thermostat.


Modules are grouped together by the installation of factory-supplied jumpers on the unit zone control board.

The thermostats are automatic changeover with a 3 F dead spot between heating and cooling. There is a 1 F differential between the first and second steps of heating or cooling. Two subbases are available for use with the thermostats; one with off-heat-auto.-cool switch and one without switches for tamperproof installation. The tamperproof subbase has provisions for locking the thermostat cover and temperature selectors. Refer to 48MA/50ME wiring booklet for thermostat wiring connections.

Typical piping and wiring

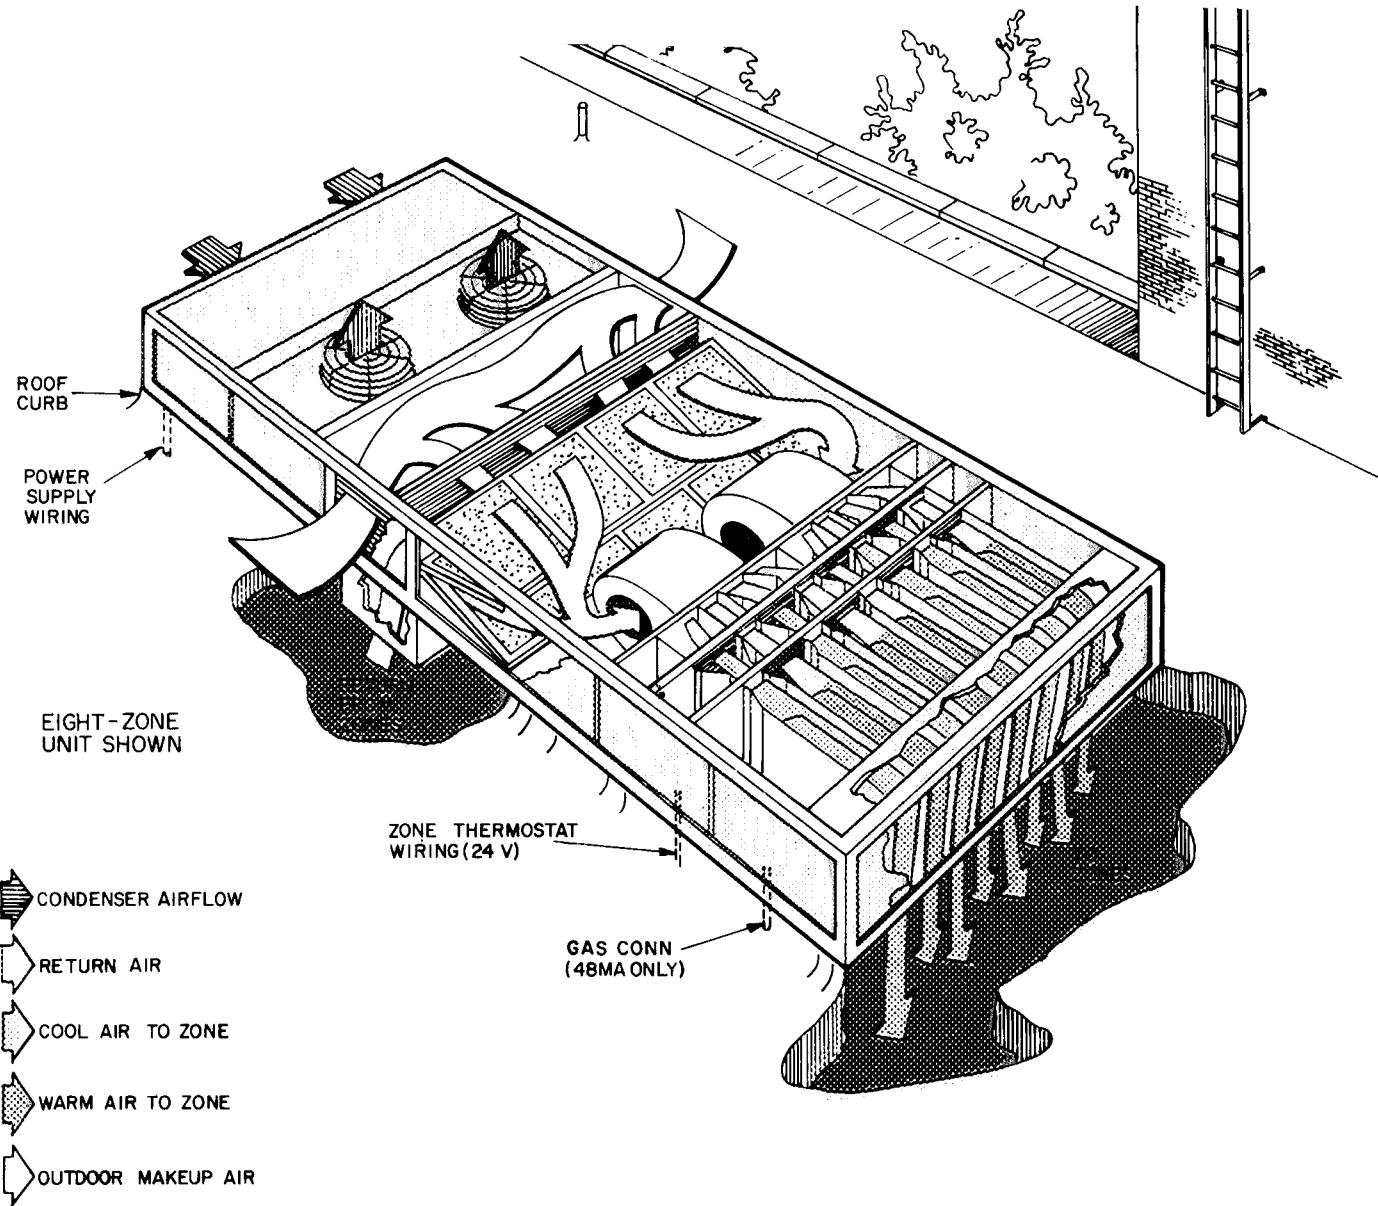

Typical schematic (50ME shown)

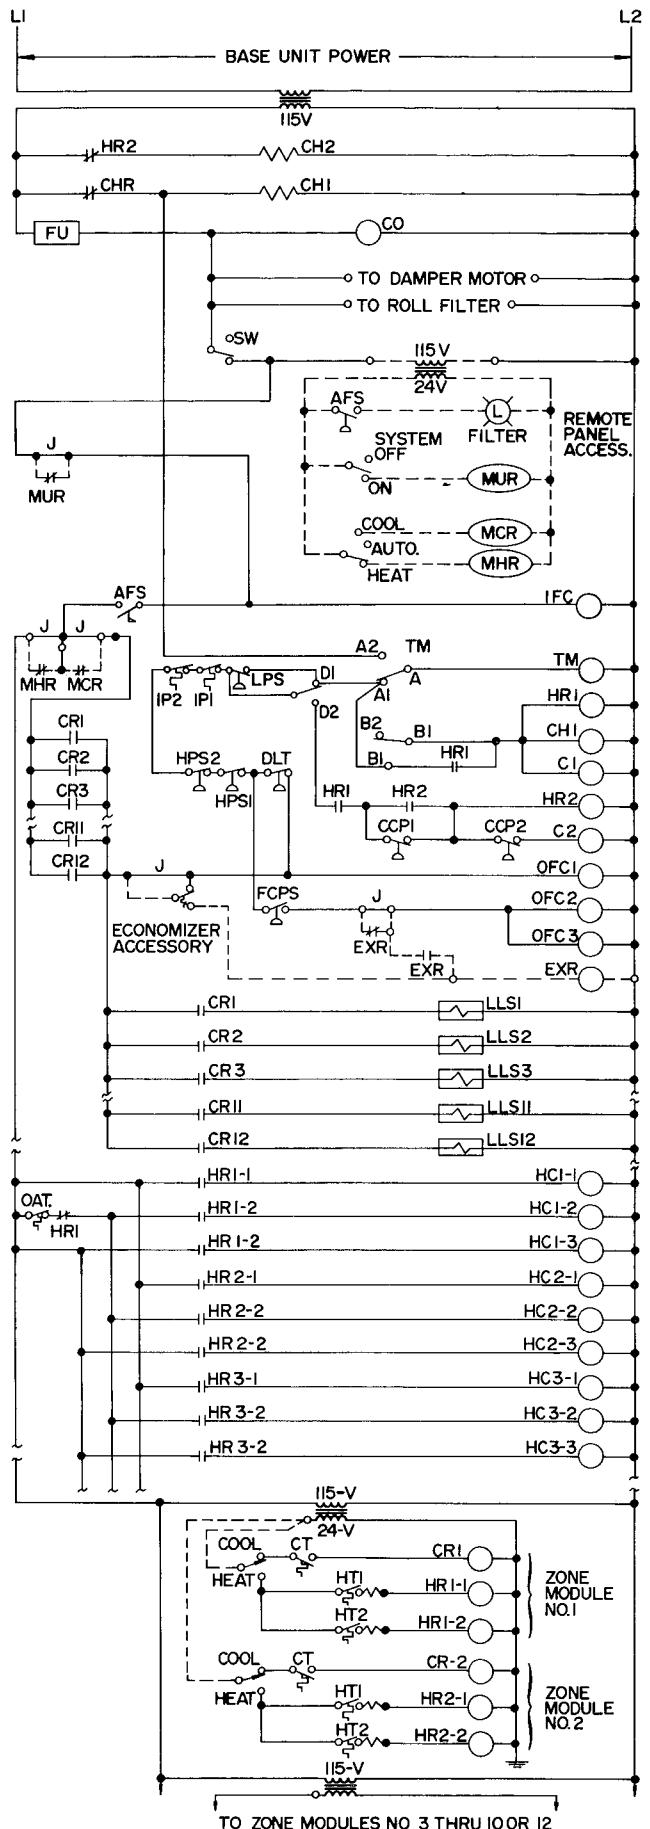

LEGEND

AFS	Air Flow Sensor
APS	Air Pressure Switch
C	Compressor
CCP	Capacity Control Pressurestat
CH	Crankcase Heater
CHR	Crankcase Heater Relay
CO	Convenience Outlet
CR	Cooling Relay
CT	Cooling Thermostat
DLT	Discharge Line Thermostat
ECR	Economizer Relay
ECT	Economizer Thermostat
EXR	Exhaust Relay
FCPS	Fan Cycling Pressure Switch
Fu	Fuse
HC	Heating Contactor
HPS	High-Pressure Switch
HR	Heating Relay
HT	Heating Thermostat
IFC	Indoor Fan Contactor
IP	Internal Protector
J	Jumper
LAT	Low-Ambient Thermostat
LLS	Liquid Line Thermostat
LPS	Low Pressurestat
MCR	Master Cooling Relay
MHR	Master Heating Relay
MUR	Master Unit Relay
OAT.	Outdoor Air Thermostat
OFC	Outdoor Fan Contactor
Sw	Switch
TM	Timer Motor
—	Factory Wiring
- - -	Field or Option Wiring

Guide specifications

Base unit

General — Install _____ self-contained electric cooling, natural or propane gas heating or electric cooling/electric heating (hot water glycol heating) multizone unit(s) specifically designed for rooftop installation mounted on a curb supplied by unit manufacturer. There shall be _____ zones, each having capability to heat or cool independently of requirements of other zones. Compressor(s) shall be capable of unloading in steps of approximately 5 tons to follow variations in cooling loads. Hot gas bypass shall be used to maintain a correct minimum suction temperature at loads below minimum compressor capacity step or between capacity steps. Individual zone control shall not require mixing of heated and cooled air to maintain desired space conditions. All outdoor air for ventilation must pass thru a cooling coil and be cooled and dehumidified whenever mechanical cooling is operating. Unit design shall be tested and certified by AGA. All electrical components shall be UL listed.

Cabinet — The unit frame shall be constructed of 6000 series aluminum extrusions. Panels shall be constructed of galvanneal steel, bonderized and finished with a baked enamel finish. All panels requiring insulation shall be constructed of 2 separate panels filled with polyurethane foam insulation. All side panels shall be fastened by quick-release compression fasteners and shall be sealed against weather and air leakage by the use of refrigerator door type gaskets. All top panels are to be easily and individually removable for complete access of all components from top as well as sides of unit and shall be fully gasketed to prevent air and water leakage and be able to support the weight of a 250-lb man walking on top of unit. Unit shall not be over (3 ft, 016,024,028,030) (4 ft, 034,040) above the curb height or weigh over (4000 lbs, 016,024; 4500 lbs, 028,030; 6000 lbs, 034,040).

All utility connection openings shall be provided within the curb enclosure. Alternate heating connection openings shall be provided in cabinet front panel to permit installation of shutoff device where required by local codes (48MA).

Alternate electric heating connection openings shall be provided in cabinet front panel (50ME)

Cooling — Unit shall have a total capacity of _____ Btuh with a sensible capacity of _____ Btuh while operating at inside conditions of _____ F db and _____ F wb with a total air quantity of _____ cfm and _____ cfm of outdoor air for ventilation. Compressor power shall not exceed _____ kw at these conditions. The refrigerant circuit shall include an accumulator, shutoff valves for compressor suction and discharge, liquid line, and hot gas line. Filter drier and crankcase heater(s) shall be furnished. Unit shall have serviceable hermetic compressor(s) (one on 016, 2 on 024, 028,030,034 and 040).

Heating (48MA) — Unit shall have a heating input of _____ Btuh. Gas furnace heat exchangers shall be manufactured of Porcelon™. Burners shall be constructed of stainless steel. Forced-draft combustion shall be standard. The following safety devices shall be part of the gas heating control circuit; main blower airflow switch, combustion air blower flow switch, combustion chamber access door switch, flame sensor, and heating limit switch(es). Each of

these devices must be closed, indicating a safe condition, before gas valve can be energized. Unit shall include a redundant gas valve with intermittent pilot ignition.

Heating (50ME) — Electric heat unit shall have a heating capacity of _____ Btuh. Each zone module shall have a 2- or 3-stage electric resistance heater assembly and include circuit breakers, automatic resetting switches for primary thermal protection and heat limiters (fusible links) for secondary thermal protection. Last stage of heat shall be controlled by an adjustable outdoor air thermostat. A lock-out circuit to keep one stage of heaters off if any module is in cooling mode shall be provided. Hot water/glycol heat unit shall have a heating capacity of _____ Btuh. Each zone module shall have its own heating coil. Each heating coil shall include an electric solenoid control valve and a balancing valve. Bleed valves shall be provided. All zone module heating coils shall be factory piped in parallel and shall require no internal field piping or wiring.

Reheat humidity control in zone(s) _____ shall be included by installing a humidistat in parallel with the cooling thermostat.

Electrical controls — Unit shall be equipped with a time-delay device to prevent short cycling of compressors and ensure staged starting of dual compressor units. Head pressure control down to -20 F with low-ambient starting capabilities shall be furnished. All internal control wiring shall be 115 volts. All external control wiring shall be 24 volts. Factory-installed circuit breakers for power and control circuits shall be suitable for use as disconnect switches. A 350-va, 115-volt convenience outlet shall be part of the main control panel. All relays shall be the plug-in type for reliability and ease of maintenance. In the event of a main blower failure, the complete unit shall be shut down electrically.

Filters — 41.6 sq ft of 2-in. low-velocity (optional, high-velocity) filters shall be used. (An optional roll filter with 65 ft of 2-in. media shall be used.)

Outdoor air damper — Unit shall be equipped with a modulating outdoor air damper controlled by an electric motor and shall be adjusted by setting a rheostat on the control panel.

Indoor air fans shall consist of (2) (3) 15-in. wheels capable of moving _____ cfm of air against an external static pressure of _____ in. wg utilizing _____ bhp. A _____ hp motor shall be installed.

Accessories and options

Roof curb — Install a 2-piece galvanized steel roof curb. Condenser section shall incorporate a pitched panel for water drainoff and a main power electrical opening. A seal strip shall be included to seal space between unit and curb and provide vibration isolation.

Economizer — An economizer control shall be included which shuts off mechanical refrigeration at _____ F outdoor air temperature and modulates outdoor air and return air damper to maintain a mixed air temperature of _____ F.

Guide specifications (cont)


Exhaust feature — Provision shall be made for positive exhaust of room air when unit is operating on economizer cycle.

Remote control panel — Furnish a remote control panel which contains a ventilation position adjustment, SYSTEM switch, DAY/NIGHT switch, HEAT-COOL-AUTO-OFF switch and a clogged filter indicator light. Panel must have provision for 3 additional indicator lights

High-efficiency filters — Furnish and install filters with 36.5% efficiency (NBS Dust Spot Test).

Roll filter — Install a motorized roll filter with 65 ft x 2-in. of media, a runout switch and automatic advancing switch.

Cooling only — Unit shall have no heaters but shall have 24-volt heating controls and 115-volt power terminals suitable for operation of field-installed steam, hot water or electric heat.

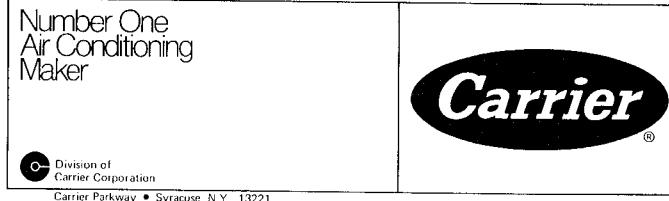

Manufacturer reserves the right to discontinue, or change at any time, specifications or designs without notice and without incurring obligations.

Book	1	1
Tab	1c	1d

Form 48MA/50ME-3P Supersedes 48MA/50ME-2P

Printed in U S A

1-82

PC 111

Catalog No 524-814

Free Manuals Download Website

<http://myh66.com>

<http://usermanuals.us>

<http://www.somanuals.com>

<http://www.4manuals.cc>

<http://www.manual-lib.com>

<http://www.404manual.com>

<http://www.luxmanual.com>

<http://aubethermostatmanual.com>

Golf course search by state

<http://golfingnear.com>

Email search by domain

<http://emailbydomain.com>

Auto manuals search

<http://auto.somanuals.com>

TV manuals search

<http://tv.somanuals.com>